

HTE# 04500-19917R

Harnett County Department of Public Health

20639

PERMIT # 25223

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 1277

Name: (owner) Shawn & Stacey McCredden

SUBDIVISION _____

LOT # _____

System Installer: Mike Rng

Registration # _____

23.76 ac

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet Well not installed as of 3-24-09

System Type: Pump to Gravel III b Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

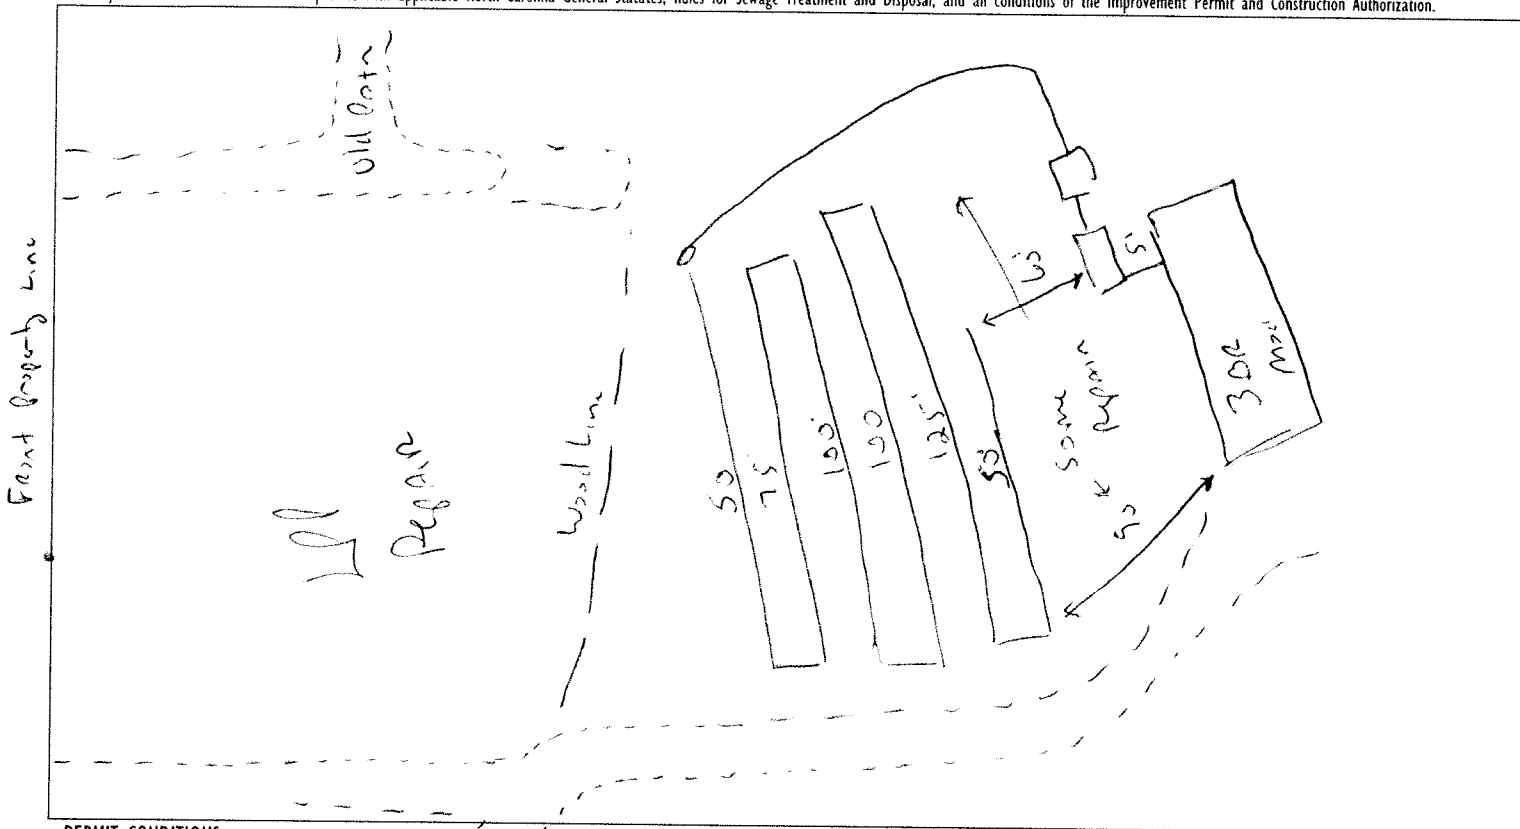

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

Need Final grade around River & electrical box

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to Gravel Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 500 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent

[Signature]

Date

04-14-09