

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner: 08500-22637

Applicant: _____

Address: _____

Date Evaluated: _____

Proposed Facility: MH

Design Flow (.1949): 200

Property Size: _____

Location of Site: S.H.M

Property Recorded: _____

Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
S 9%		0-30	GR JL	VFA J2					.5
		30-36	SOH JCL	FR J2					
		0-20	GR JL	VFA JF					
		20-30	SOH JCL	FR JF					
		0-24	GR JL	VFA JF					
		24-30	SOH JCL	FR JF					
		0-24	GR JL	VFA J2					
		24-30	SOH JCL	FR JF					
		0-24	GR JL	VFA J2					
		24-30	SOH JCL	FR JF					
		0-24	GR JL	VFA J2					
		24-30	SOH JCL	FR JF					

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	San	San
Site LTAR	.5	.5

Other Factors (.1946): _____
 Site Classification (.1948): B1
 Evaluated By: JW
 Others Present: _____


COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND		FR-FRIABLE	SS-SLIGHTLY STICKY
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FI-FIRM	S-STICKY
FS-FOOT SLOPE		L-LOAM		VFI-VERY FIRM	VS-VERY STICKY
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	EFI-EXTREMELY FIRM	NP-NON-PLASTIC
H-HEAD SLOPE		SIL-SILT LOAM			SP-SLIGHTLY STICKY
CC-CONCLAVE SLOPE		CL-CLAY LOAM			P-PLASTIC
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			VP-VERY PLASTIC
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

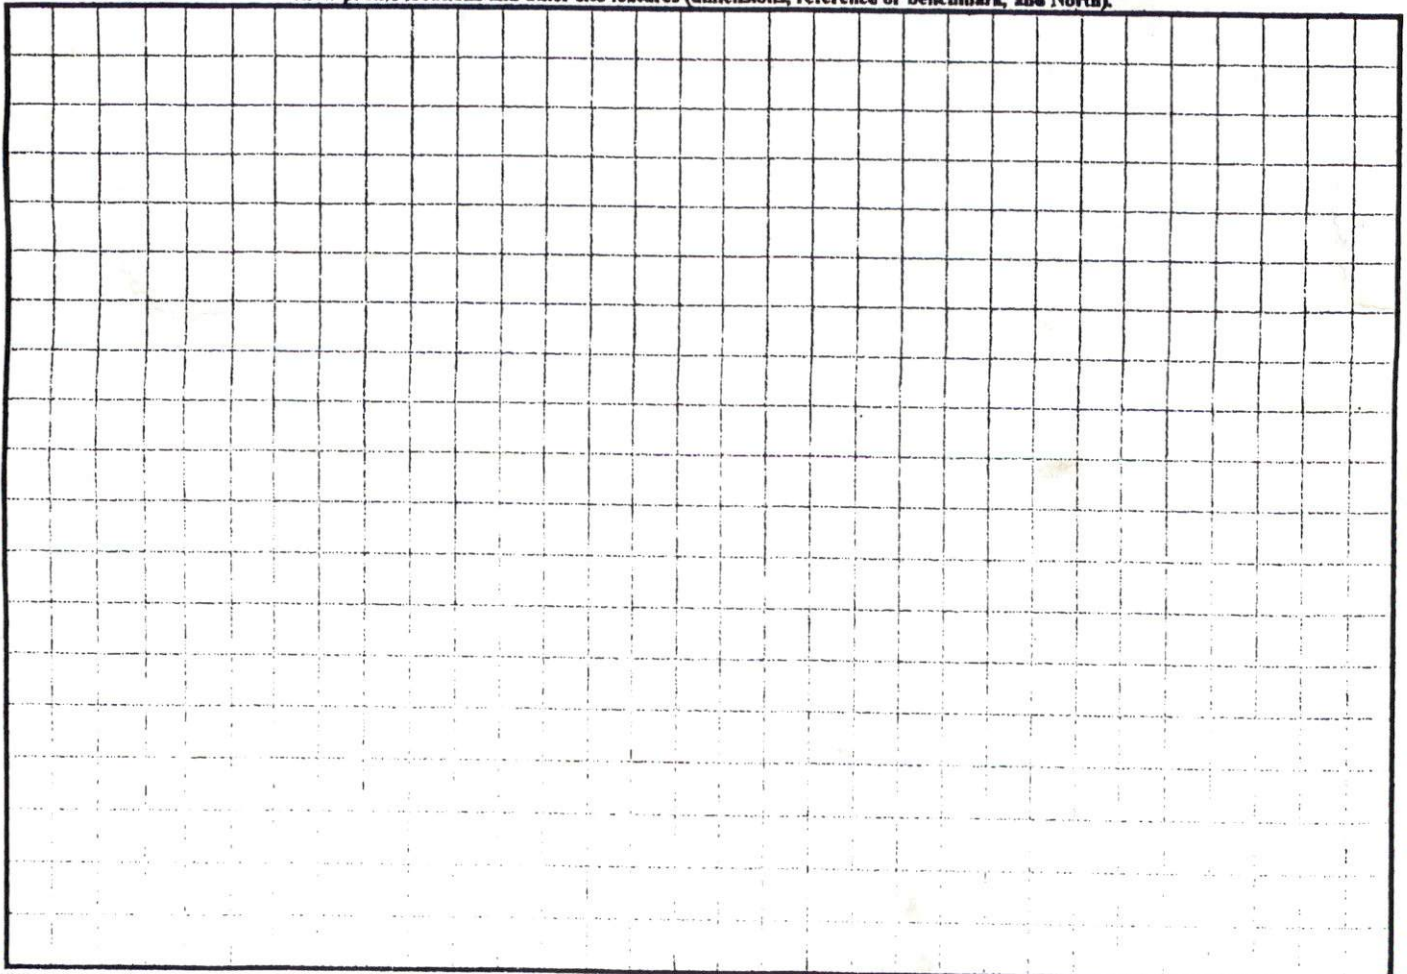

* NOT IN USE

SITE PLAN APPROVAL 274X76 MOD

DISTRICT RA-30 USE

#BEDROOMS 3

Date 7-29-08 N.C. Form 4


Zoning Administrator 249.37'

[Signature]

LOT 4

NCSR #1295 "SUITE 21" 60' R/W

EXISTING 4" WATER MAIN

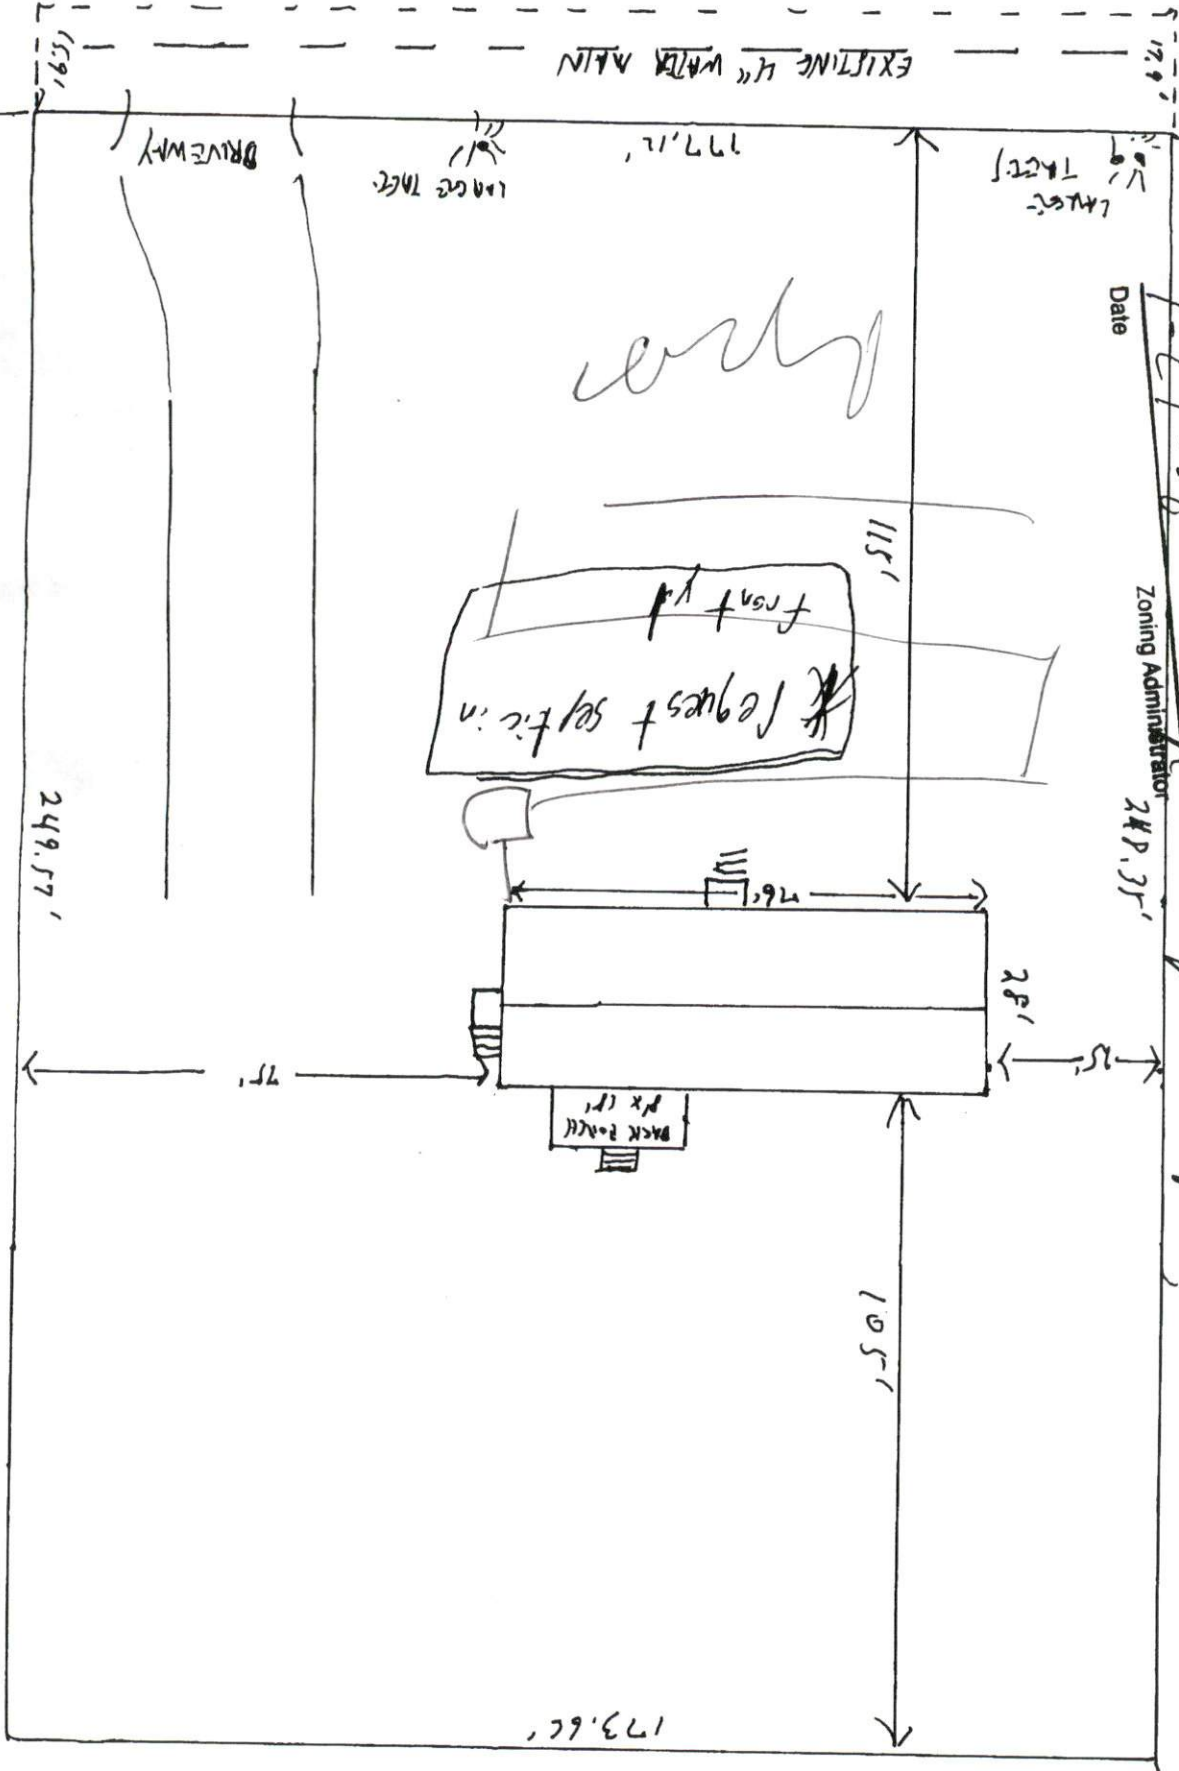

T 3, SUITE FORMS SUBMISSION

(LOT 2)