

HTE# 095-2260

Harnett County Department of Public Health

21076

PERMIT # 25324

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: DARROCK RD (COUNTRY COVE)

Name: (owner) SHUPE, CHRISTOPHER & HELEN SUBDIVISION _____ LOT # _____

System Installer: GERALD TEMPLE Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIb Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

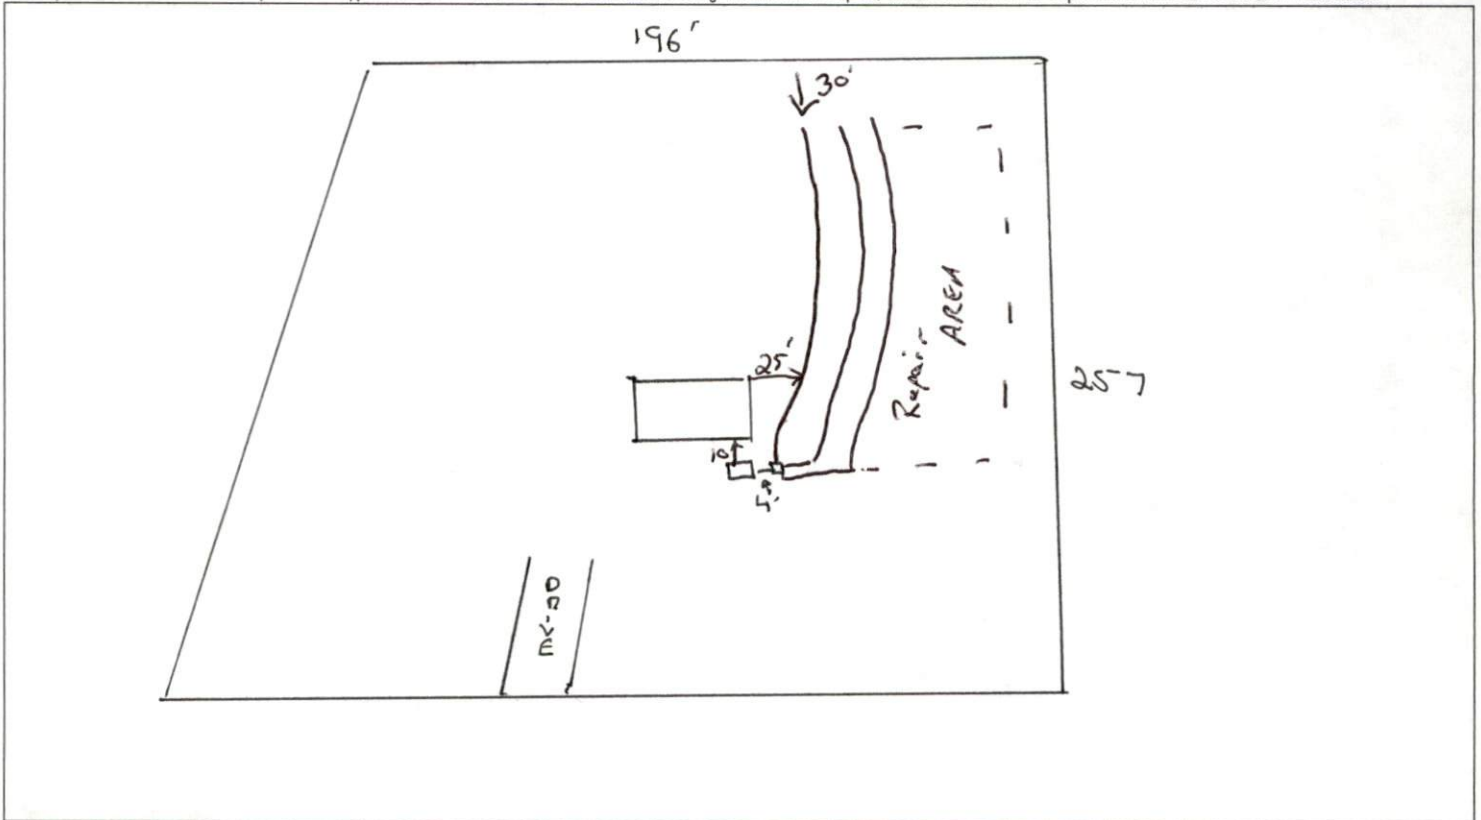

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: TANK CHECKED ON 10/7/09 BY OT *Needs Water & Power line check 12/30/09
WATER LINE CHECKED ON 12/28/09

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of ditches 3 exact length of each ditch 120 feet width of ditches 3 feet depth of ditches 18-24 inches

Drainage Field _____

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] REHS

Date 12/31/09

Bm
10/9/09