

**HARNETT DEPARTMENT OF PUBLIC HEALTH PERMIT  
TO CONSTRUCT A DRINKING WATER SUPPLY WELL**

PIN #: 9597-68-05947.000 Parcel #: 03 9597 0078 01 Application #: 10-5-24381 Subdivision: \_\_\_\_\_ Lot #: 2

Applicant Name: Robert A. Becquet  
Address: 12604 NC 27 W. Broadway, NC 27505

Type of Facility Served by Well: SFD

Sewage System: Pump to 25% Reduction System

Permit Conditions: Well must be 100 feet away from any part of septic system

General Permit Conditions:

- Drinking water supply well construction must meet 15A NCAC 02C.100 rules
- The permitted drinking water supply well shall be located in accordance with the **SITE PLAN**
- **ANY ALTERATION** of the site of the site (including location of structures and appurtenance) or modification in use of the well, may subject this Permit to revocation

Authorized State Agent \_\_\_\_\_ Date \_\_\_\_\_

Grouting Inspection Witnessed \_\_\_\_\_ Date \_\_\_\_\_

Grouting self-certified by driller GW-1 provided?  Yes  No

See attachment for construction sketch

**WELL CERTIFICATE OF COMPLETION**

Date: 9/29/2010 Application #: 10-5-24381 Well Contractor: Jackson Well

Applicant Name: Robert A. Bequet  
Address: 12674 NC 27 W. Broadway, NC 27505  
Directions to Site: 27w from lillington about 12 miles on left

Use of Well: sfd Date Drilled: 9/14/2010 Total Depth: 125 ft Replacement Well?  Yes  No  
Static Water Level: 70 ft Top of Casing is 12 in. above surface. Yield: 25 gpm at \_\_\_\_\_ ft.  
Disinfection: Type hth Amount 10g

<u>Water Zone (depth)</u>	<u>Casing</u>	<u>Grout</u>
From <u>85</u> To <u>87</u>	From <u>0</u> To <u>54ft</u>	From <u>0</u> To <u>20ft</u>
From <u>112</u> To <u>114</u>	Diameter: <u>6</u> Material: <u>pvc</u> Thickness: _____	Material: <u>sand/cement</u> Method: <u>pour</u>
From _____ To _____	From _____ To _____	From _____ To _____
	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____
	From _____ To _____	From _____ To _____
	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____

Inspector: \_\_\_\_\_ On Hold Date: \_\_\_\_\_ Release Date: 9/30/2010

Remarks: \_\_\_\_\_

**Well Head Information**


Casing Height: 12 in (above finished grade) Access Port: yes Vent Stack: yes  
Well ID Tag: yes Pump ID Tag: yes Sampling Tap: yes Backflow Preventer: \_\_\_\_\_  
Sample Taken?  Yes  No Well Head properly sealed: yes

Remarks: \_\_\_\_\_

Authorized State Agent [Signature] Date 9/30/2010

See Attachment for completion sketch

**Well Construction Sketch**

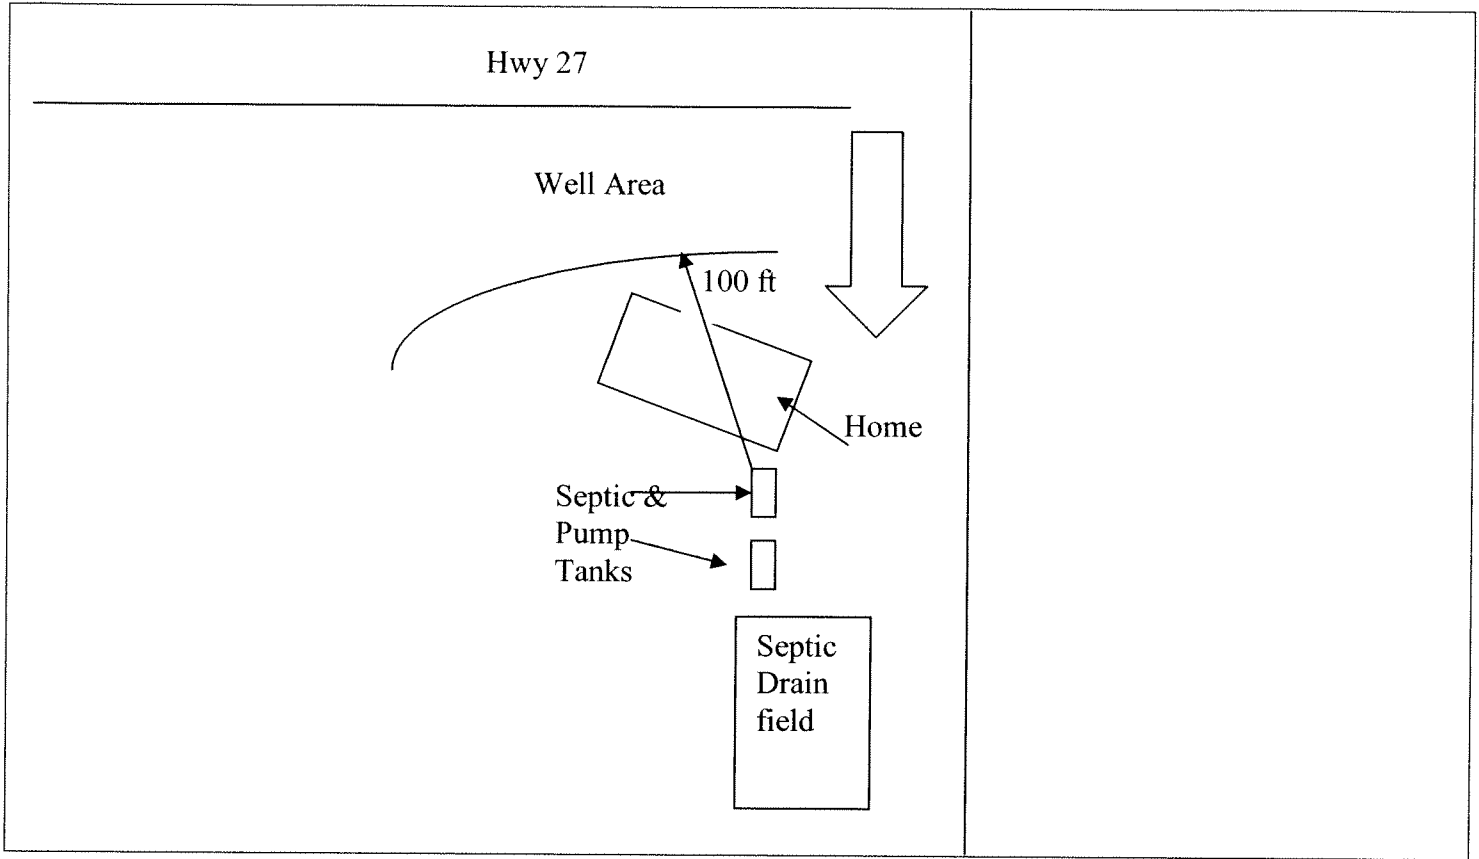

**Well Completion Sketch**

