

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM


Owner: Applicant: BV FZ Date Evaluated: 12-6-7-4
 Address: MOY Design Flow (.1949): 480 Property Size:
 Location of Site: Property Recorded:
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

| P R O F I L E # | .1940 Landscape Position/ Slope % | Horizon Depth (In.) | SOIL MORPHOLOGY .1941 | | OTHER PROFILE FACTORS | | | | Profile Class & LTAR |
|--------------------------------------|--|---------------------------|--------------------------------|------------------------------------|------------------------------------|------------------------------|-------------------------|-------------------------|----------------------------|
| | | | .1941 Structure/ Texture | .1941 Consistence Mineralogy | .1942 Soil Wetness/ Color | .1943 Soil Depth (IN.) | .1956 Sapro Class | .1944 Restr Horiz | |
| 1 | L 4% | 0-28 | SL | ORGANOSP | | | | | |
| | | 28-48 | SCL | fm 15945.1 | 40" 7.54 4.2 | | | | .4 |
| 2 | L 4% | 0-20 | SL | ORGANOSP | | | | | |
| | | 20-40 | SCL | fm 15945.1 | 36" 7.54 4.2 | | | | .35 |
| 3 | L 3% | 0-22 | SL | ORGANOSP | | | | | |
| | | 22-48 | SL | fm 15945.1 | 40" 7.54 4.2 | | | | .4 |
| 4 | L 3% | 0-20 | SL | ORGANOSP | | | | | |
| | | 20-48 | SL | fm 15945.1 | 42" 7.54 4.2 | | | | .4 |

| | | | |
|-------------------------|-------------------------------------|-------------------------------------|--|
| Description | Initial System | Repair System | Other Factors (.1946): Site Classification (.1948): Evaluated By: <u>BV</u> Others Present: |
| Available Space (.1945) | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | |
| System Type(s) | <u>252</u> | <u>252</u> | |
| Site LTAR | <u>.4</u> | <u>.35</u> | |

SITE PLAN APPROVAL
 DISTRICT HA 30 USE MDD
 #BEDROOMS 4
 Zoning Administrator N/C BM
 Date 12-1-11

$1 = 10$

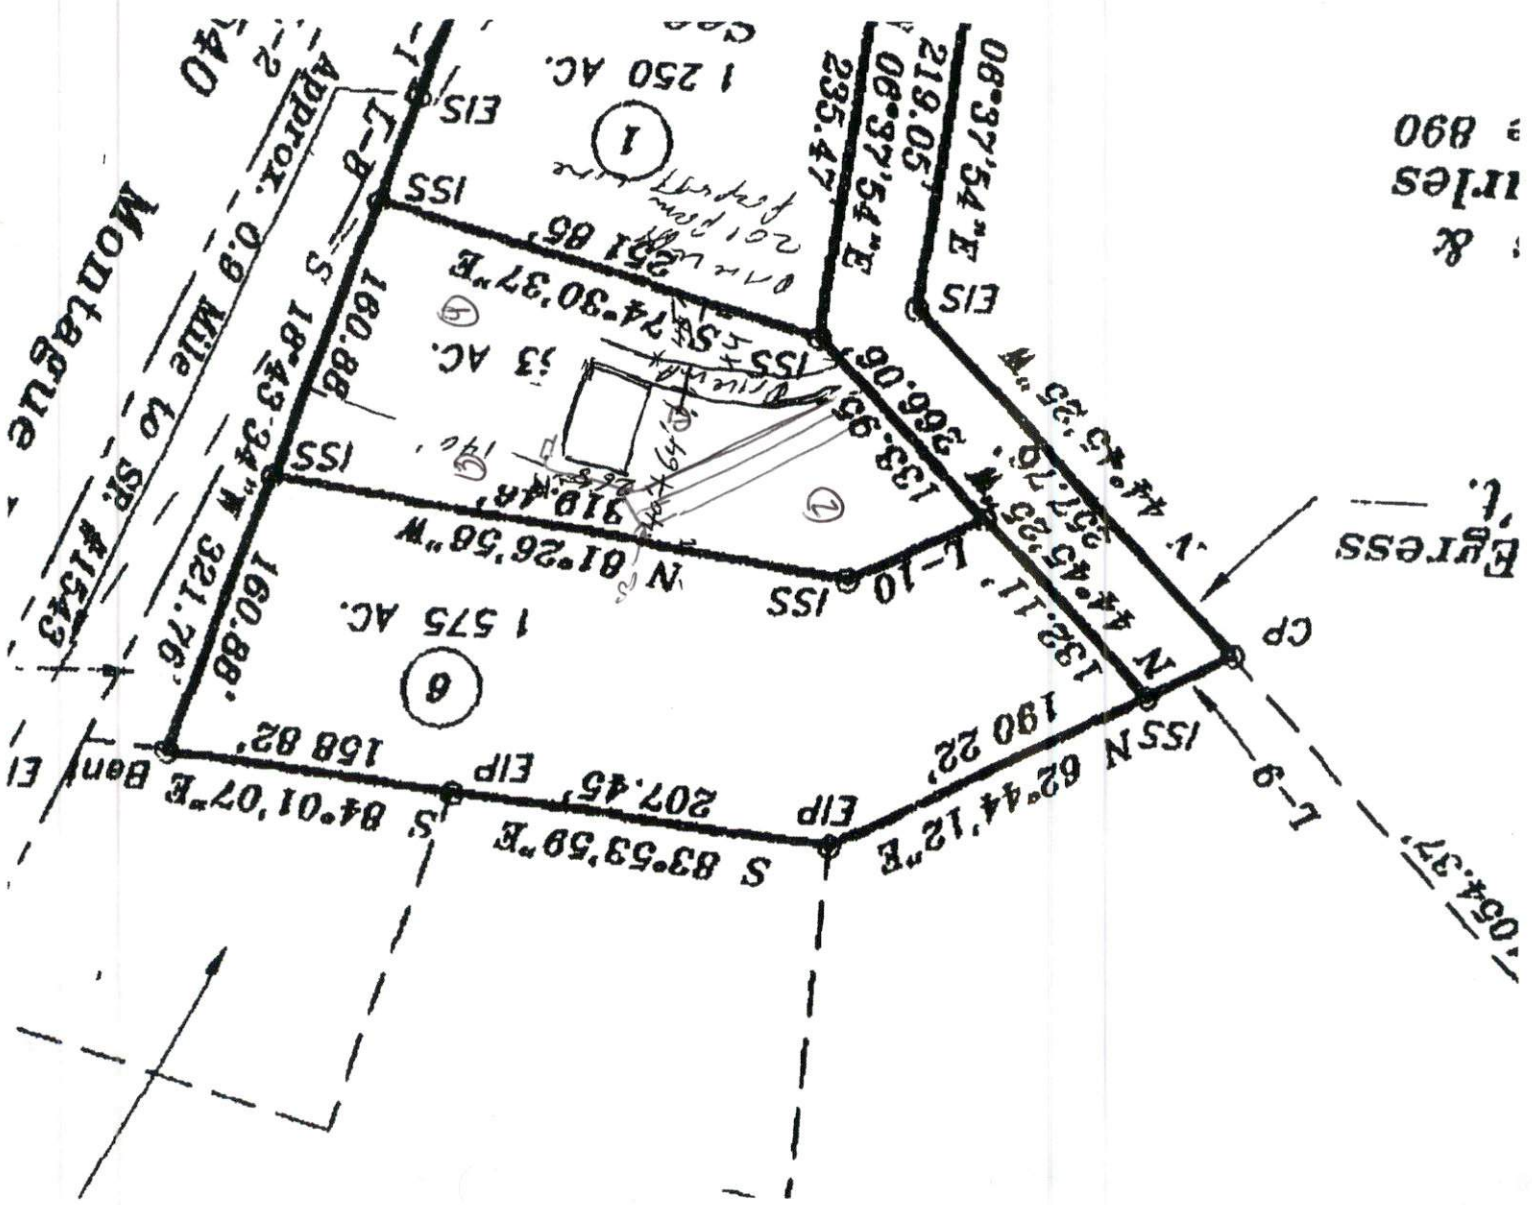

&
 rles
 = 890

Burgess