

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner: _____ Applicant: _____
 Address: _____ Date Evaluated: 6-22-
 Proposed Facility: 3000 SF Design Flow (.1949): 270 Property Size: _____
 Location of Site: _____ Property Recorded: _____
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed


P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	L ^{-2%}	0-12	SL	fr 62 NSDP-SSSP					
		12-44	SC-city	from 32 NSDP	40-42" 10R 3.1				.3
2	L ^{3%}	0-10	SL	fr 62 NSDP-SSSP					
		10-44	SC-city	from 32 NSDP	40" 10R 3.1				.3
3	L ^{3-4%}	0-10	SL	fr 62 NSDP-SSSP					
		10-40	SC-city	from 32 NSDP	36" 10R 3.1				.3

Description	Initial System	Repair System	Other Factors (.1946):
Available Space (.1945)	<u> ✓ </u>	<u> / </u>	Site Classification (.1948): <u> PS </u>
System Type(s)	<u> 25" </u>	<u> 15" </u>	Evaluated By: <u> 9 </u>
Site LTAR	<u> .5 </u>	<u> .3 </u>	Others Present:

Richard T. Waddell, Jr.
 Deed Book 2683, Page 11
 Map # 2009-191
 ZONE: RA

24
 2
 02

Map 2012 452 I-50

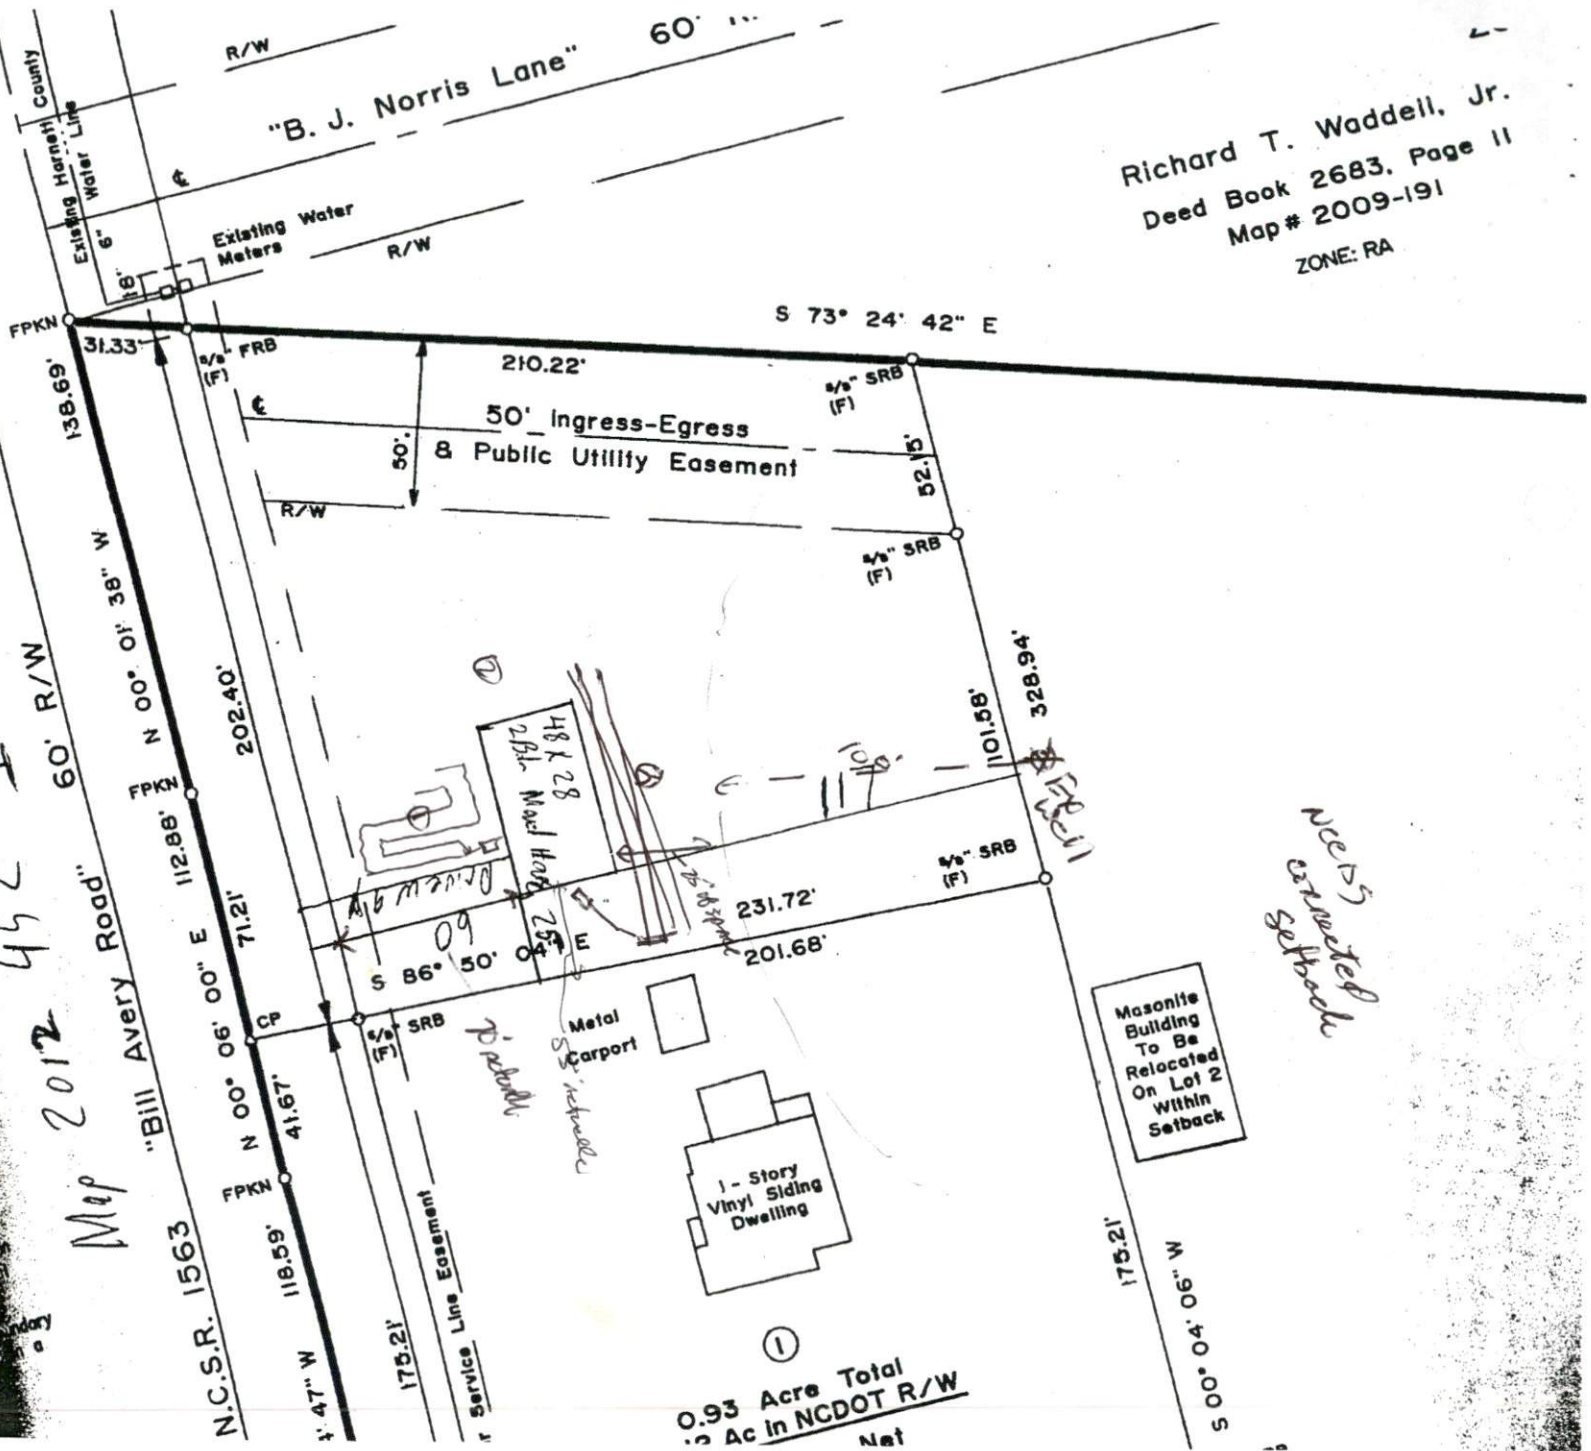

①
 0.93 Acre Total
 1.2 Ac In NCDOT R/W
 Net

Masonry Building
 To Be
 Relocated
 On Lot 2
 Within
 Setback

*Needs
 extracted
 See book*