

HARNETT DEPARTMENT OF PUBLIC HEALTH PERMIT
TO CONSTRUCT A DRINKING WATER SUPPLY WELL

PIN #: 0545-95-7120.000 Parcel #: 12 0555 0011 13 Application #: 12-5-28302 Subdivision: Carroll Lot #: 2

Applicant Name: Michael Waterstripe
Address: 193 Jerome Lane Linden, NC 28356

Type of Facility Served by Well: SFD

Sewage System: conventional

Permit Conditions: Well to be a minimum of 50 ft. from septic system

General Permit Conditions:

- Drinking water supply well construction must meet 15A NCAC 02C.100 rules
- The permitted drinking water supply well shall be located in accordance with the SITE PLAN
- ANY ALTERATION of the site of the site (including location of structures and appurtenance) or modification in use of the well, may subject this Permit to revocation

Authorized State Agent _____ Date _____

Grouting Inspection Witnessed _____ Date _____

Grouting self-certified by driller GW-1 provided? Yes No

See attachment for construction sketch

WELL CERTIFICATE OF COMPLETION

Date: 4/26/2012 Application #: 12-5-28302 Well Contractor: Jackson Well Co.

Applicant Name: Michael Waterstripe
Address: 193 Jerome Lane Linden, NC 28356
Directions to Site: 401 to Bunnlevel turn right on Mclean Chaple Ch Rd. turn left on Wire turn right on Walker

Use of Well: sfd Date Drilled: 2-29-12 Total Depth: 260 ft Replacement Well? Yes No
Static Water Level: 22 ft Top of Casing is 12 in. above surface. Yield: 15 gpm at _____ ft.
Disinfection: Type hth Amount 16 oz

<u>Water Zone (depth)</u>	<u>Casing</u>	<u>Grout</u>
From 231 To 235 ft	From 0 To 200 ft	From 0 To 20 ft
From _____ To _____	Diameter: 6.18 Material: pvc Thickness: sr20	Material: sand cement Method: pour
From _____ To _____	From _____ To _____	From _____ To _____
	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____
	From _____ To _____	From _____ To _____
	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____

Inspector: bm On Hold Date: _____ Release Date: 4/26/2012

Remarks: _____

Well Head Information


Casing Height: 12 in (above finished grade) Access Port: yes Vent Stack: yes
Well ID Tag: yes Pump ID Tag: yes Sampling Tap: yes Backflow Preventer: _____
Sample Taken? Yes No Well Head properly sealed: yes

Remarks: _____

Authorized State Agent Bryan P. Swain/REHS Date 4/26/2012

See Attachment for completion sketch

Well Construction Sketch

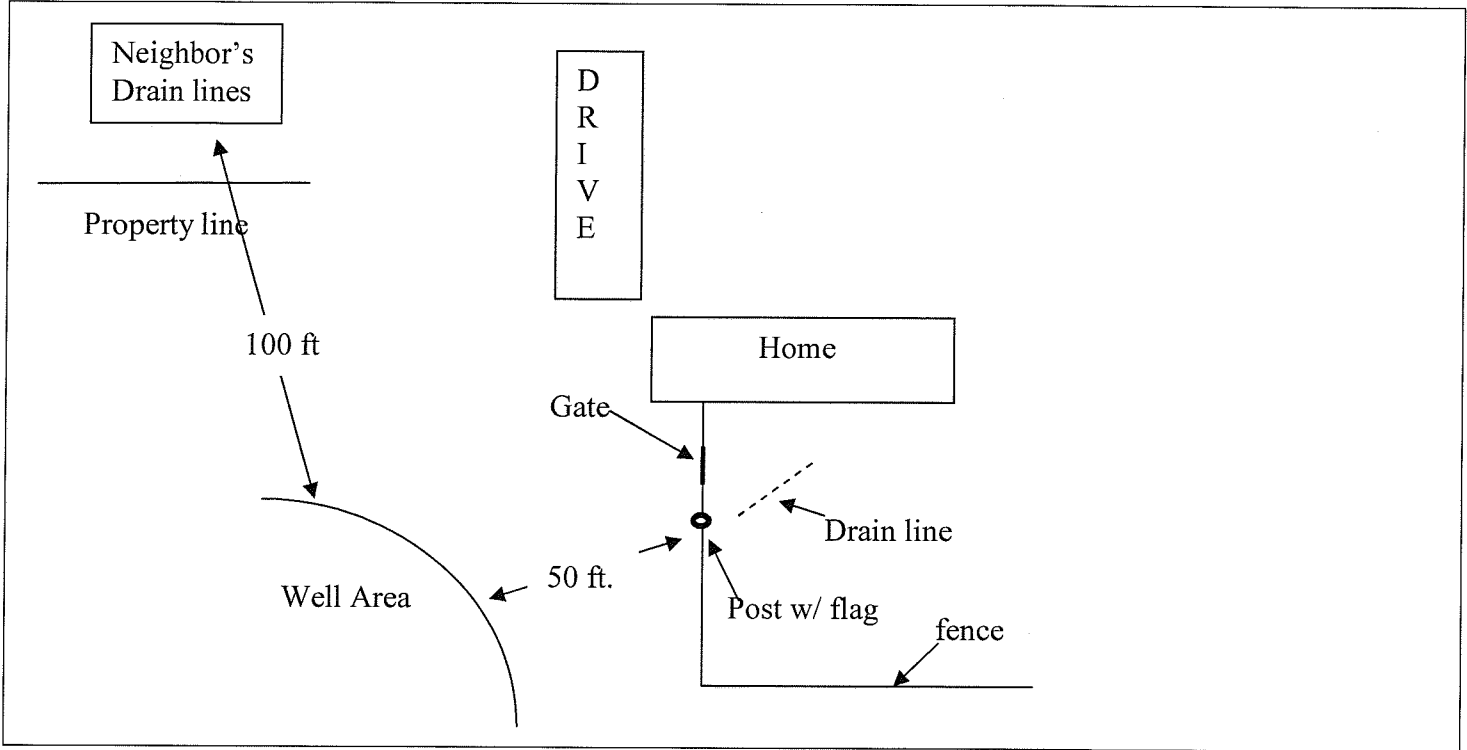

Well Completion Sketch

