

HTE 03-5-8440R

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Wesley C. Hamilton Jr. New Installation Septic Tank
 Property Location: SR# 82 Repairs Nitrification Line

Subdivision _____ Lot # _____

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 2 Lot Size: _____

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: ~~Conventional~~ Other Pump to Conventional

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 50 ft. width of ditches 3 ft. depth of ditches 12 in. ^{MAX} in of cover


French Drain Required: _____ Linear feet

Date: 7/19/2004

This permit is subject to revocation if site plans or intended use change.

Signed: Bryan McLean R.S.
 Environmental Health Specialist

- * Maintain all setbacks
- * Run ditches on contour + NO DEEPER than 12 inches
- * 6 inches of cover must be placed over system

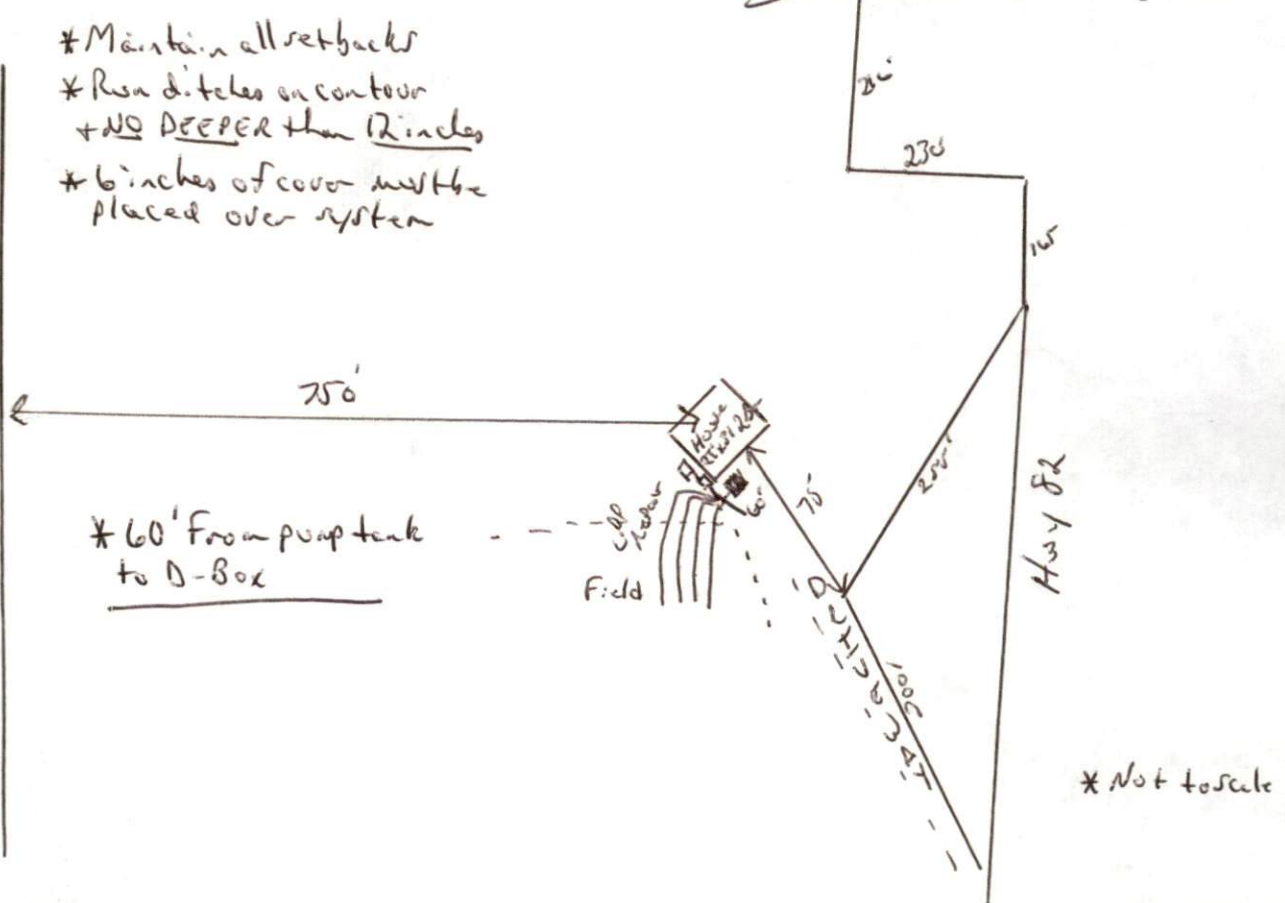

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20533. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Wesley C. Hamilton
Name

892-4781
Telephone #

2220 NC 82 Dunn, NC 28324
Address

82
Property Location SR#

Road Name

Subdivision

Lot #

2

Bedrooms Proposed

Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other Pump to Conventional

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber 1000 gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 50 Ft.

Width of ditches 3 ft. Depth of ditches 12 inches M.A.Y.
6 inches of cover

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature]
Signature of Authorized Agent for Harnett County

7/19/2004
Date