

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner:

Address:

Proposed Facility:

Location of Site:

Water Supply:

Evaluation Method:

Type of Wastewater:

Design Flow (.1949):

☐ Public

☐ Individual

☐ Well

☐ Auger Boring

☐ Sewage

☐ Pit

☐ Industrial Process

Date Evaluated:

Property Size:

Property Recorded:

☐ Spring

☐ Other

☐ Cut

☐ Mixed

P R O F I L E #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	L	0-8	SL	fm GL NSNP					.35
		8-20	SC ^{CL}	SL fm SBL SSP					
		20-34	SCL	SL fm - SBL SSP fm	34				
2	L	0-8	SL	fm GL NSNP					.35
		8-20	SC ^{CL}	SL fm SBL SSP					
		20-38	SCL	SL fm SBL SSP fm	32				
3	L	0-8	SL	fm GL NSNP					.3
		8-20	SC ^{CL}	SL fm SBL SSP					
		20-38	SCL	SL fm SBL SSP fm .	30				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	cor	WPP
Site LTAR	.35	.3.

Other Factors (.1946):

Site Classification (.1948):

Evaluated By:

Others Present:


COMMENTS: _____

LANDSCAPE POSITIONS	GROUP	TEXTURES	.1955 LTAR	CONSISTENCE MOIST	WET
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FR-FRIABLE	SS-SLIGHTLY STICKY
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	FI-FIRM	S-STICKY
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1	VFI-VERY FIRM	NP-NON-PLASTIC
		C-CLAY			
		SC-SANDY CLAY			
				EFI-EXTREMELY FIRM	SP-SLIGHTLY STICKY
					P-PLASTIC
					VP-VERY PLASTIC


STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

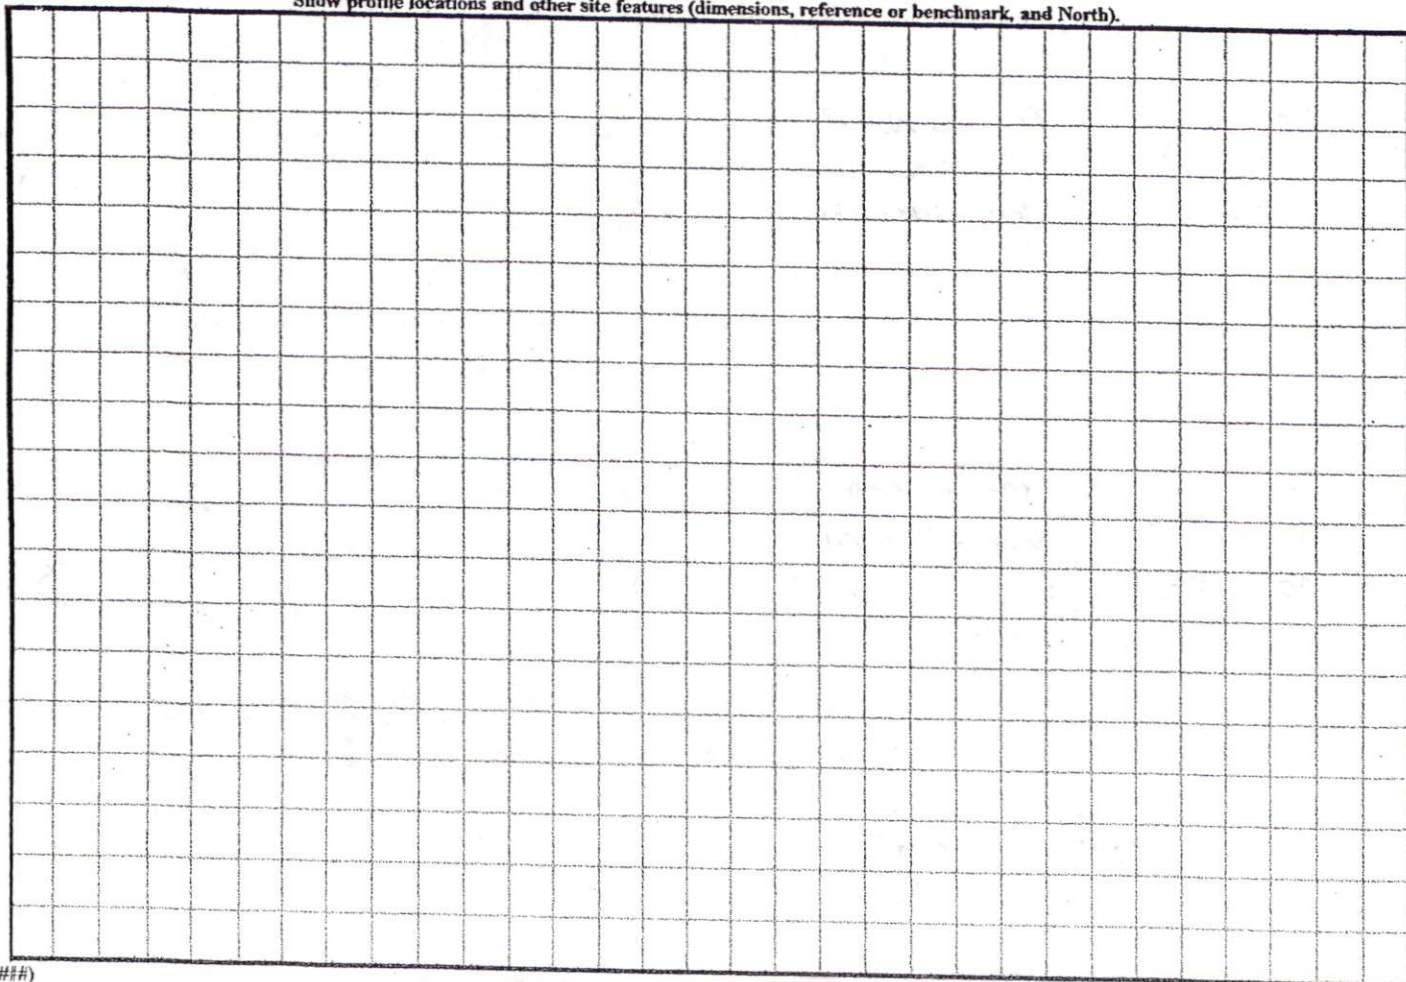

Lucas
 Red Hill Ch Rd
 Dunn NC
 Contact
 Lee Johnson
 919-630-0408

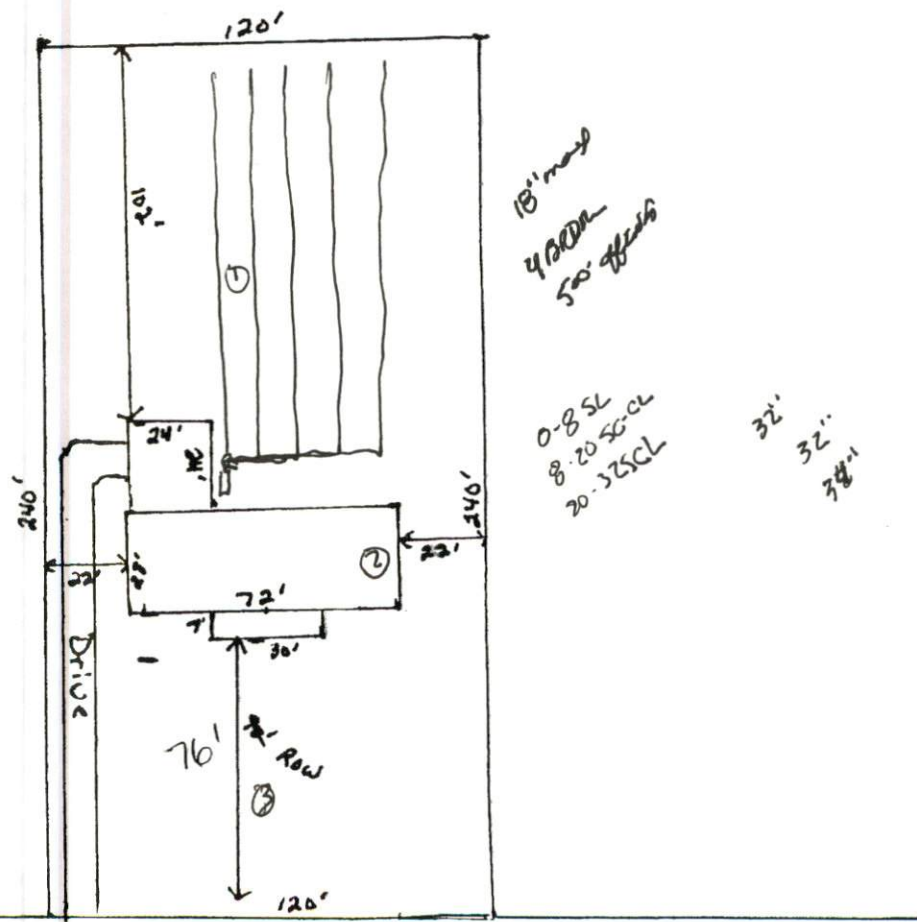

Red Hill Ch Rd

1-50