

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH

Well Certificate of Completion

Date: 10/6/2008 Permit Number: 08-5-19902R Well Contractor: Roger Jackson

Applicant Name: Chris & Michelle Bailey

Address: 350 Maynard Lake Rd. Erwin, N.C. 28339

Directions to Site: 421 S to Erwin take a left on Maynard Lake Rd. house just past Triton High School on left

Use of Well: SFD Date Drilled: 10/1/2008 Total Depth: 320 ft. Replacement Well? Yes No
 Static Water Level: 80 ft. Top of Casing is 12 in. above surface. Yield: 15 gpm at ft.
 Disinfection: Type HTH Amount 12 oz.


Water Zone (depth)	Casing	Grout
From <u>314</u> To <u>315</u>	From <u>0</u> To <u>220</u>	From <u>0</u> To <u>25</u>
From <u> </u> To <u> </u>	Diameter: <u>4 in</u> Material: <u>PVC</u> Thickness: <u>sch 40</u>	Material: <u>sand/cement</u> Method: <u>pouring</u>
From <u> </u> To <u> </u>		

Inspector: BM On Hold Date: Release Date: 10/6/2008
 Remarks: Well driller did not contact Health Dept. to inspect grouting

Well Head Information

Casing Height: 12 in. (above finished grade) Access Port: Vent Stack:
 Well ID Tag: Pump ID Tag: Bib Cock: Backflow Preventer:
 Sample Taken? Yes No Well Head properly sealed: yes

Inspector: BM Date: 10/6/2008
 Remarks:

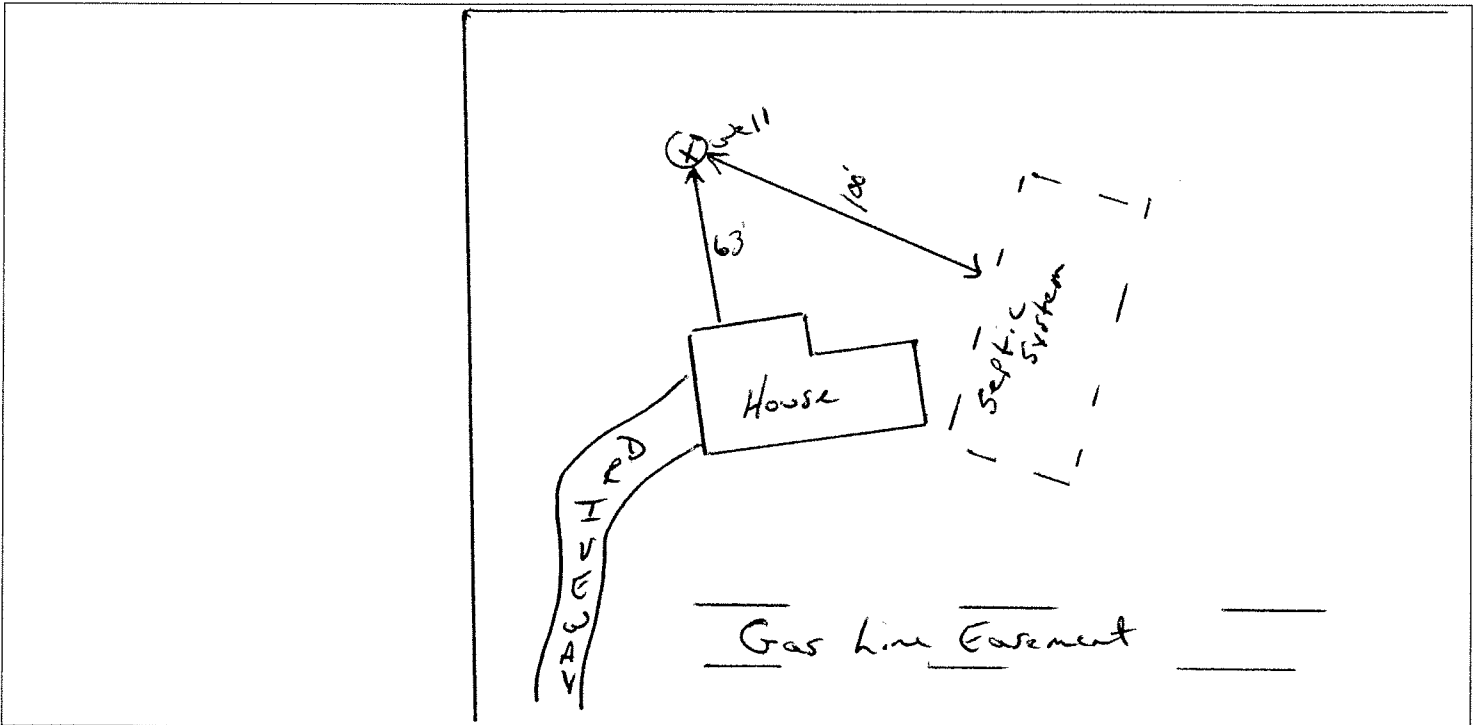

Authorized State Agent Bryan McSwain, R.S. Date 10/6/2008