

HTE# 10-5-25201R

Harnett County Department of Public Health

PERMIT # 26408

Operation Permit


21732

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ ExpansionPROPERTY LOCATION: 101 Pecan LnName: (owner) Charles STEVENS SUBDIVISION Henry Pope LOT # 3System Installer: Gerald Temple Registration # _____Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 4Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: 25% REDUCTION Type III G EZZ Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

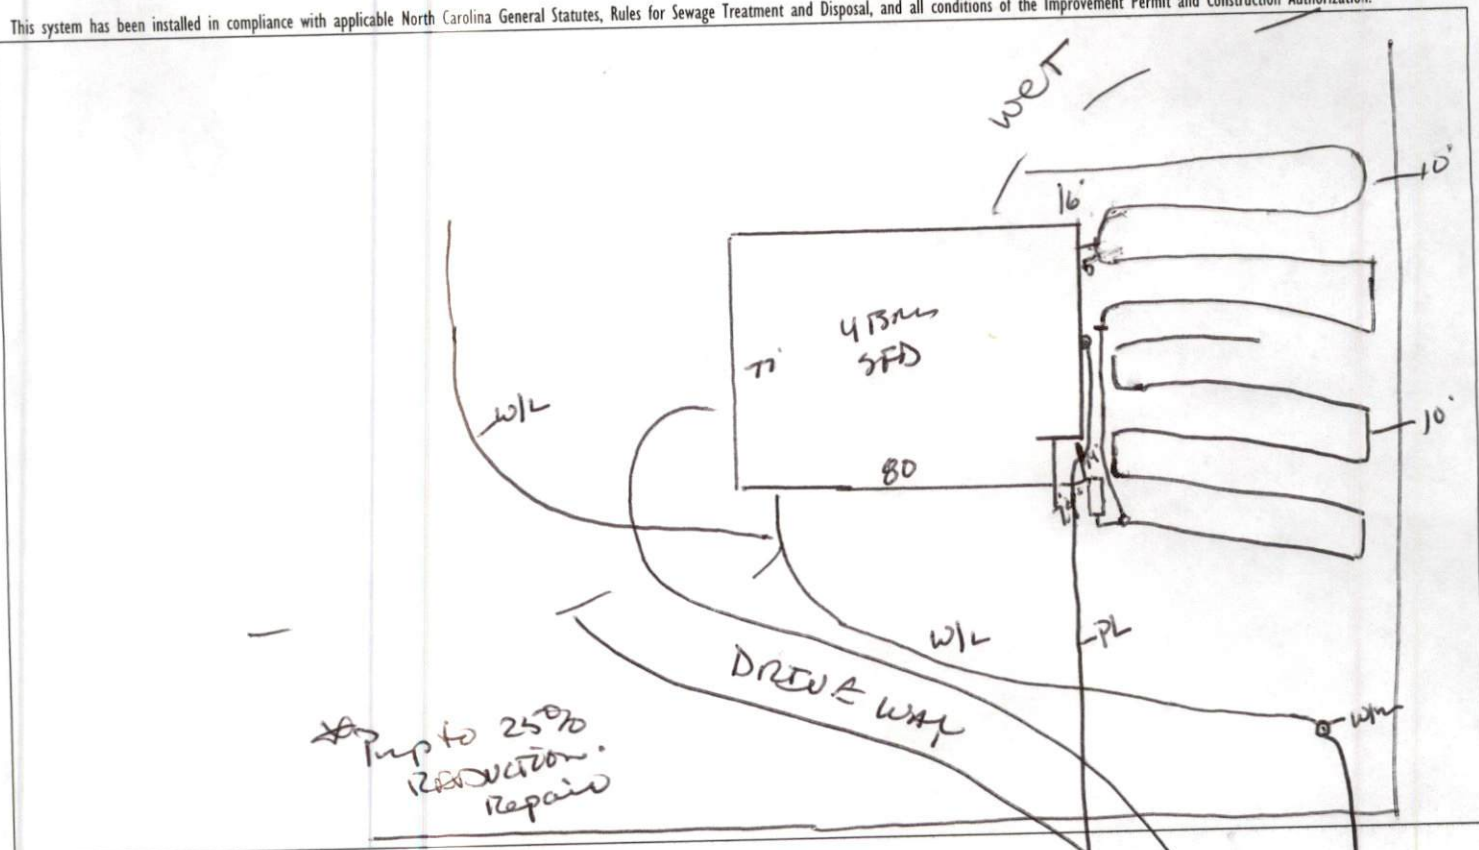

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% REDUCTION Type III G EZZSubsurface No. of ditches 2 exact length of each ditch 180 feetSeptic Tank: 1200 gallons Pump Tank: _____ gallonswidth of ditches 3 feet depth of ditches 20 inches

Drainage Field _____ Linear feet

Authorized State Agent

James E. ManhartDate 5-18-11