

**HARNETT DEPARTMENT OF PUBLIC HEALTH PERMIT  
TO CONSTRUCT A DRINKING WATER SUPPLY WELL**

PIN #: 0692-67-0515.000 Parcel #: \_\_\_\_\_ Application #: 11-5-27794 Subdivision: \_\_\_\_\_ Lot #: \_\_\_\_\_

Applicant Name: Srinivasa Badarinarayana  
Address: 341 Melvin Jackson Dr. Cary, NC 27511

Type of Facility Served by Well: SFD

Sewage System: pump to 25% reduction system

Permit Conditions: Well to be 100 ft. from any part of septic system

General Permit Conditions:

- Drinking water supply well construction must meet 15A NCAC 02C.100 rules
- The permitted drinking water supply well shall be located in accordance with the **SITE PLAN**
- **ANY ALTERATION** of the site of the site (including location of structures and appurtenance) or modification in use of the well, may subject this Permit to revocation

Authorized State Agent *Danya McSwain, RCHS* Date 11/17/2011

Grouting Inspection Witnessed \_\_\_\_\_ Date \_\_\_\_\_  
 Grouting self-certified by driller      GW-1 provided?  Yes  No

See attachment for construction sketch

**WELL CERTIFICATE OF COMPLETION**

Date: \_\_\_\_\_ Application #: \_\_\_\_\_ Well Contractor: \_\_\_\_\_

Applicant Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
Directions to Site: \_\_\_\_\_

Use of Well: \_\_\_\_\_ Date Drilled: \_\_\_\_\_ Total Depth: \_\_\_\_\_ Replacement Well?  Yes  No  
Static Water Level: \_\_\_\_\_ Top of Casing is \_\_\_\_\_ in. above surface. Yield: \_\_\_\_\_ gpm at \_\_\_\_\_ ft.  
Disinfection: Type \_\_\_\_\_ Amount \_\_\_\_\_

**Water Zone (depth)**

**Casing**

**Grout**

From \_\_\_\_\_ To \_\_\_\_\_  
From \_\_\_\_\_ To \_\_\_\_\_  
From \_\_\_\_\_ To \_\_\_\_\_

From \_\_\_\_\_ To \_\_\_\_\_  
Diameter: \_\_\_\_\_ Material: \_\_\_\_\_ Thickness: \_\_\_\_\_  
From \_\_\_\_\_ To \_\_\_\_\_  
Diameter: \_\_\_\_\_ Material: \_\_\_\_\_ Thickness: \_\_\_\_\_  
From \_\_\_\_\_ To \_\_\_\_\_  
Diameter: \_\_\_\_\_ Material: \_\_\_\_\_ Thickness: \_\_\_\_\_

From 0 To \_\_\_\_\_  
Material: \_\_\_\_\_ Method: \_\_\_\_\_  
From \_\_\_\_\_ To \_\_\_\_\_  
Material: \_\_\_\_\_ Method: \_\_\_\_\_  
From \_\_\_\_\_ To \_\_\_\_\_  
Material: \_\_\_\_\_ Method: \_\_\_\_\_

Inspector: \_\_\_\_\_ On Hold Date: \_\_\_\_\_ Release Date: \_\_\_\_\_

Remarks: \_\_\_\_\_

**Well Head Information**


Casing Height: \_\_\_\_\_ (above finished grade)      Access Port: \_\_\_\_\_      Vent Stack: \_\_\_\_\_  
Well ID Tag: \_\_\_\_\_      Pump ID Tag: \_\_\_\_\_      Sampling Tap: \_\_\_\_\_      Backflow Preventer: \_\_\_\_\_  
Sample Taken?  Yes  No      Well Head properly sealed: \_\_\_\_\_

Remarks: \_\_\_\_\_

Authorized State Agent \_\_\_\_\_ Date \_\_\_\_\_

See Attachment for completion sketch

**Well Construction Sketch**

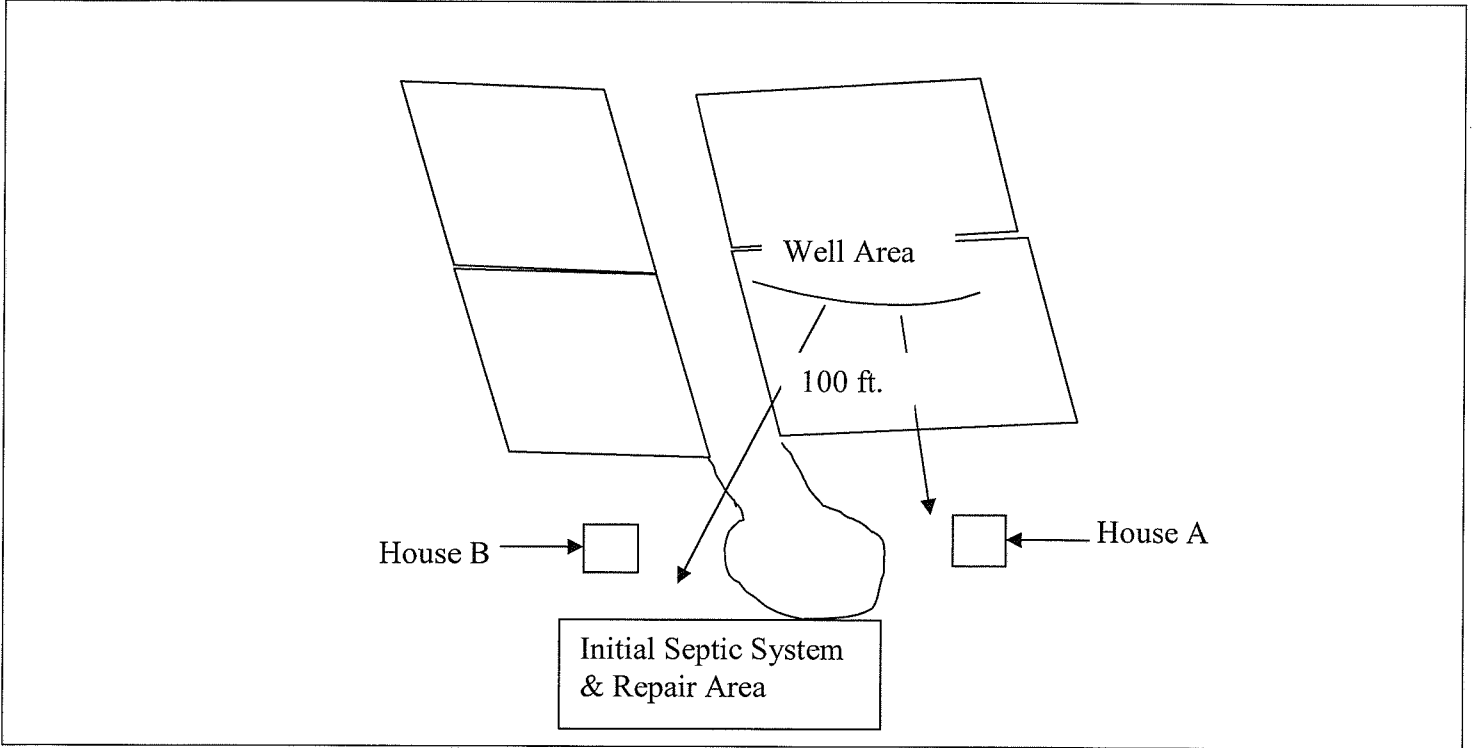

**Well Completion Sketch**

