

HTE# 17-5-426367

# Harnett County Department of Public Health

24971

PERMIT # 29758

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 180 Woodmill Ln (Lennie Smith Rd. SR 1428)

Name: (owner) Ta Floyd Taylor Farms LLC SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: Floyd Taylor Registration # \_\_\_\_\_


Basement with plumbing:  Garage  Number of Bedrooms NA 200 GPD MAX w/ 8 person office

Type of Water Supply:  Community  Public  Well Distance from well NA feet Building MAX

System Type: Conventional Gravel System Types V and VI Systems expire in 5 years.

(In accordance with Table V a) IIg Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

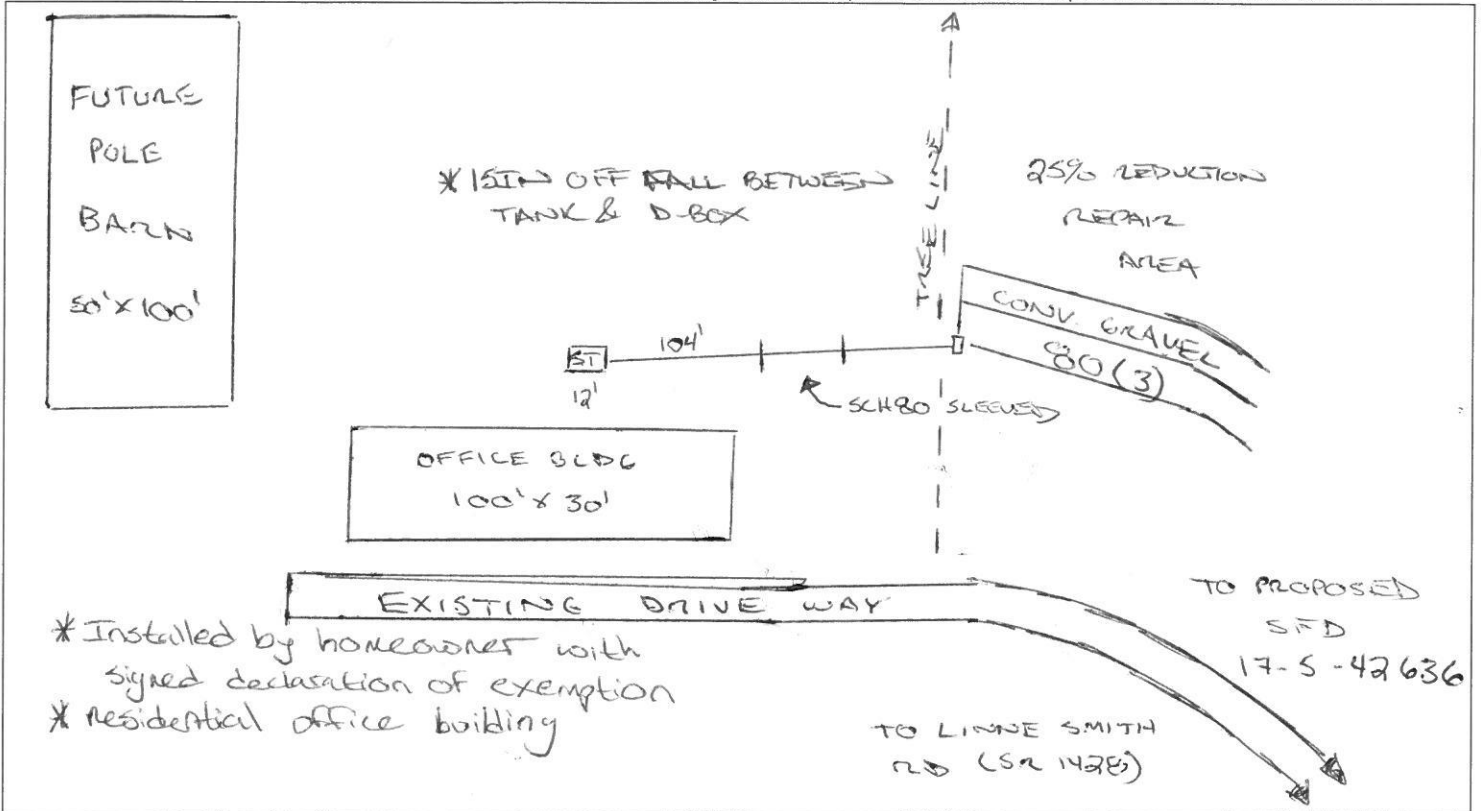

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other \_\_\_\_\_ Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons  
 Subsurface No. of exact length width of depth of  
 Drainage Field ditches 3 of each ditch 80 feet ditches 3 feet ditches 20-24 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 05/17/2018

**Notice to Homeowner Declaring Exemption from Article 5 Chapter 90A**

HARNETT County Environmental Health Department has received notification that Floyd Taylor T2 Farms LLC shall be declaring the exemption Homeowner

as Homeowner under N.C. General Statute 90A-72(b)(2) to install and/or repair an on-site wastewater system. In order to protect the environment, the Environmental Health Department advises if Homeowner does not have prior experience in on-site installation and/or repair that a person certified by the North Carolina On-Site Wastewater Contractors Inspectors Certification Board (NCOWCICB) be hired to do this service. Please be advised that Environmental Health Department reserves the right to be present for any and/or all parts of the installation and/or repair process including excavation and cover-up.

In order to declare the exemption all of the following requirements must be met:

- System must be a single septic tank
- System must be gravity fed
- System must have gravel trench dispersal media
- Person listed as Homeowner must own property
- Property must be intended solely for use by Homeowner and members of homeowner's immediate family who reside in the same dwelling
- Homeowner shall perform installation and/or repair labor without any monetary exchange or other means of payment for labor to any party other than a person certified by NCOWCICB

By signing below, the Homeowner hereby acknowledges the above statement.

Date 5/10/18 \_\_\_\_\_  
Homeowner Signature  
Floyd Taylor  
Printed Name

STATE OF North Carolina  
COUNTY OF Harnett

I Betsy Shoemaker, the undersigned Notary Public, do hereby certify that Floyd Taylor, personally appeared before me this day and acknowledged the due execution of the foregoing instrument.

WITNESS my hand and notarial seal, this the 10 day of May 20 18.



Betsy Shoemaker  
Notary Public

My Commission Expires: 3-22-2021

CC: File  
LEHD

17-5-42637

