

HTE# 18-543584

Harnett County Department of Public Health

25592

PERMIT # _____

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 8670 US421

Name: (owner) M+T ELECTRICAL SUBDIVISION _____ LOT # _____

System Installer: LARRY SHARPE Registration # _____

Basement with plumbing: Garage Number of Bedrooms BARN (100 sq)


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

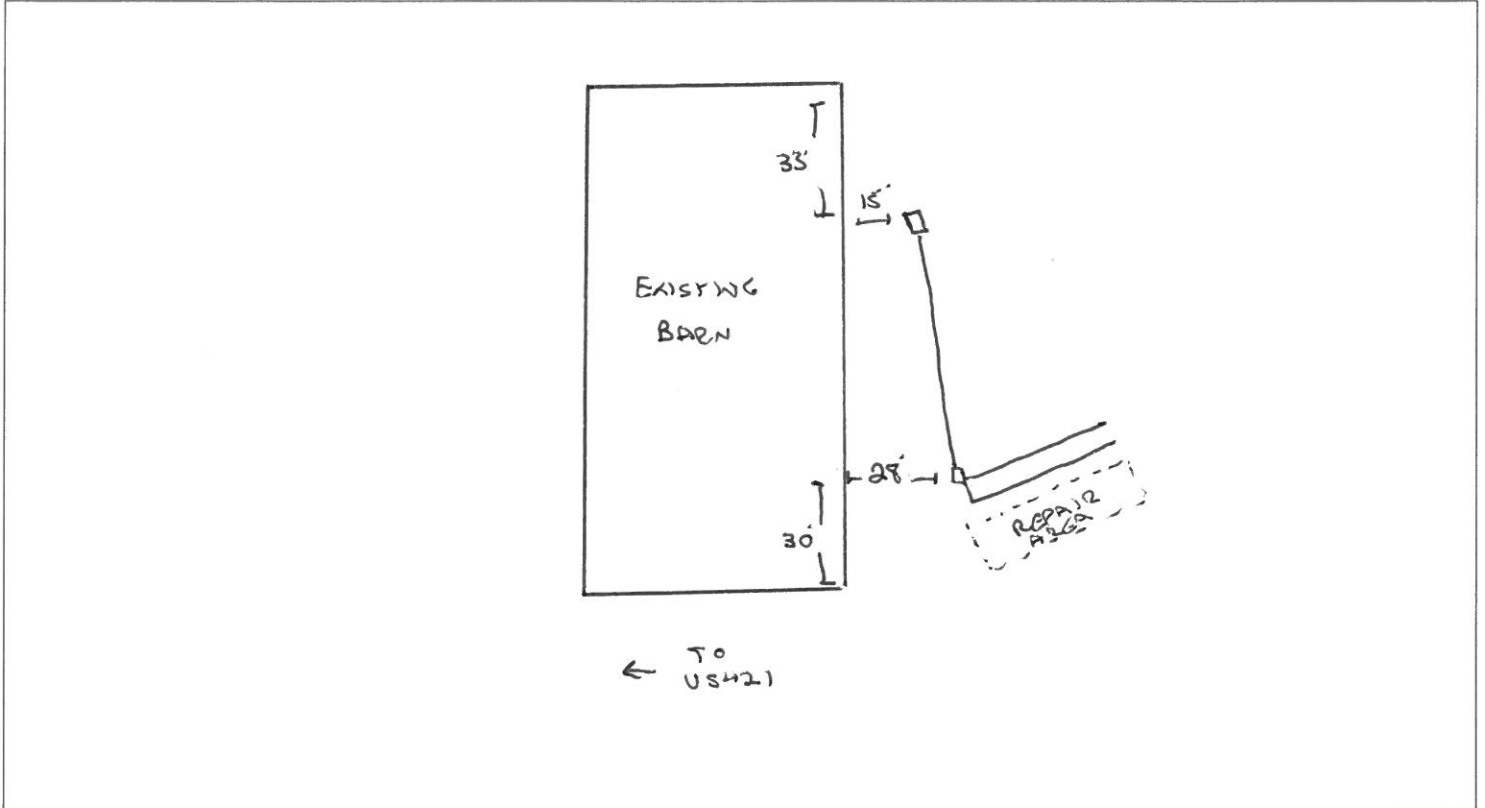

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other TIRE CURBS Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface Drainage Field: No. of ditches 2 exact length of each ditch 40 feet width of ditches 3 feet depth of ditches 18-20 inches
 French Drain Required: _____ Linear feet

Authorized State Agent: [Signature] Date: 7/10/19

Customer: 0369650001 / Larry Sharpes

Scale
Gross: 43060 LBS Out Manual Wt
Tare: 21900 LBS In Manual Wt
Net: 21160 LBS

Generator: NA / Not Applicable
Dest: DEST: CUSTOMER / Customer
Truck: LARRY SHAR

Comment:

Origin	Wastes & Sevices	Quantity	Unit	Rate/Unit	Amount
NA / Not Applicable	DFMT116/Drain Fill Material	10.58	TON	\$25.00/TN	\$264.50
				Total Taxes:	\$18.51
				Total Amount:	\$283.01

Driver: _____

Deputy Weighmaster: Libby Cameron

This load of tire chips is from the Fuel Grade location and meets the Nc specification as stated in Innovative Wastewater system approval IWWS-2002-03R for tire chip Substitution for Rock Aggregate in Nitrification Fields.

Larry Sharpes