

HTE 04-5-9932

# IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Wellons Realty  New Installation  Septic Tank  
Property Location: SR# 1435 Trippid  Repairs  Nitrification Line

Subdivision Plantation @ Vineyard Green Lot # 81  
Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 Lot Size: .99 ac  
Basement with Plumbing:  Garage:   
Water Supply:  Well  Public  Community  
Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.


Type of system:  Conventional  Other 25% Reduction System

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface Drainage Field No. of ditches 2 exact length of each ditch 125 ft. width of ditches 3 ft. depth of <sup>max</sup> ditches 24 ~~24~~ <sup>18</sup> in.

French Drain Required: \_\_\_\_\_ Linear feet  
Date: 8-4-04

This permit is subject to revocation if site plans or intended use change.  
Signed: James E. Manhattan  
Environmental Health Specialist

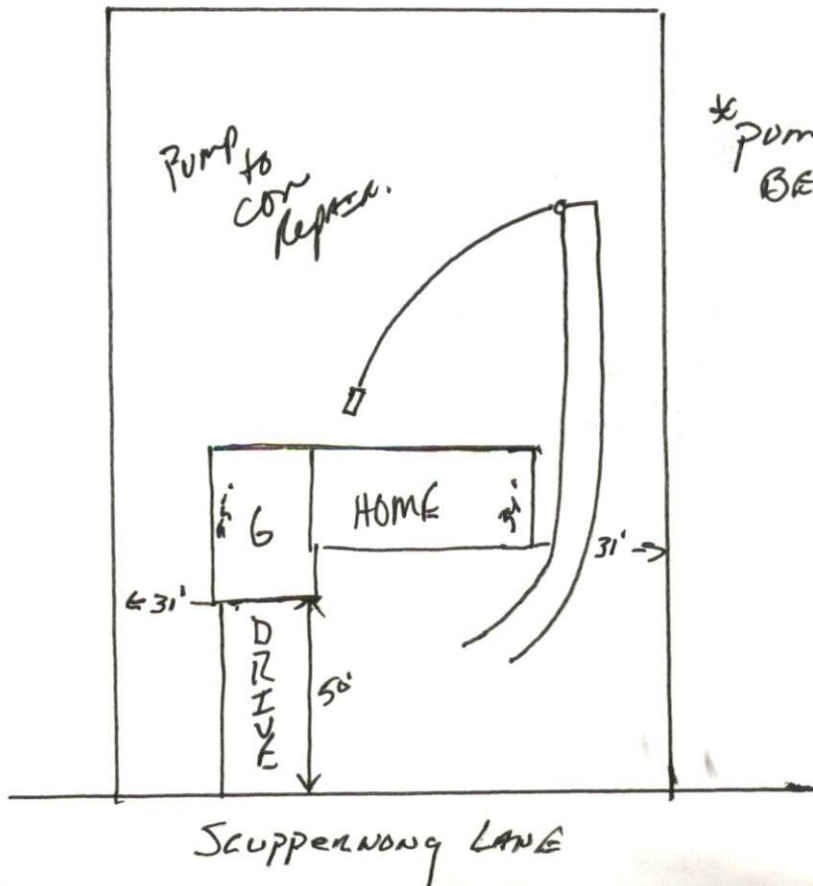

04-5-9932

# HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20960. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Wellons Realty Telephone # 910-892-3123

Address P.O. Box 730 DUNN N.C. 28335

Property Location SR# 1435 Road Name Tripp

Subdivision Plantation @ Vineyard Lot # 81 # Bedrooms Proposed 3 Lot Size .49

### TYPE OF SYSTEM

New Installation [ ] Repair [  ] Septic Tank [  ] Nitrification Lines

[ ] Conventional [  ] Other 25% Reduction

[ ] Basement [ ] With Plumbing [ ] Without Plumbing

Water Supply: [ ] Well [  ] Public Water Supply Minimum Well Setback: \_\_\_\_\_ Ft.

Septic Tank 1000 gal Pump Chamber \_\_\_\_\_ gal

### NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 2 Length of lines 125 Ft.

Width of ditches 3 ft. Depth of ditches 24-18 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Marhart  
Signature of Authorized Agent for Harnett County

8-4-04  
Date