

HTE 04-5-9946

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Wellness Realty New Installation Septic Tank
Property Location: SR# 1435 Tripp Rd Repairs Nitrification Line

Subdivision Plantation @ Vineyard Green Lot # 80
Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 Lot Size: 1.986 ac
Basement with Plumbing: Garage:
Water Supply: Well Public Community
Distance From Well: 50' ft.


Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other 25% Reduction System
Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
Subsurface Drainage Field No. of ditches 2 exact length of each ditch 125' width of ditches 3 ft. depth of max ditches 24-18 in.
French Drain Required: - Linear feet

Date: 8-4-04
Signed: James E. Merchant, M.D.
Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

* Pump may BE required.

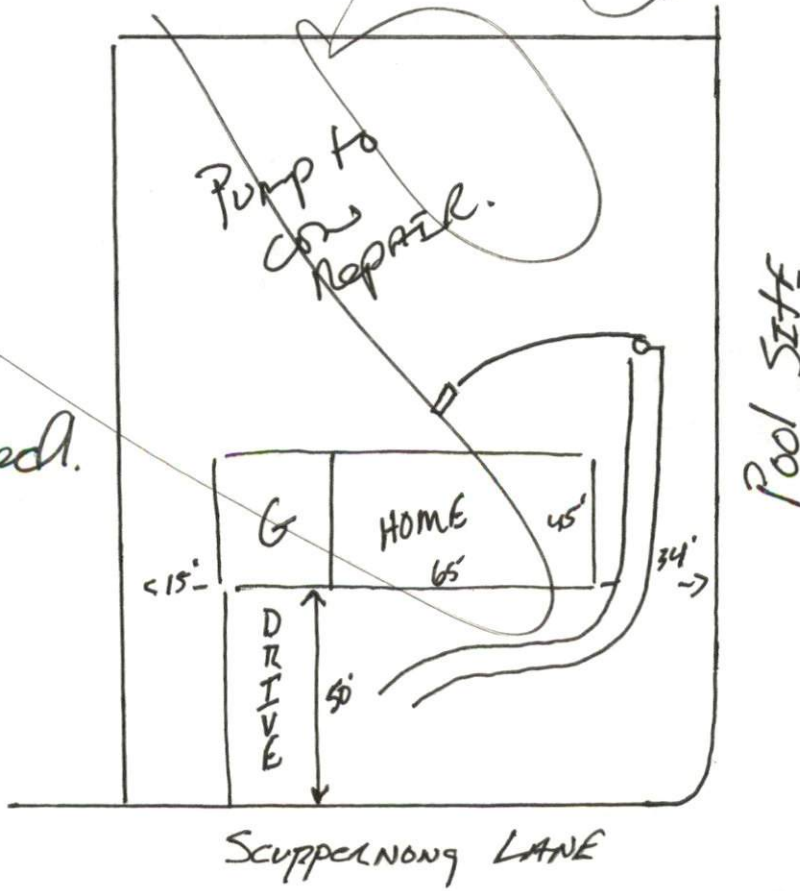

04-5-9946

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20961. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Wellons Realty Telephone # 910-892-3123

Address P.O. Box 730 DUNN N.C. 28335

Property Location SR# 1435 Road Name Tripp

Subdivision Plantation at Vineyard Lot # 80 # Bedrooms Proposed 3 Lot Size .486

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other 25% Reduction

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 2 Length of lines 125 Ft.

Width of ditches 3 ft. Depth of ditches 24 to 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James C. Markant
Signature of Authorized Agent for Harnett County

8-4-04
Date