

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner:
 Address:
 Proposed Facility:
 Location of Site:
 Water Supply:
 Evaluation Method:
 Type of Wastewater:

Public Individual Well
 Auger Boring Pit
 Sewage Industrial Process

Applicant:
 Date Evaluated:
 Property Size:
 Property Recorded:
 Spring Other
 Cut
 Mixed

Profile #	.1940 Landscape Position/Slope%	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
		.1941 Structure/Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
	0-4	SL	FA/LA		4/			
	0-6	SL	FA/LA		4/			
	0-8	SL	FA/LA		4/			
	0-8	SL	FA/LA		4/			
	0-8	SL	FA/LA		4/			
	0-8	SL	FA/LA		4/			
	0-8	SL	FA/LA		4/			

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	Gravel	WPA
Site LTAR	.6	.7

25% Addition to same space

Other Factors (.1946): _____
 Site Classification (.1948): _____
 Evaluated By: *J. L. A.*
 Others Present: *Pits by Agency*


COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	NS-NON-STICKY SS-SLIGHTLY STICKY S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6		
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3		
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE


Show profile locations and other site features (dimensions, reference or benchmark, and North).

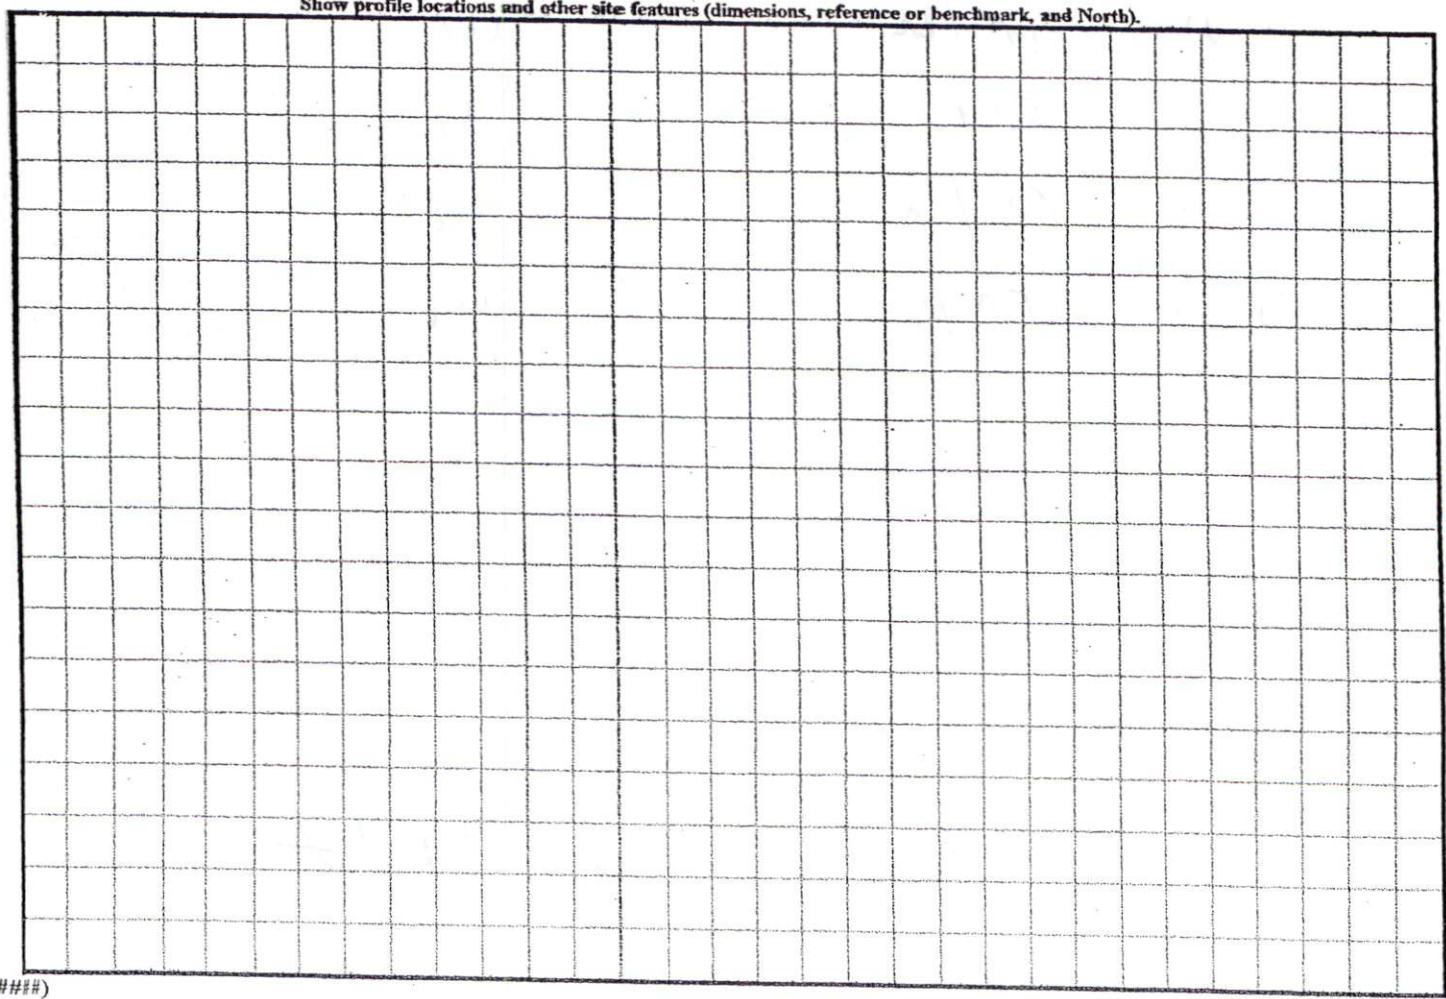

"NORTHVEIW DRIVE" 50' R/W

SITE PLAN APPROVAL
DISTRICT RA2008 USE SFD
#BEDROOMS 3
9-10-04
ZONING ADMINISTRATOR

133

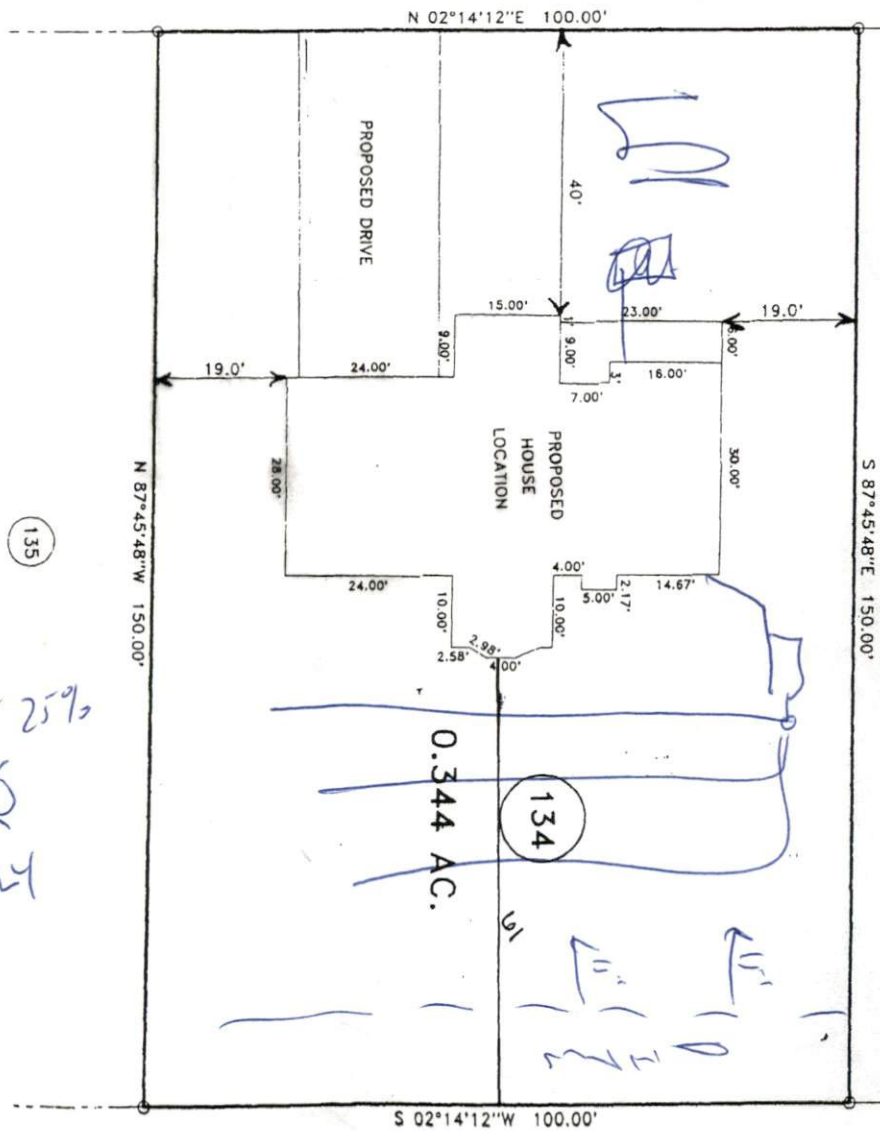

0.344 AC.

134

135

27.75 25.9
10.24

S 02°14'12\"W 100.00'