

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: _____ Applicant: _____
 Address: _____ Date Evaluated: _____
 Proposed Facility: _____ Design Flow (.1949): _____ Property Size: _____
 Location of Site: _____ Property Recorded: _____
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

Profile #	1940 Landscape Position/Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			1941 Structure/Texture	1941 Consistence Mineralogy	1942 Soil Wetness/Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	
1	L	0-8	SL	FR GL NSNP					.3
		8-36	SL-CLAY	SL FRM SBR S P	36				
2	L	0-5	SL	FR GL NSNP					.3
		5-42	SL-CLAY	SL FRM SBR S.P.	34				
				Rocky Lot					

Description	Initial System	Repair System
Available Space (.1945)	/	/
System Type(s)	/	/
Site LTAR	.3	.3

Other Factors (.1946): _____
 Site Classification (.1948): _____
 Evaluated By: _____
 Others Present: _____

COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FR-FRIABLE	SS-SLIGHTLY STICKY
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	FI-FIRM	S-STICKY
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE	IV	SIC-SILTY CLAY	0.4 - 0.1	VFI-VERY FIRM	VS-VERY STICKY
FP-FLOOD PLAN		C-CLAY			
		SC-SANDY CLAY		EFI-EXTREMELY FIRM	NP-NON-PLASTIC
					SP-SLIGHTLY STICKY
					P-PLASTIC
					VP-VERY PLASTIC


STRUCTURE


- SG-SINGLE GRAIN
- M-MASSIVE
- CR-CRUMB
- GR-GRANULAR
- SBK-SUBANGULAR BLOCKY
- ABK-ANGULAR BLOCKY
- PL-PLATY
- PR-PRISMATIC

MINERALOGY

- SLIGHTLY EXPANSIVE
- EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

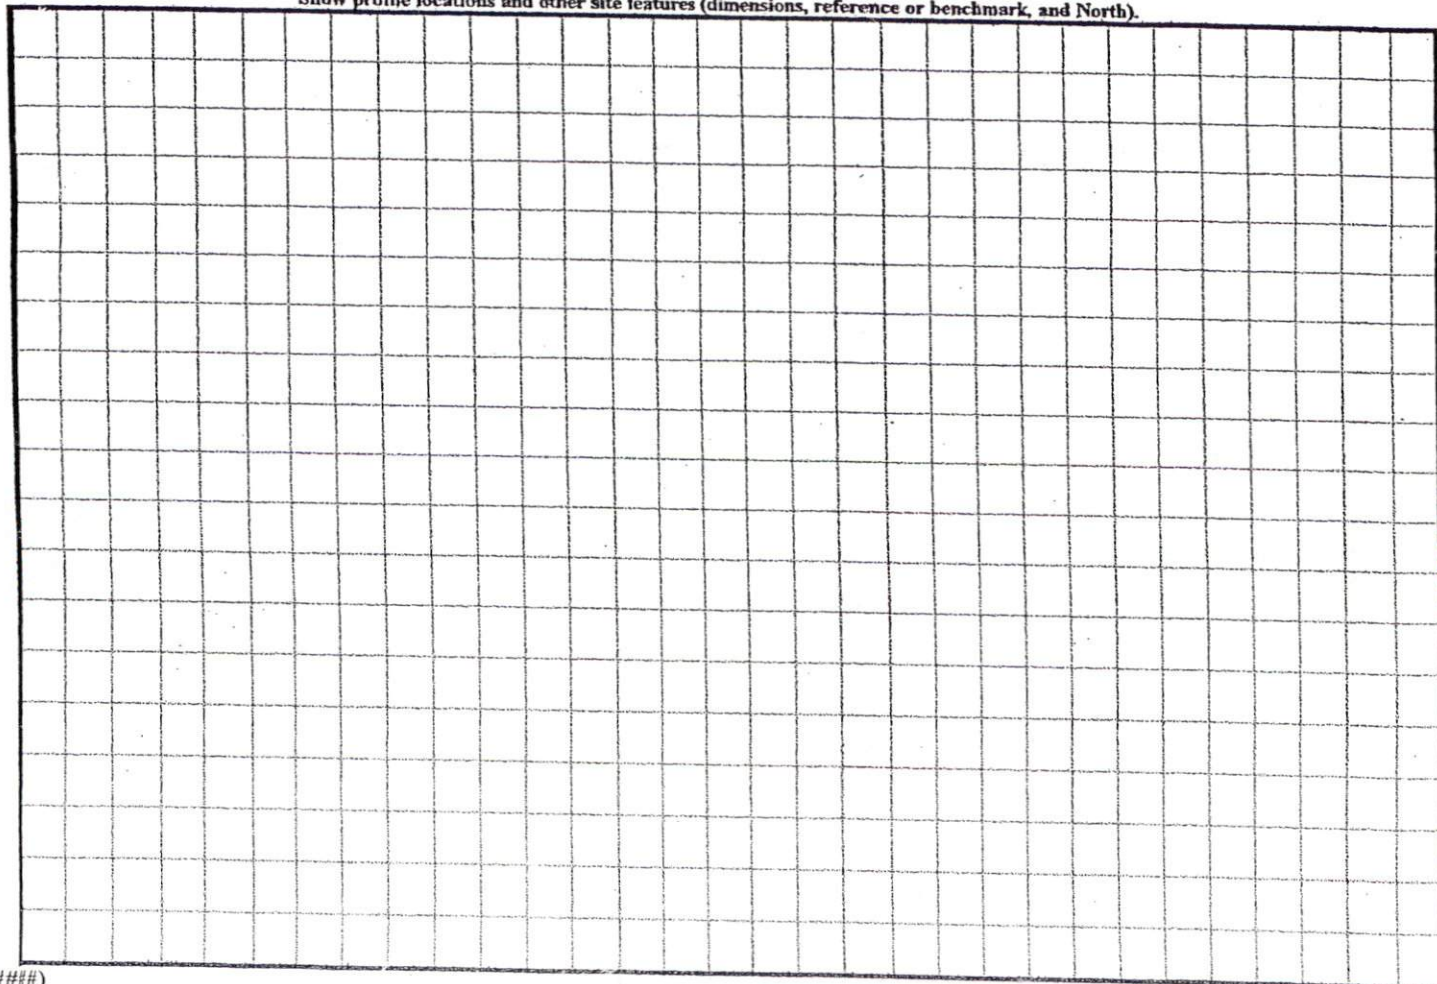

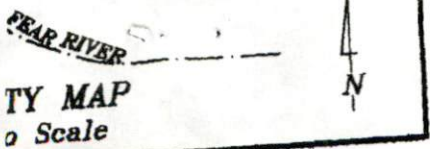

TY MAP
Scale

- LEGEND:**
- TP Telephone Pedestal
 - MH Manhole
 - Trans. Electric Transformer
 - WM Water Meter
 - Esmt. Easement
 - R/W Right-of-Way
 - C/L Centerline
 - P.C. Plat Cabinet
 - D.B. Deed Book
 - M.B. Map Book
 - B.M. Book of Maps
 - PIN Parcel Identifier Number
- or Stake
monument
- Ac. Acres
 - Sq. Ft. square feet

datum of 1927
datum of 1983
traverse Survey

property corners

ordinate method.
are Horizontal
otherwise indicated.

Date _____
Zoning Administrator _____

#BEDROOMS 3
DISTRICT USE SFD
SITE PLAN APPROVAL

in Easement shall be reserved
nd as shown hereon.


Been
roved

Zoned RA-40
Jeff S. Wester
D.B. 986, Pg. 928
P.C. "F", Slide 56-A

RD STATEMENT
at are not
MA 100 year
shown on
-0085D
16, 1990

*Control Point
Ex. Iron Bar

RA-40
Gary M. Turlington
D.B. 778, Pg. 382

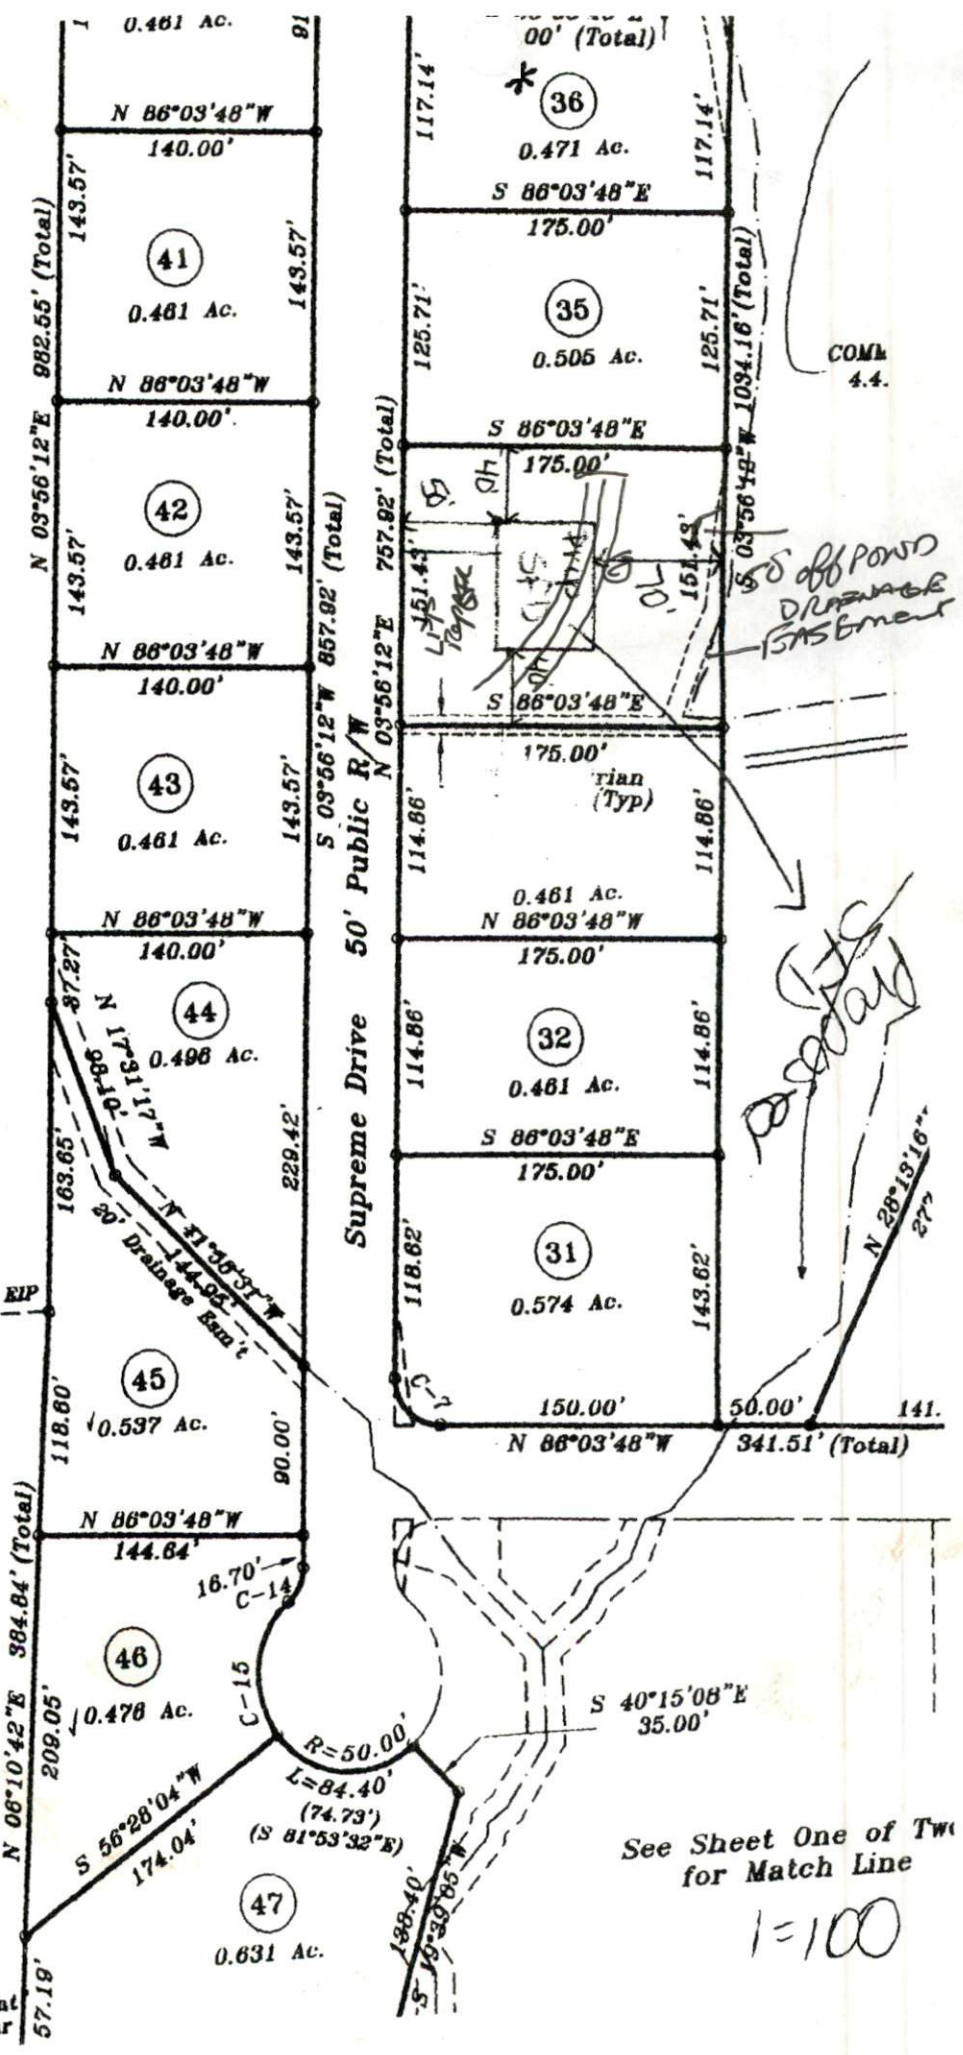

COM 4.4.

Handwritten signature/initials