

HTE 0450010995

IMPROVEMENT PERMIT

21508

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Danny Norris
Property Location: SR# 1115
New Installation, Septic Tank, Repairs, Nitrification Line

Subdivision CRESTVIEW Lot # 147

Tax ID # Quadrant #

Number of Bedrooms Proposed: 3(56x46) Lot Size: .35 AC

Basement with Plumbing: Garage: X

Water Supply: Well, Public, Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional, 25% Reduction SYSTEM

Size of tank: Septic Tank: 1000 gallons Pump Tank: gallons


Subsurface Drainage Field: No. of ditches 1, exact length of each ditch 200 ft., width of ditches 3 ft., depth of ditches 18 in.

French-Drain Required: Linear feet of 25% Reduction system

Date: 01-10-05

Signed: Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

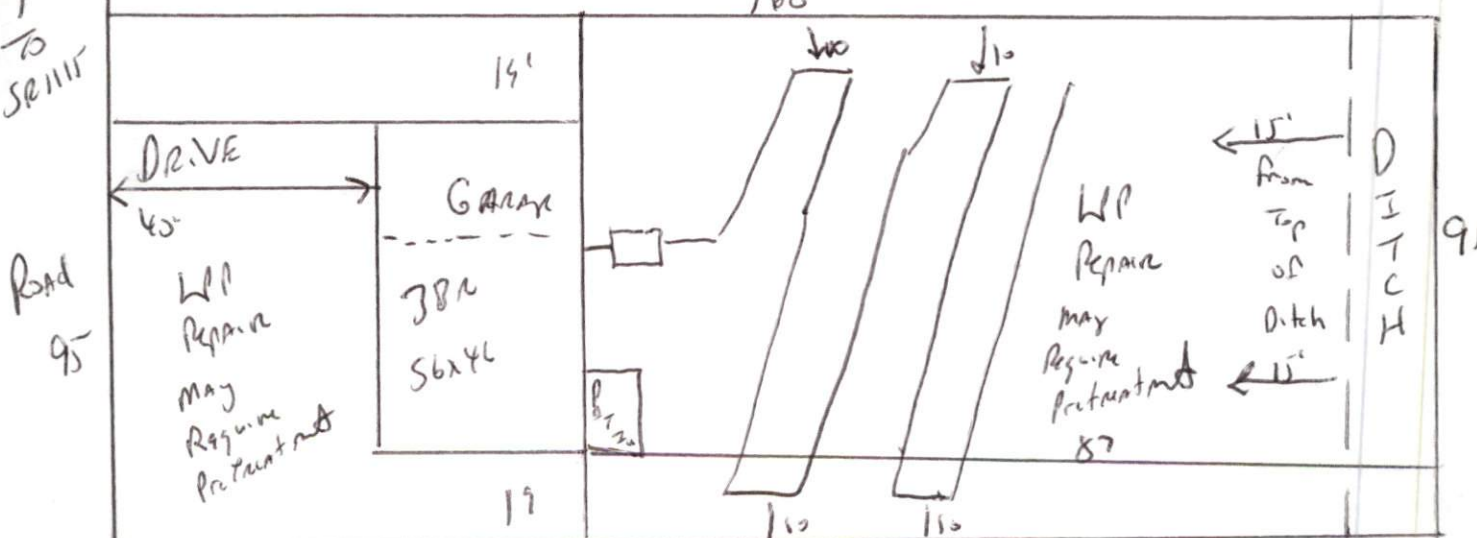

Keep draw lines 15' from Top of Ditch Bank (Rear)
Meet onsite stub out Plumbing shallow where shown ground level or higher
Maintain All setbacks

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 21508. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Danny Telephone # _____

Address _____

Property Location SR# 1115 Road Name _____

Subdivision Crestview Lot # 147 # Bedrooms Proposed 3(56x46) Lot Size .35 ac

TYPE OF SYSTEM

New Installation [] Repair Septic Tank Nitrification Lines
[] Conventional Other 25% Reduction system
[] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 200 Ft.

Width of ditches 3 ft. Depth of ditches 18-24 inches 4 25% reduction system

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County Joe West RS

Date 01-10-05