

HTE 0450011038

IMPROVEMENT PERMIT

21534

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) MOJ Home Builder
Property Location: SR# 1267 Womack Rd
New Installation
Septic Tank
Repairs
Nitrification Line

Subdivision River Ridge Lot # 6

Tax ID # Quadrant #

Number of Bedrooms Proposed: 3 (40x54) Lot Size: 13.71 Ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 100 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to Conventional

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 5 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18 MAX in.


French Drain Required: Linear feet

Date: 01-26-05

Signed: J. W. WRS Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

NOTE Well To Be 100' From ANY PART of septic system

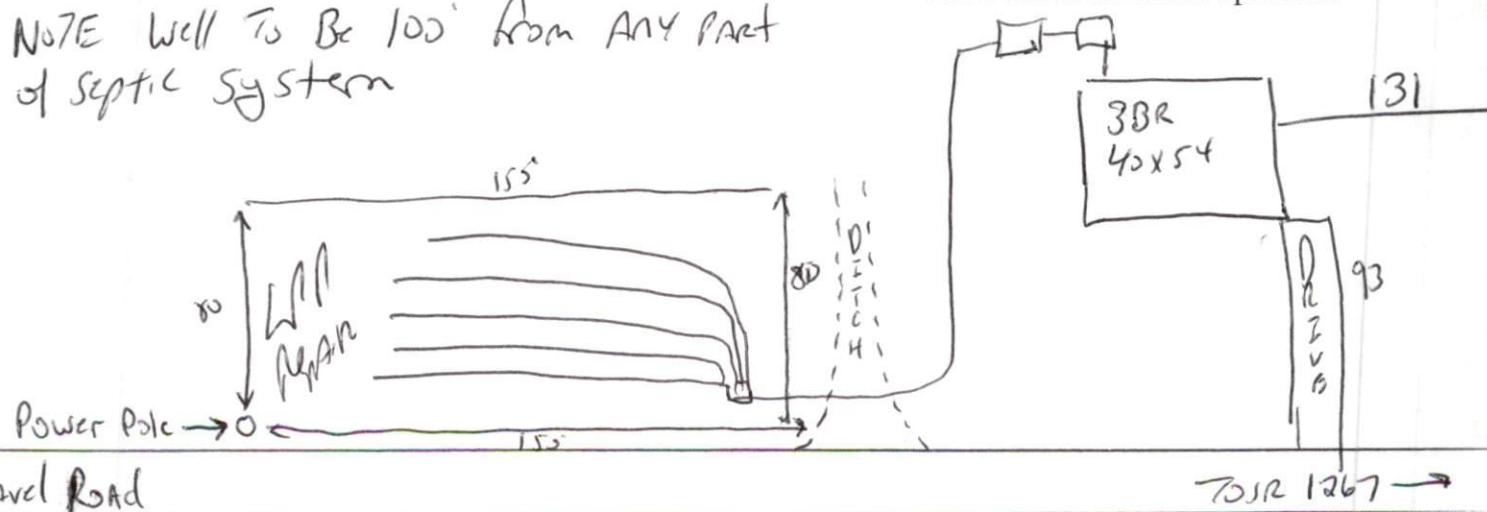

Meet onsite Before Installing MAINTAIN All set Backs Well To Be 100' from Any Part of septic system

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 21534. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Moss Home Builders  
Name \_\_\_\_\_ Telephone # \_\_\_\_\_

Address  
1267

Property Location SR# \_\_\_\_\_ Road Name \_\_\_\_\_  
River Ridge 6 3 (40x54) 13.7/acre  
Subdivision Lot # # Bedrooms Proposed Lot Size

**TYPE OF SYSTEM**

New Installation [ ] Repair  Septic Tank  Nitrification Lines  
[ ] Conventional  Other Pure  
[ ] Basement [ ] With Plumbing [ ] Without Plumbing

Water Supply: [ ] Well  Public Water Supply Minimum Well Setback: 50 Ft.  
Septic Tank 1000 gal Pump Chamber 1000 gal

**NITRIFICATION FIELD SPECIFICATIONS**

Number of fields 1 # of lines per field 5 Length of lines 100<sup>max</sup> Ft.  
Width of ditches 3 ft. Depth of ditches 18 inches  
French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Joe West RS \_\_\_\_\_  
Signature of Authorized Agent for Harnett County Date 01-26-05