

**SOIL/SITE EVALUATION**  
**for ON-SITE WASTEWATER SYSTEM**

Owner: \_\_\_\_\_ Applicant: \_\_\_\_\_  
 Address: \_\_\_\_\_  
 Proposed Facility: \_\_\_\_\_ Design Flow (.1949): \_\_\_\_\_ Date Evaluated: \_\_\_\_\_  
 Location of Site: \_\_\_\_\_ Property Size: \_\_\_\_\_  
 Water Supply:  Public  Individual  Well  Spring  Other  
 Evaluation Method:  Auger Boring  Pit  Cut  
 Type of Wastewater:  Sewage  Industrial Process  Mixed

Profile #	1940 Landscape Position/Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			1941 Structure/Texture	1941 Consistence Mineralogy	1942 Soil Wetness/Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr. Horiz	
1	L 3%	0-15	SL	FR GA NSMP					-4
		15-42	SCL	SL GA 100% S.P.	36				
2	L 3%	0-18	SL	FR GA NSMP					-4
		18-42	SCL	SL GA 100% S.P.	36				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	CON	CON/LPP
Site LTAR	-4	-4

Other Factors (.1946): \_\_\_\_\_  
 Site Classification (.1948): \_\_\_\_\_  
 Evaluated By: \_\_\_\_\_  
 Others Present: \_\_\_\_\_


COMMENTS: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	NS-NON-STICKY SS-SLIGHTLY STICKY S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6		
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3		
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE  
 SG-SINGLE GRAIN  
 M-MASSIVE  
 CR-CRUMB  
 GR-GRANULAR  
 SBK-SUBANGULAR BLOCKY  
 ABK-ANGULAR BLOCKY  
 PL-PLATY  
 PR-PRISMATIC

MINERALOGY  
 SLIGHTLY EXPANSIVE  
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

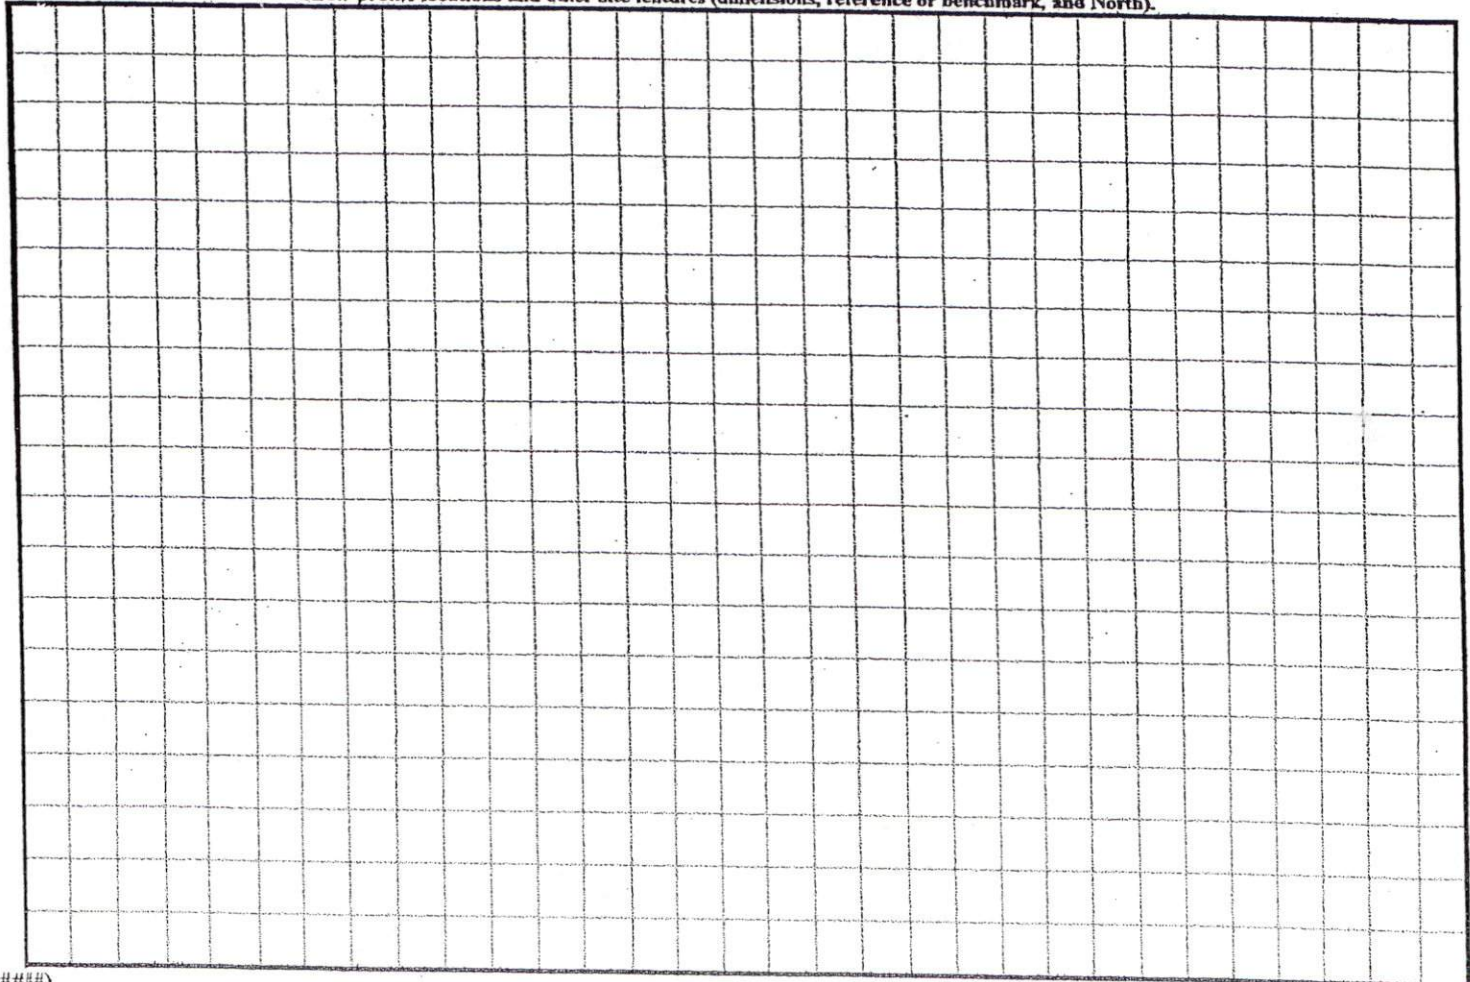



FRB  
(Control Corner)

S 83° 34' 14" E

185.57'

FRB

1194.86' to FIP

10' Minimum Side Setback Line

30' Private Road Easement  
(Deed Book 1367, Page 207)

R/W

NORTH C  
HARNET  
This Map  
in this o  
This —  
o'clock  
KIMBI  
Regi  
By:

SITE PLAN APPROVAL

DISTRICT RA30

USE SFD

#BEDROOMS

4

2-23-05

ZONING ADMINISTRATOR

Sandra F. Owen  
Deed Book 1125, Page 670


No. 2

65'

*LP Repair*

41.5

Proposed  
Log Dwelling



100.5

25' Minimum Rear Setback Line

208.21'

S 19° 02' 59" W

10' Minimum Side Setback Line

1.00 Acre

Nov. 22  
88 x 5  
2021

*Repair*

67'