

HTE# 05-5-1151412

IMPROVEMENT PERMIT 22781

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) STANCI BUILDERS INC New Installation Septic Tank Repair
Property Location: SR# 1415 Rams Ct RD Nitrification Line Expansion
Subdivision Alex Place Lot # 10
Tax ID# _____ Quadrant # _____
Number of Bedrooms Proposed: 3 3606P/D Lot Size: 1.10

Basement with Plumbing: Garage:
Water Supply: Well Public Community
Distance From Well: _____ ft.

Following is the minimum specifications for sewage disposal system on above captioned property.
Subject to final approval.

Type of system: Conventional Other Pump to Conventional
Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 1 ft. of each ditch 400 ft. ditches 3 ft. ditches 12" max in.


French Drain Required: - Linear feet

Date: 12-12-05
PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

This permit is subject to revocation if site plans or intended use change.

Signed: James E. Markant @RS
Environmental Health Specialist

*STAY OUT of Buffered
AND UNSATURATED SOILS
LINE.

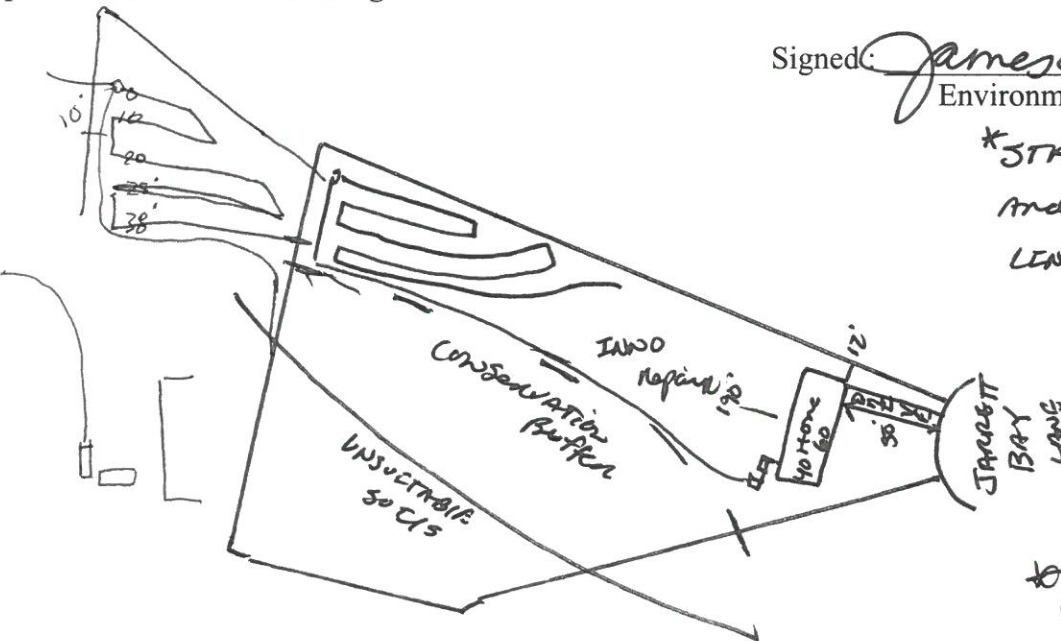

*CONTRACTOR
TO MEET
ON SITE
Prior to
Installation

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22781. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

STANCI Builders INC 637-2073
Name Telephone #

466 STANCI RD Anglen N.C. 27501
Address

1415 Rawls Church RD
Property Location SR# Road Name

Alex Place 10 3 360 SPD 1.10
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other Pump to Conventional

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber 1000 gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 1 Length of lines 400 Ft.

Width of ditches 3 ft. Depth of ditches 12" inches

French Drain: Linear feet required - Depth of gravel -

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Marshall
Signature of Authorized Agent for Harnett County

12-12-05
Date