

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: _____ Applicant: _____
 Address: _____ Date Evaluated: _____
 Proposed Facility: _____ Design Flow (.1949): _____ Property Size: _____
 Location of Site: _____ Property Recorded: _____
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			1941 Structure/ Texture	1941 Consistence Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr. Horiz.	
1	L 2%	0-8	SL	FR GR NSNP					.3
		8-36	SCL	SL GR SCL S.P	25"				
2	L 2%	0-10	SL	FR GR NSNP					.4
		10-42	SCL	SL GR SCL S.P	32				
3	L 2%	0-12	SL	FR GR NSNP					.4
		12-42	SCL	SL GR SCL S.P	33				
3	L 2%	0-8	SL	FR GR NSNP					.4
		8-42	SCL	SL GR SCL S.P	34				
4	L	0-10	SL	FR GR NSNP					.4
		10-42	SCL	SL GR SCL S.P	33				
5					28"				
					31"				
6									
7					33"				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	60	60-2590
Site LTAR	.4	.4

Other Factors (.1946): _____
 Site Classification (.1948): _____
 Evaluated By: _____
 Others Present: _____


COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FR-FRIABLE	SS-SLIGHTLY STICKY
FS-FOOT SLOPE		L-LOAM		FI-FIRM	S-STICKY
N-NOSE SLOPE				VFI-VERY FIRM	VS-VERY STICKY
H-HEAD SLOPE	III	SI-SILT-	0.6 - 0.3	EFI-EXTREMELY FIRM	NP-NON-PLASTIC
CC-CONCLAVE SLOPE		SIL-SILT LOAM			SP-SLIGHTLY STICKY
CV-CONVEX SLOPE		CL-CLAY LOAM			P-PLASTIC
T-TERRACE		SCL-SANDY CLAY LOAM			VP-VERY PLASTIC
FP-FLOOD PLAN		SICL-SILTY CLAY LOAM			
	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

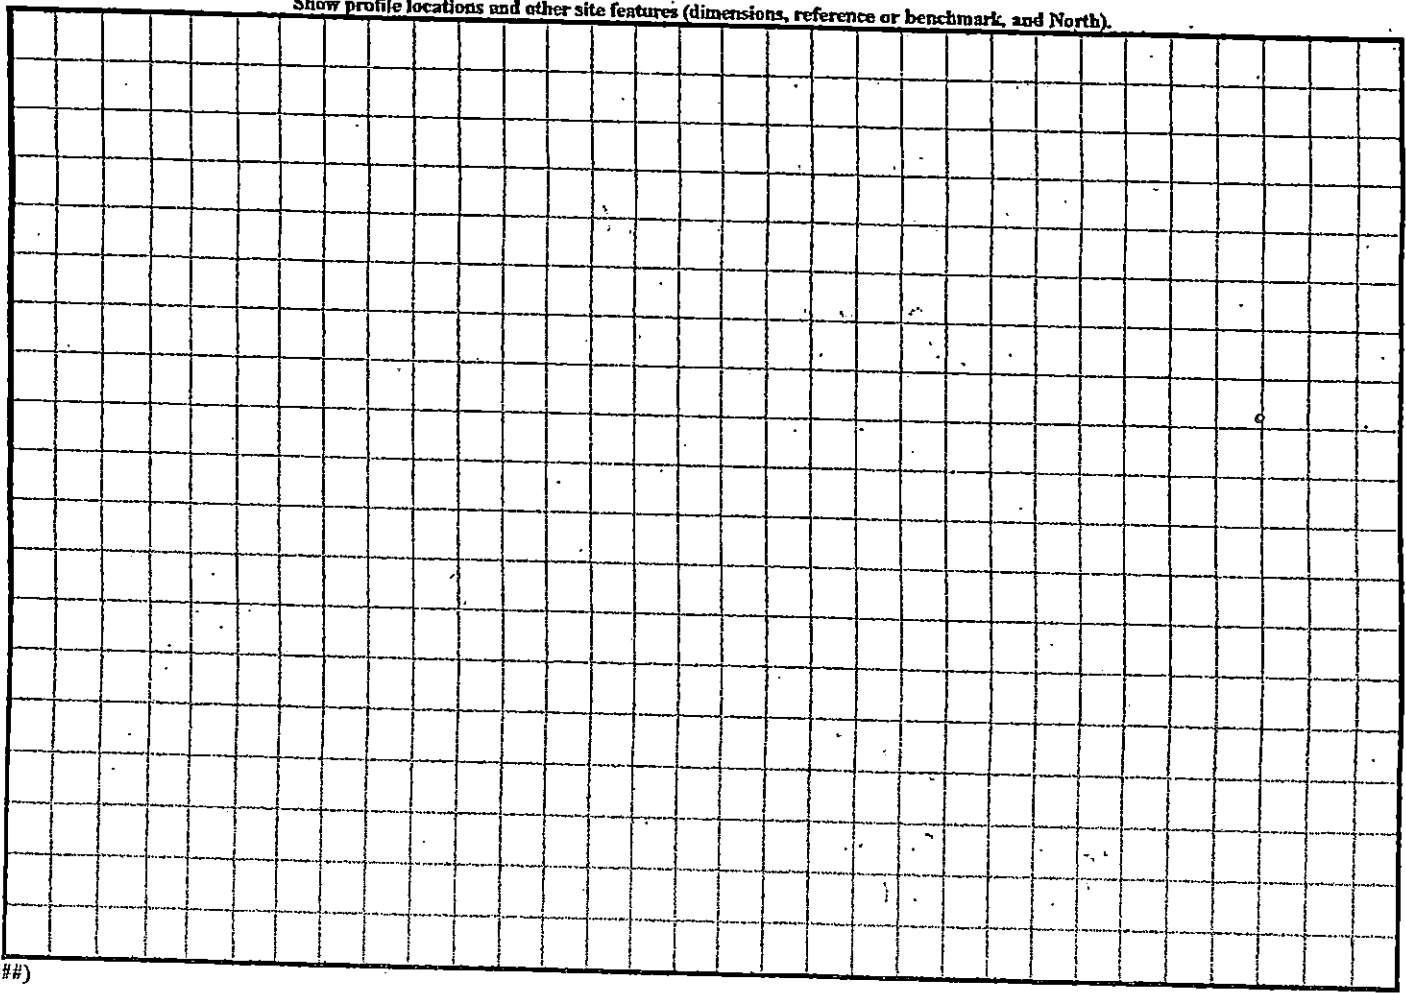


1=100

SITE PLAN APPROVAL

DISTRICT R-30 USE SFD

#BEDROOMS 3

Date 3-7-05 Zoning Administrator AB

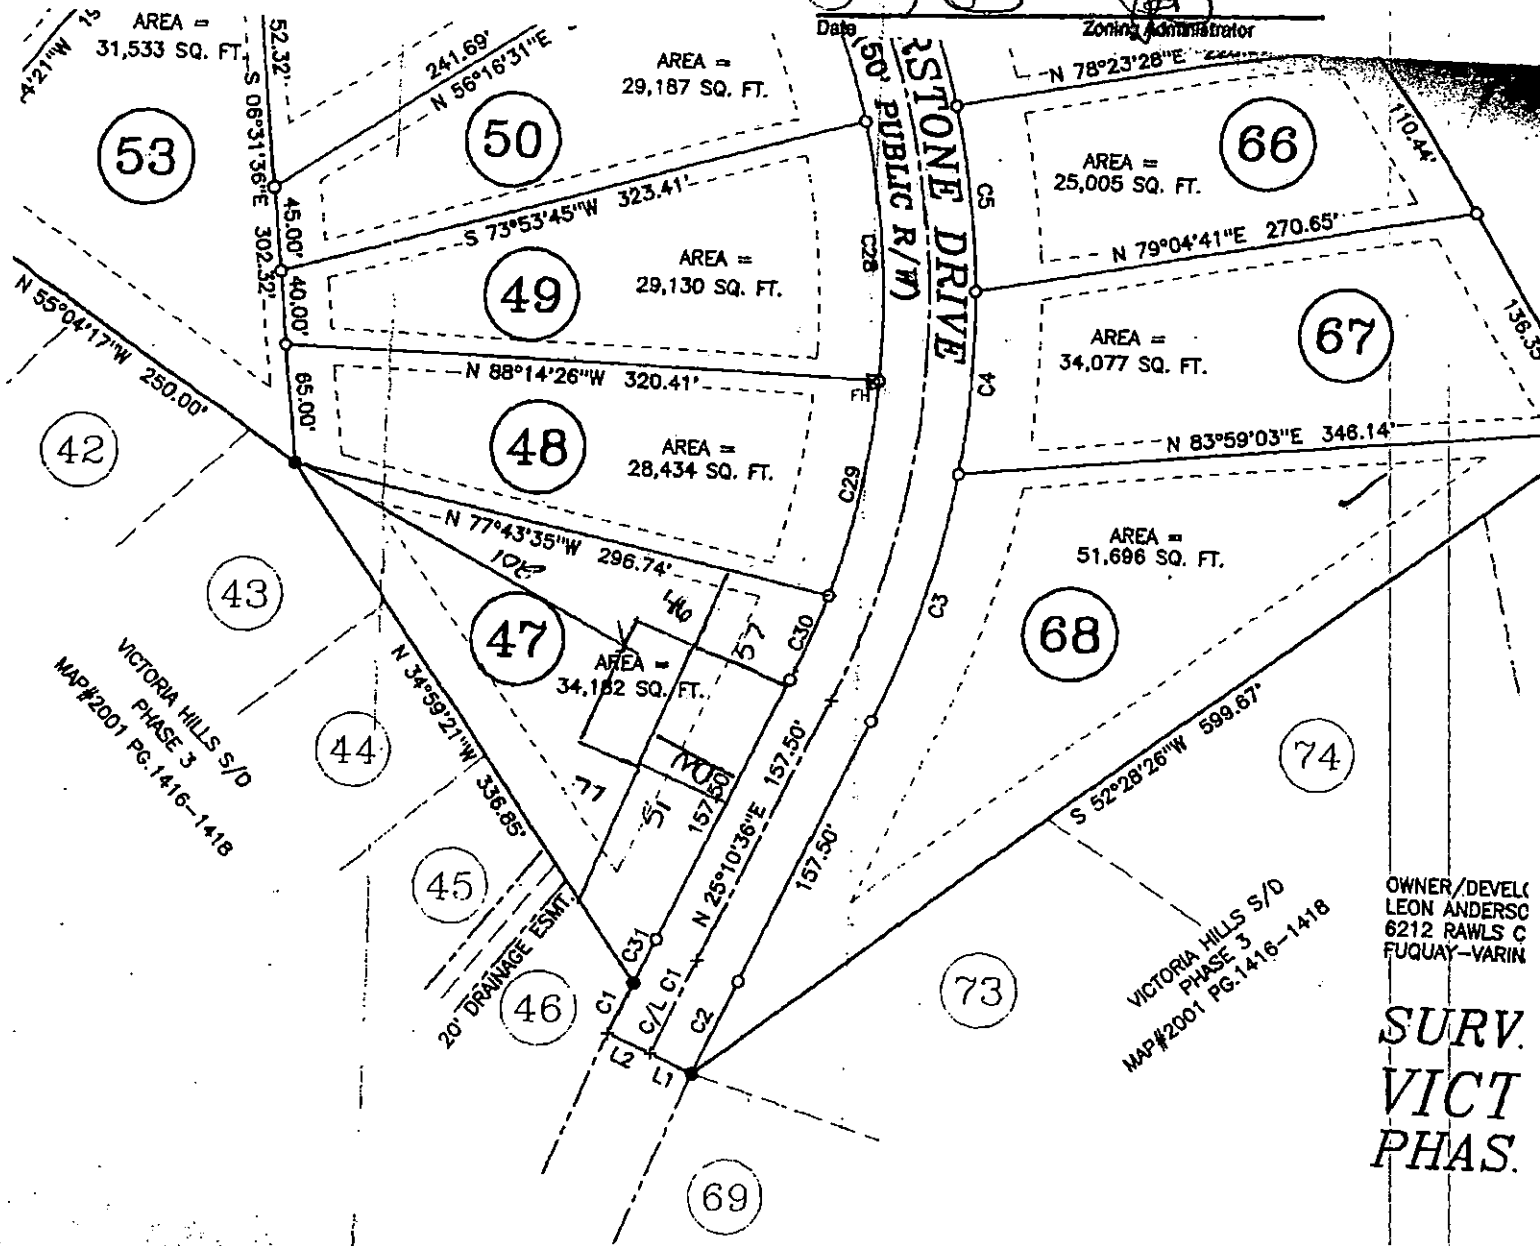

VICTORIA HILLS S/D
PHASE 3
MAP #2001 PG. 1416-1418

VICTORIA HILLS S/D
PHASE 3
MAP #2001 PG. 1416-1418

OWNER/DEVELOPER
LEON ANDERSON
6212 RAWLS C
FUQUAY-VARIN

**SURV.
VICT
PHAS.**

HECTOR'S
SCALE 1" = 100'
REVISED

MAULDIN -
P.O. BOX 4
FUQUAY VAR
(919) 552-

