

**SOIL/SITE EVALUATION  
 for ON-SITE WASTEWATER SYSTEM**

Owner: 0550011674

Applicant:

Address:

Date Evaluated:

Proposed Facility:

Design Flow (.1949): 760

Property Size:

Location of Site:

Property Recorded:

Water Supply:  Public  Individual  Well  Spring  Other

Evaluation Method:  Auger Boring  Pit  Cut

Type of Wastewater:  Sewage  Industrial Process  Mixed

P R O F I L E #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR	
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz		
		0-18	GR SU	VFA	SC					
		18-27	SDK SC	FR	SC		48			.4
		27-44	SDK SC	F2	SC					
		0-21	GR SL	VFA	SC					
		21-41	SDK SC	VFA	SC		48			.5
		0-24	GR SL	VFA	SC					
		24-44	SDK SC	FR	SC		48			.5
		0-24	GR JL	VFA	JA					
		24-44	SDK SC	FR	JA		48			.5
		0-24	GR JL	VFA	JA					
		24-44	SDK SC	FR	JA		48			.5
		0-24	GR SL	VFA	JA					
		24-44	SDK SC	FR	JA		48			.5
		0-24	GR SL	VFA	JA					
		24-44	SDK SC	FR	JA		48			.5

Description	Initial System	Repair System
Available Space (.1945)	✓	✓
System Type(s)	Gravity	W/O
Site LTAR	.5	.25

12240 16.24 250 LF

Other Factors (.1946): \_\_\_\_\_  
 Site Classification (.1948): PS  
 Evaluated By: [Signature]  
 Others Present: KR


COMMENTS: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_


<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FR-FRIABLE	SS-SLIGHTLY STICKY
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	VFI-VERY FIRM	VS-VERY STICKY
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE	IV	SIC-SILTY CLAY	0.4 - 0.1	EFI-EXTREMELY FIRM	NP-NON-PLASTIC
FP-FLOOD PLAN		C-CLAY			
		SC-SANDY CLAY			
		SICL-SILTY CLAY LOAM			SP-SLIGHTLY STICKY
					P-PLASTIC
					VP-VERY PLASTIC

STRUCTURE  
 SG-SINGLE GRAIN  
 M-MASSIVE  
 CR-CRUMB  
 GR-GRANULAR  
 SBK-SUBANGULAR BLOCKY  
 ABK-ANGULAR BLOCKY  
 PL-PLATY  
 PR-PRISMATIC

MINERALOGY  
 SLIGHTLY EXPANSIVE  
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

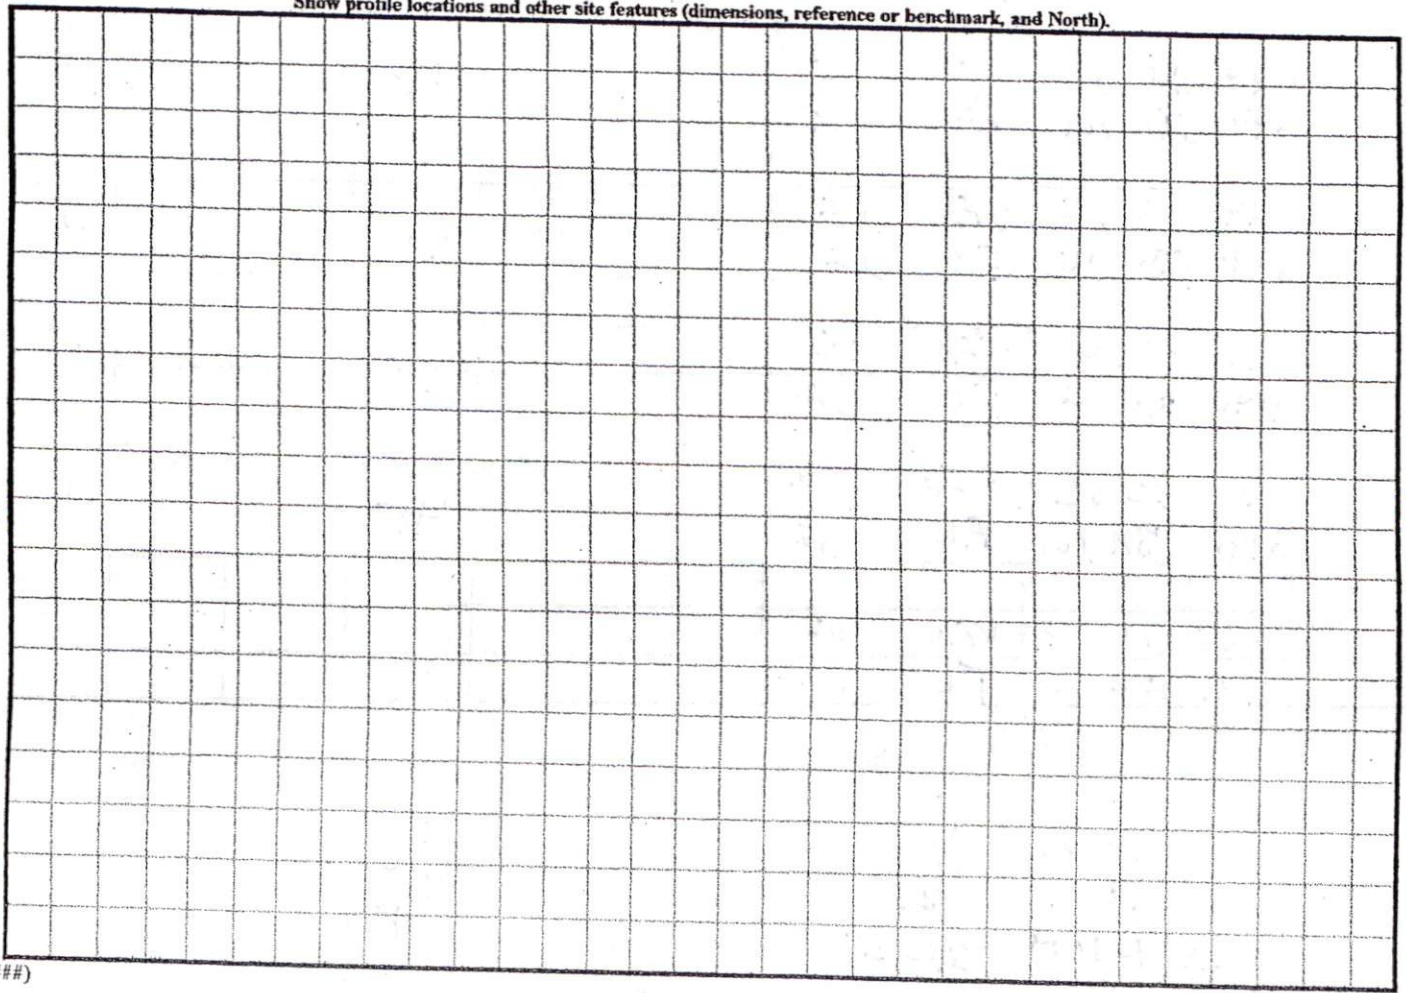

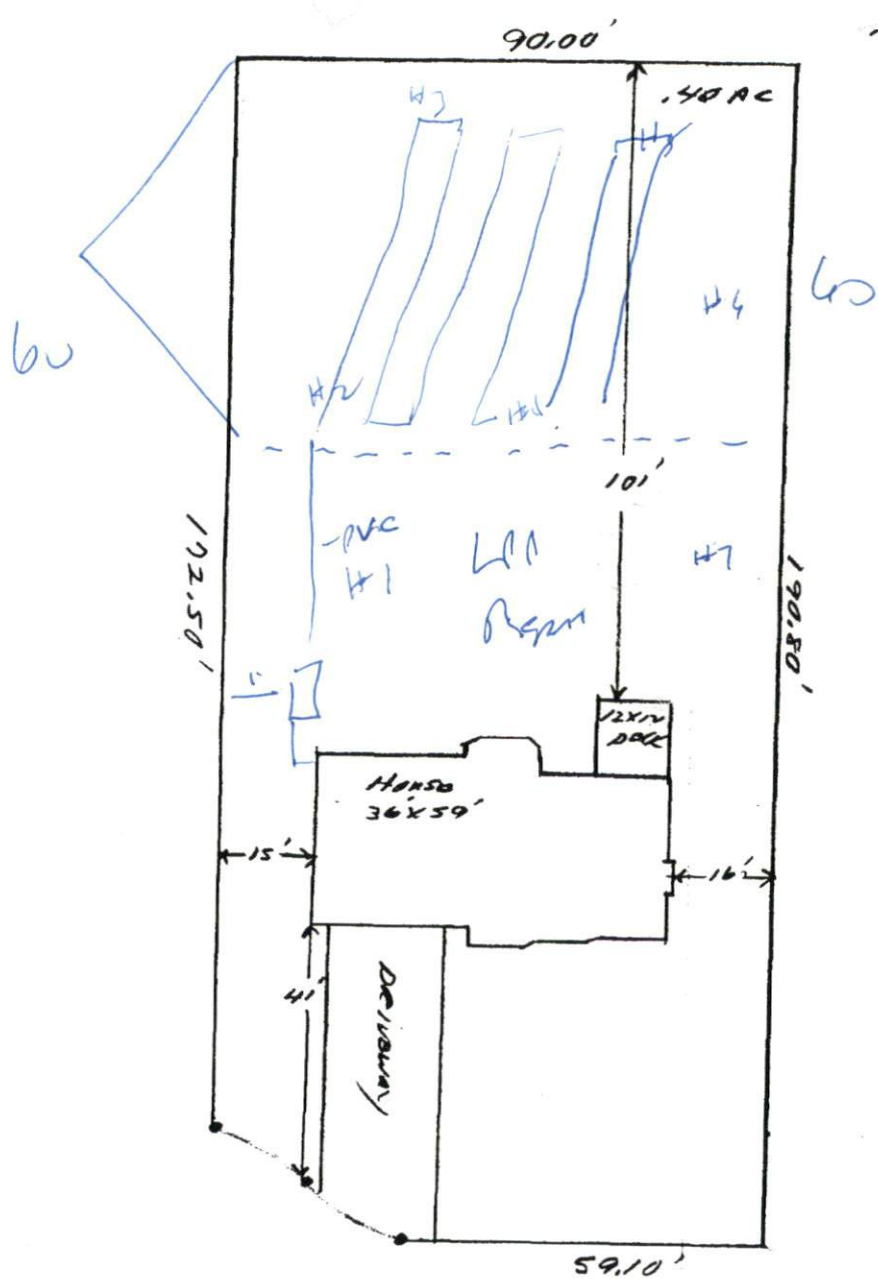

Timberwood Lane

Wm. Kent PIERCE, INC  
Lot # 145 CCESTVIEW Estates

SITE PLAN APPROVAL  
 DISTRICT ~~RAA02~~ USE SFD  
 3  
 3/16/05  
 ZONING ADMINISTRATOR