

...IMPROVEMENT PERMIT

Ref# 00-40000617

00-011466
HTE # 05-5-12157R

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Salvia McNeill

New Installation Septic Tank

Property Location: SR# 27 East

Repairs Nitrification Line

Subdivision Land Grant Lot # 3

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 Lot Size: .92 Ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18-24 in.


French Drain Required: _____ Linear feet

Date: 6/22/2000 8/23/2005 Bm

Signed: Bryan McJannet R.S.
Environmental Health Specialist

- * Maintain setbacks
- * Run lines on contour

This permit is subject to revocation if site plans or intended use change.

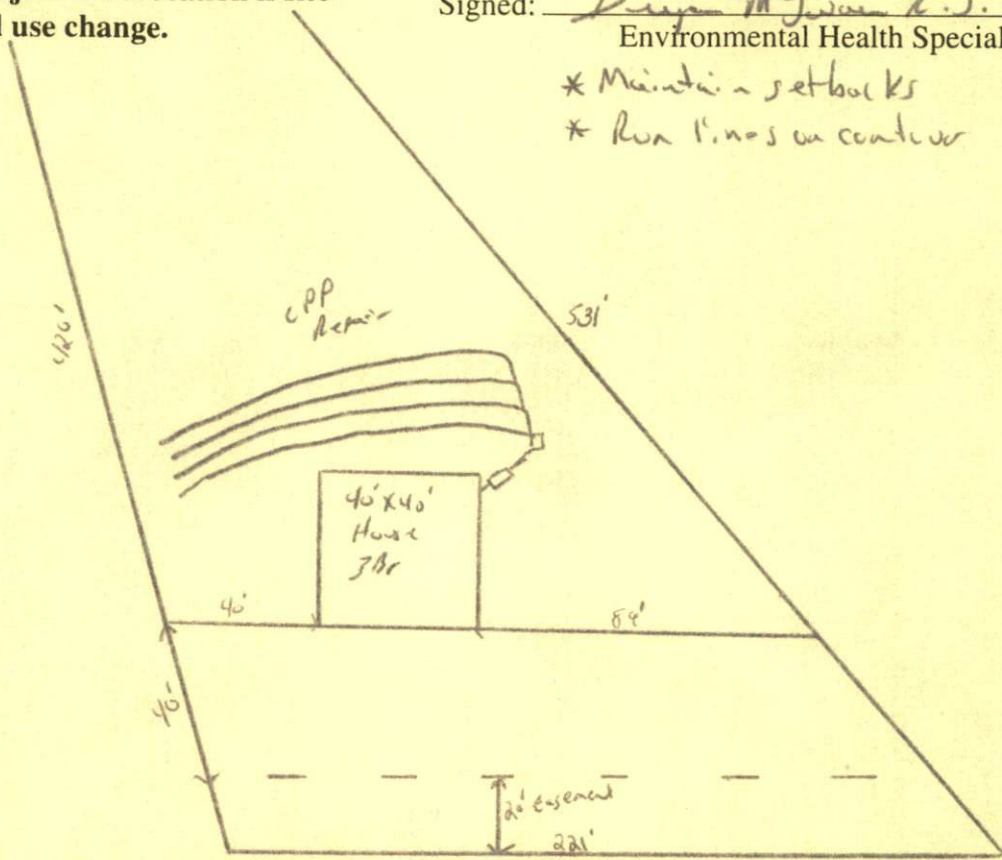

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 17505. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent _____

Name: Calvin McNeil Telephone # 919-894-7170

Address: 2195 Bailey Rd. Coats, N.C. 27521

Property Location: SR # 27 Road Name _____

New Installation _____ Repair _____ Septic Tank _____ Nitrification Lines _____

Subdivision Land Grant Lot # 3

Number of Bedrooms Proposed: 3 Lot size: .92 Ac

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public _____ Minimum Well Setback: 50 ft.

Type of System: Conventional _____ Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 4 Length of lines 100 ft

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: Bryan McFadden L.S. Date: 4/22/2000 8/23/2005