HTE # 05-500 12349h

ARNETT COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION

18083

OPERATIONS PERMIT

Name: (owner) Kenneth Cummings ☒ New Installation ☒ Septic Tank ☐ Repair

Property Location: SR# 1125 ☒ Nitrification Line ☐ Expansion
Subdivision Forestoaks Lot # 79 Tax ID # _____ Quadrant # _____

Contractor: O. Mitchell Registration # _____

Basement with Plumbing: ☐ Garage: ☒

Water Supply: ☐ Well ☒ Public ☐ Community
Distance From Well: 50 ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: ☐ Conventional ☒ Other Pump to 25% Reduction system 2-2 Flow

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field | No. of ditches 1 | exact length of each ditch 200 ft. 2-2 Flow | width of ditches 3 ft. | depth of ditches 18-24 in.

French Drain Required: _____ Linear feet Date: 11-23-05
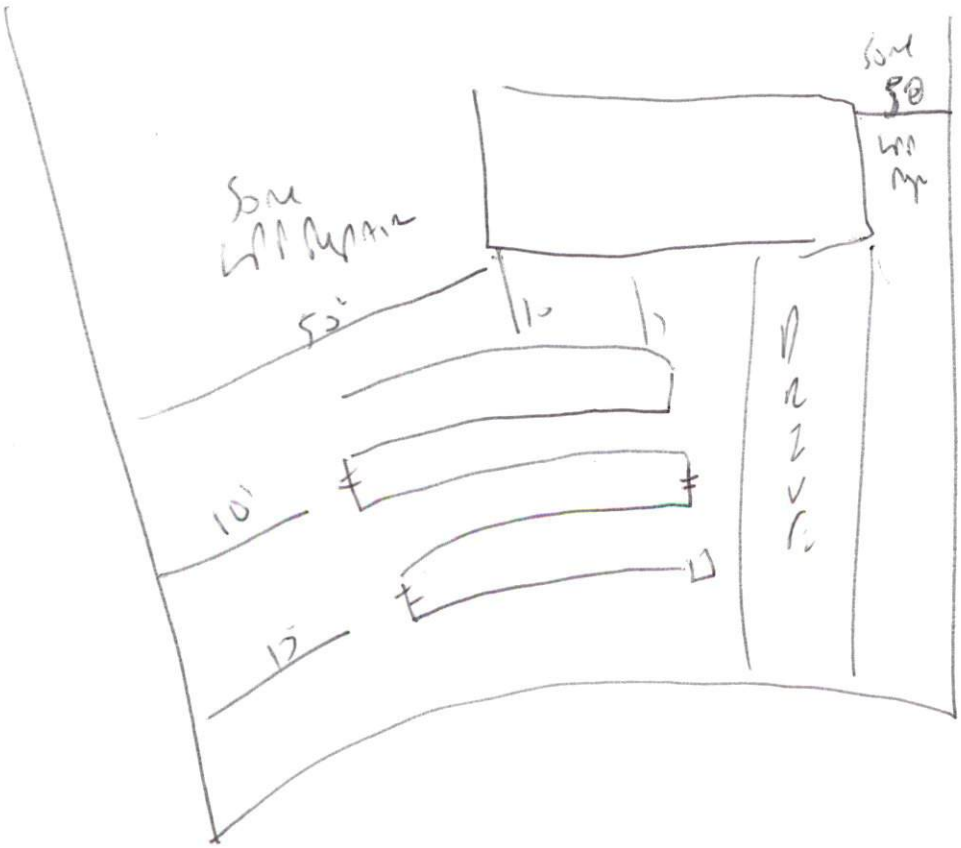
PERMIT NO. _____ Inspected by: [signature]