

Lot #:
 File #:
 Code:

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner:
 Address:
 Proposed Facility:
 Design Flow (.1949):
 Location of Site:
 Water Supply: Public Individual Well
 Evaluation Method: Auger Boring Pit
 Type of Wastewater: Sewage Industrial Process

Applicant:
 Date Evaluated:
 Property Size:
 Property Recorded:
 Spring Other
 Cut
 Mixed

1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		OTHER PROFILE FACTORS				Profile Class & LTAR
		1941 Structure/ Texture	1941 Consistence Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	
1 L 3%	0-15	SS	fm GR NSNP					.6
	15-48	SL	fm Gn NSNP	44				
2 L 3%	0-18	S	fm GR NSNP					.6
	18-48	SL	fm GR NSNP	48				
3 L 2%	0-12	SL	fm Gn NSNP					.4
	12-42	SCL	fm 1 st SAL SS.P	90'				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	25% Rad	LPP
Site LTAR	.6	.4

Other Factors (.1946): _____
 Site Classification (.1948): _____
 Evaluated By: _____
 Others Present: _____


COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	NS-NON-STICKY SS-SLIGHTLY STICKY S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6		
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3		
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE	IV	SIC-SILTY CLAY	0.4 - 0.1		
FP-FLOOD PLAN		C-CLAY			
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC


MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

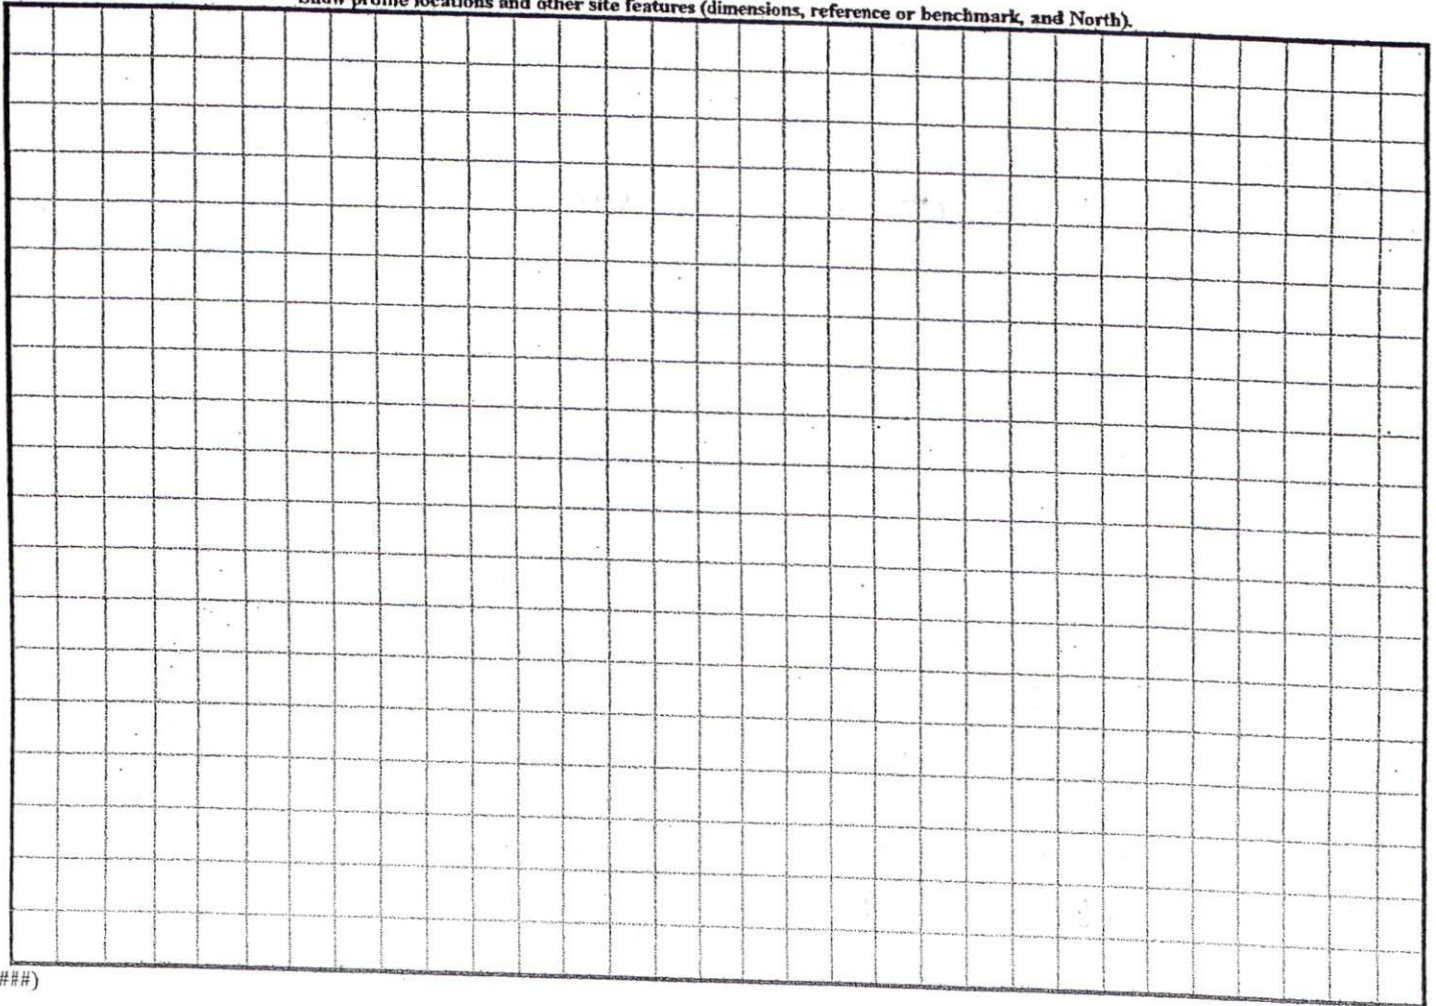

(#####)

2x100 25% Reducto → 30" → 24" → 30"

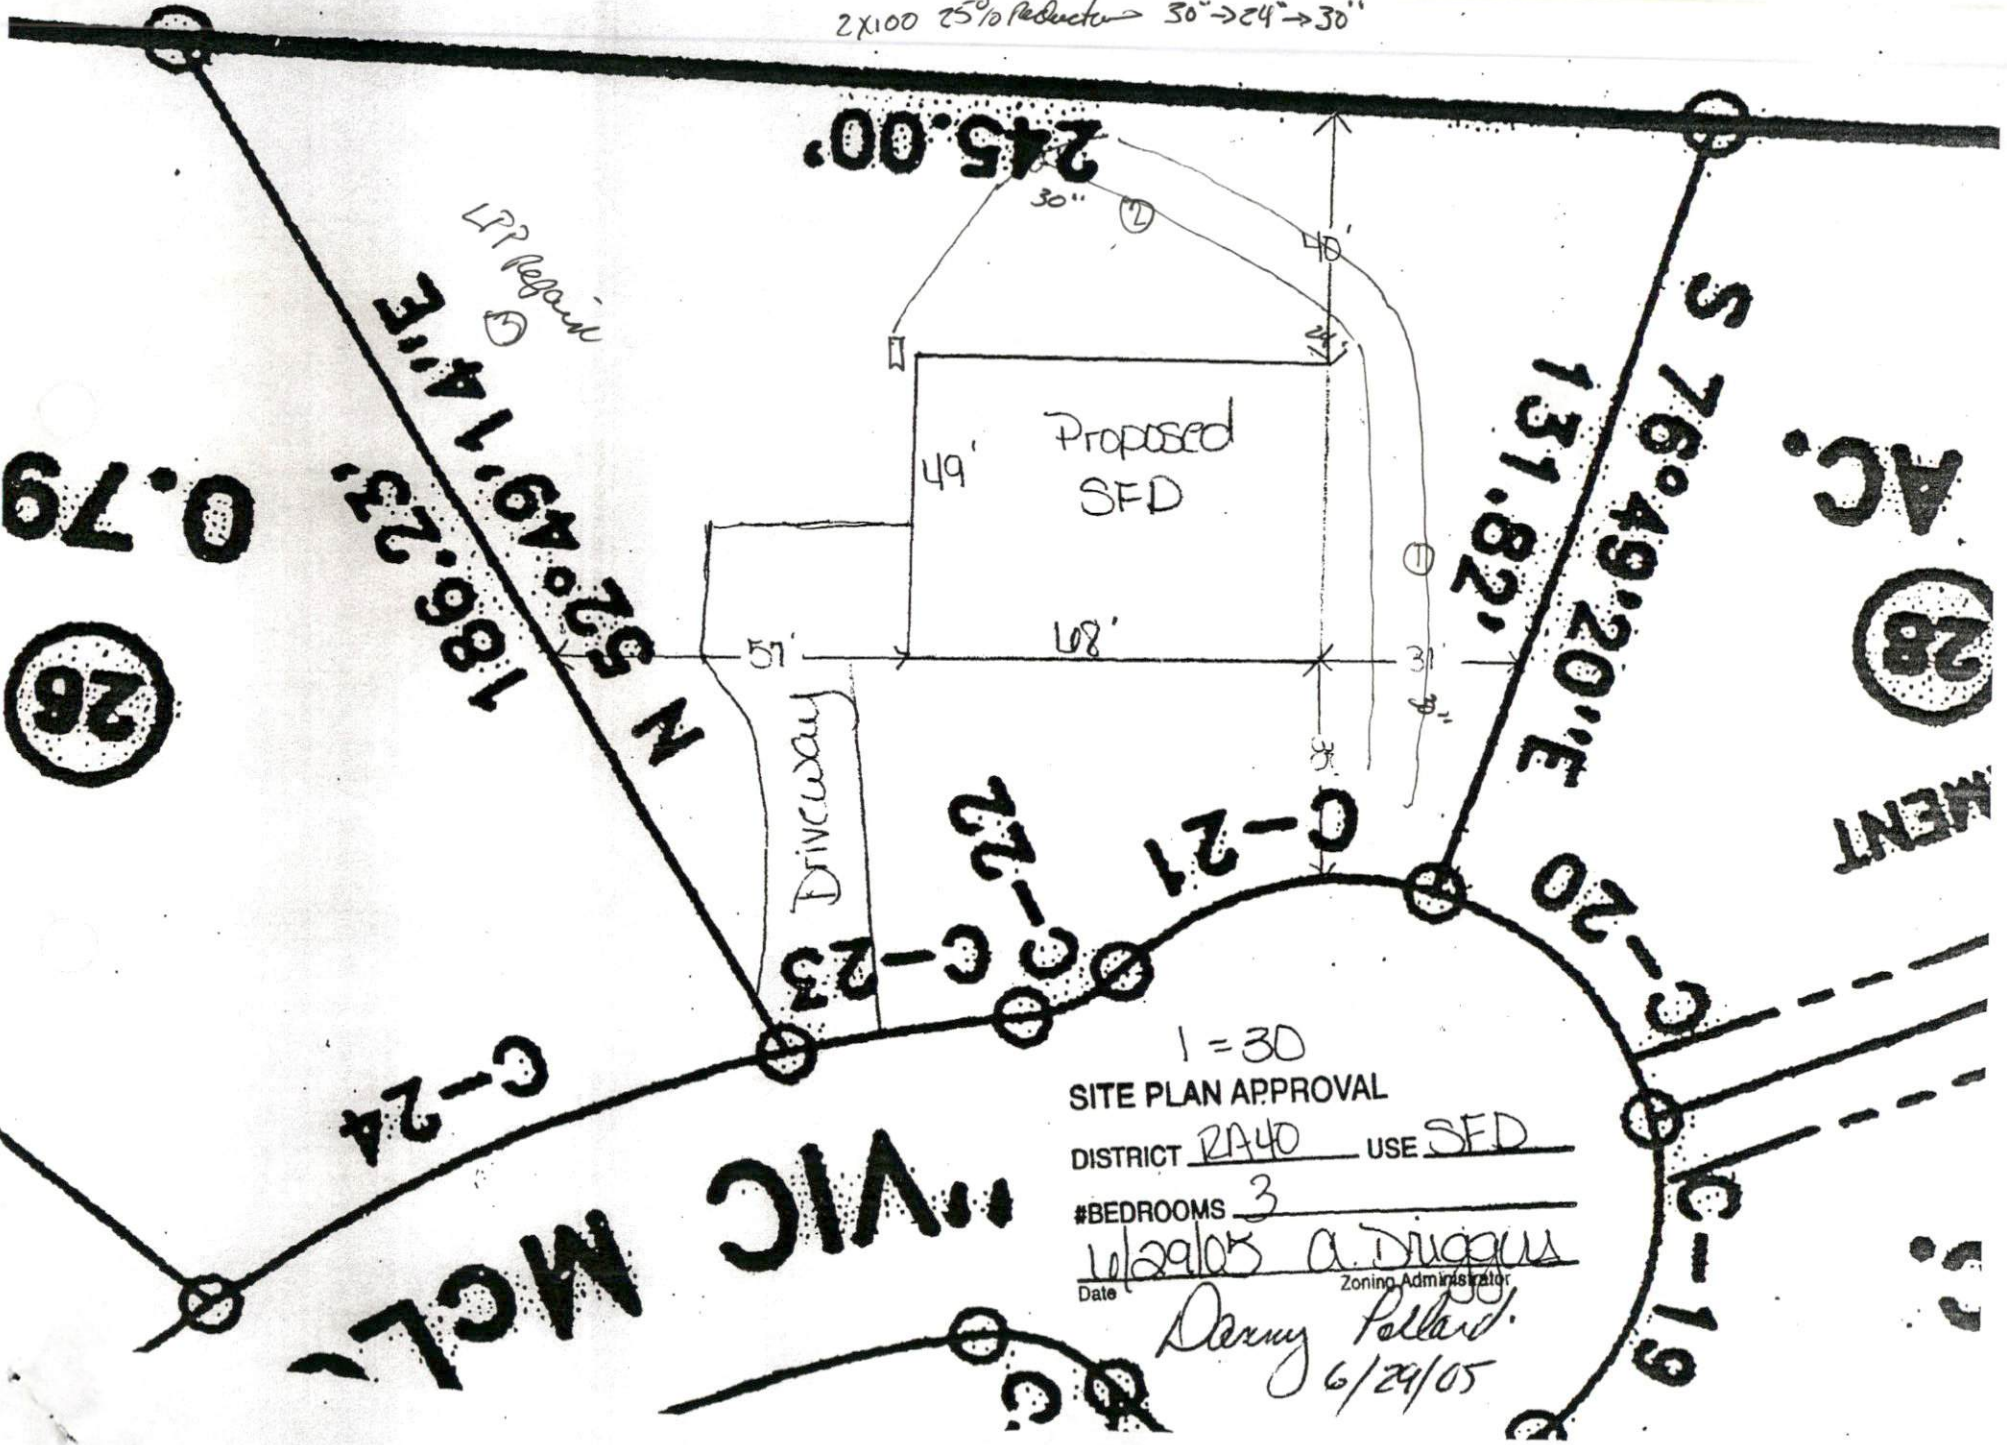

0.79
 26

LPT Repair
 N 52° 49' 14" E 187.98'
 VIC MCL

245.00'

Proposed SFD


Driveway

1 = 30
 SITE PLAN APPROVAL
 DISTRICT RA40 USE SFD
 #BEDROOMS 3
 Date 6/29/05 A. Duggan
 Zoning Administrator
Darryl Pollard
 6/29/05

AC
 28
 MENT

C-24
 C-23
 C-22
 C-21
 C-20
 C-19

245.00

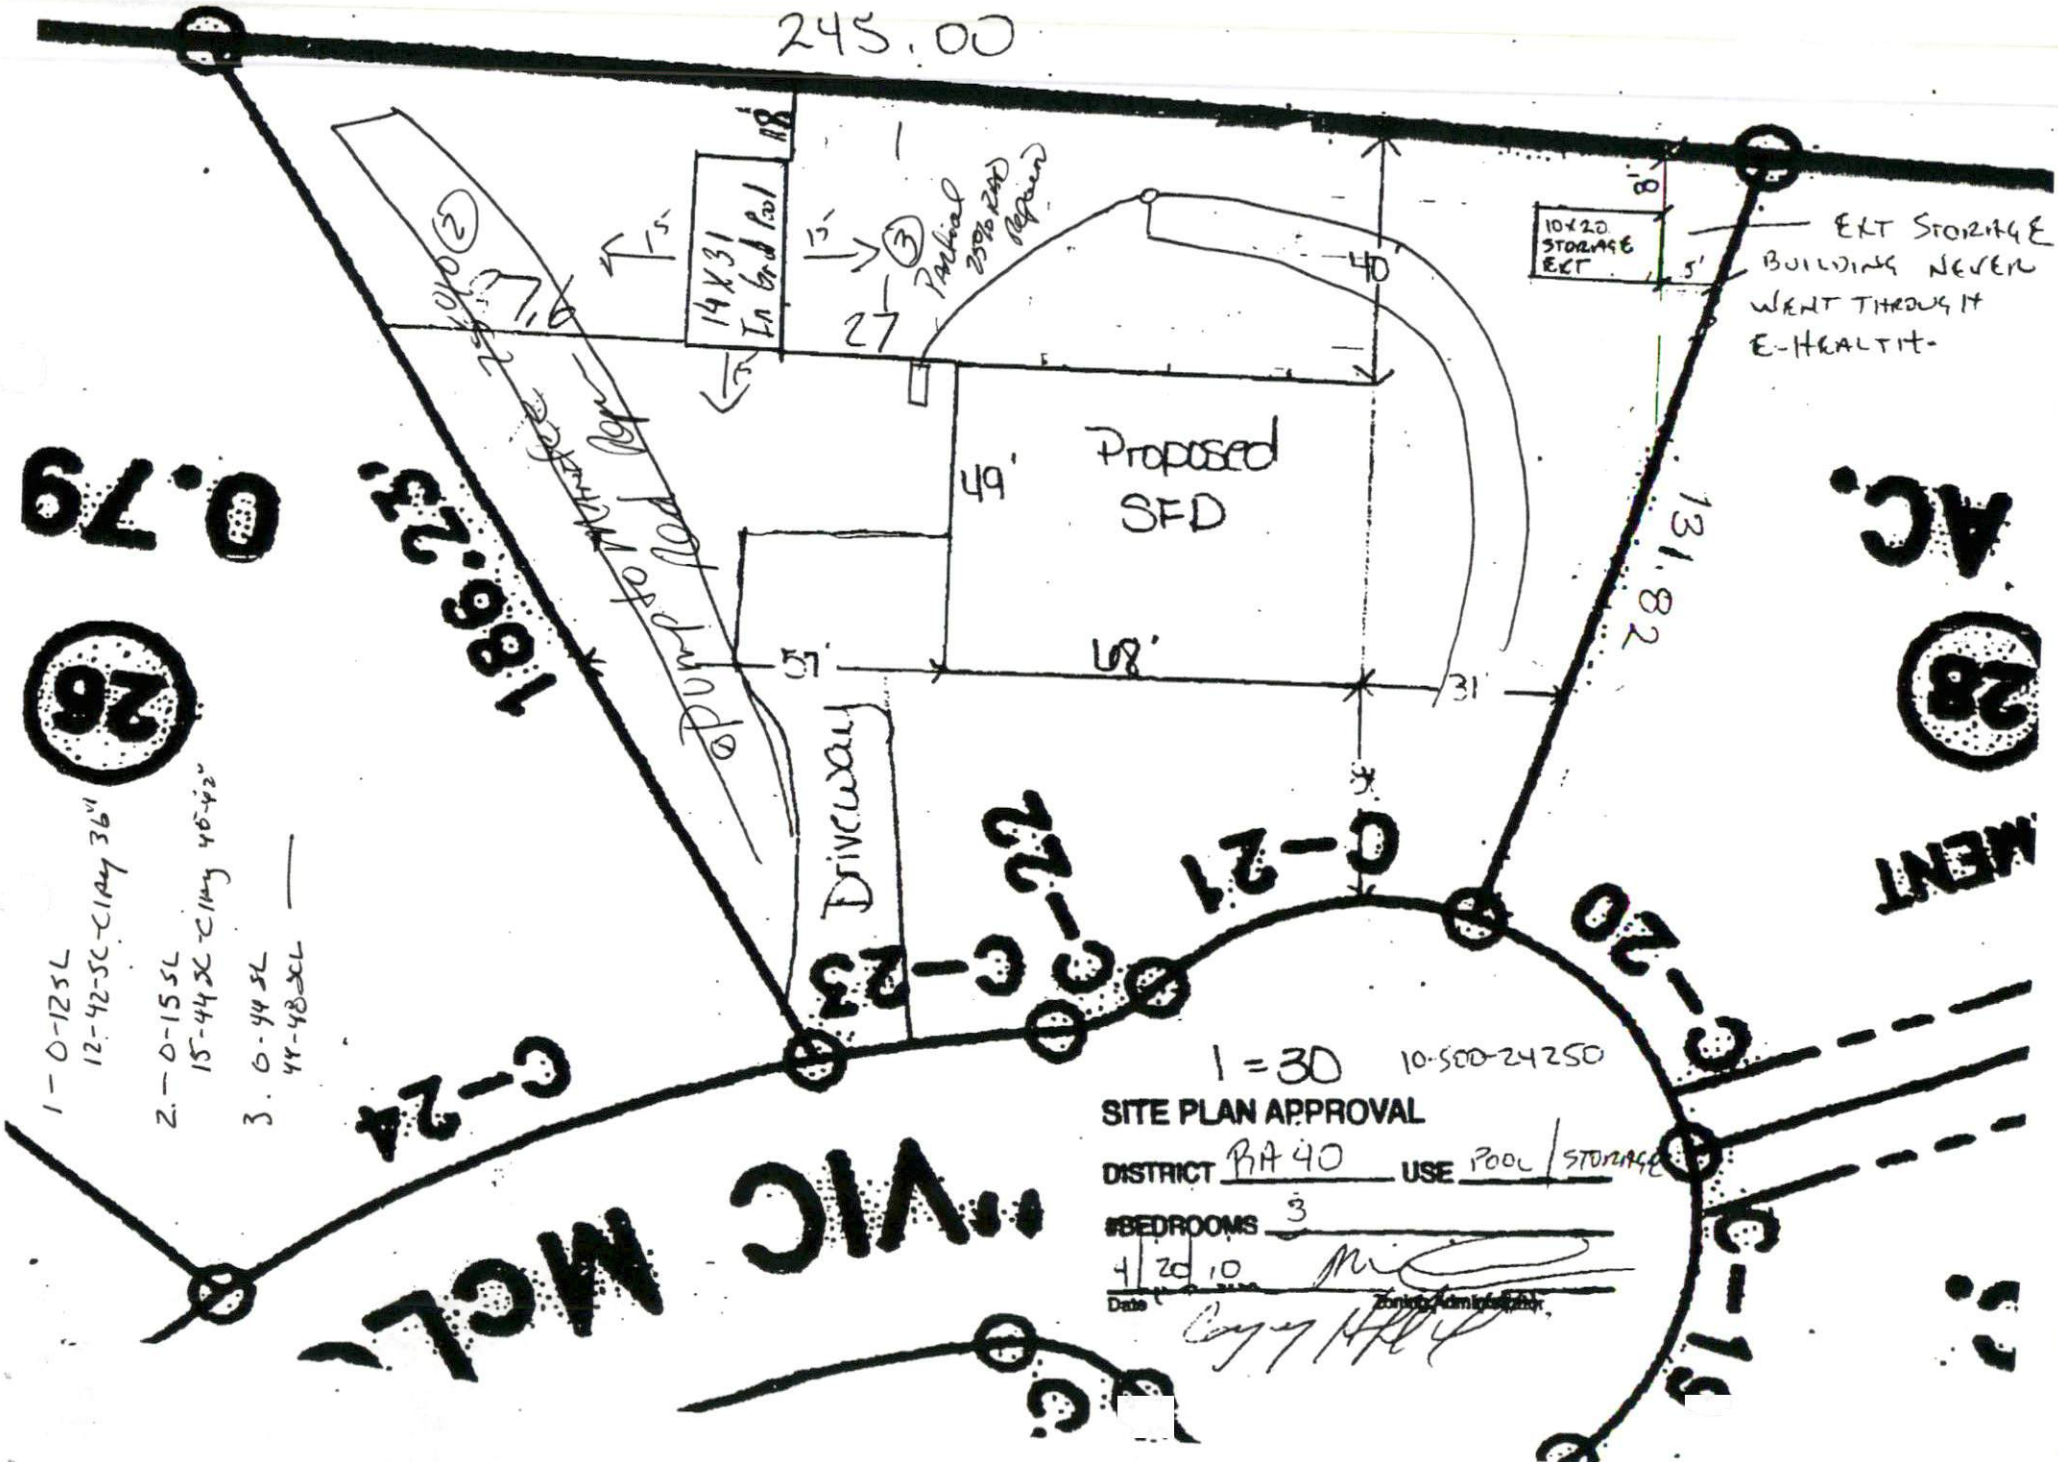

- 1- 0-125L
- 12- 42-5C - Clay 36"
- 2- 0-155L
- 15- 44-2C - Clay 40-42"
- 3- 0-445L
- 44- 48-3CL

MIC MCL

AC. 28 MENT

1 = 30 10-500-24250
 SITE PLAN APPROVAL
 DISTRICT RA 40 USE POOL / STORAGE
 #BEDROOMS 3
 Date 4/20/10
 [Signature]
 Zoning Administrator

ERT STORAGE BUILDING NEVER WENT THROUGH IT E-HEALTHIT.