

HTE 05-5-12670

IMPROVEMENT PERMIT

22185

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) HAMILTON BUILDERS New Installation Septic Tank
Property Location: SR# 1435 Trepp RD Repairs Nitrification Line

Subdivision PLANTATION AT VINEYARD GREEN Lot # 37

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 3606 sq ft Lot Size: .76

Basement with Plumbing: Garage:
Water Supply: Well Public Community
Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to 25% Reduction System "MANAGE"

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of exact length width of depth of
ditches 3 of each ditch 100 ft. ditches 3 ft. ditches 24x18 in.

French Drain Required: - Linear feet


Date: 8-11-05

This permit is subject to revocation if site plans or intended use change.

Signed: James E. Manhart
Environmental Health Specialist

* Contractor to meet ONSITE Prior to Installation!

- * PUMP
23gpm @ 15' TDH
- * MANAGE
3 1/2" SCH 40 VALVES
2' PRESSURE HEAD
2" SCH 40 PIPE

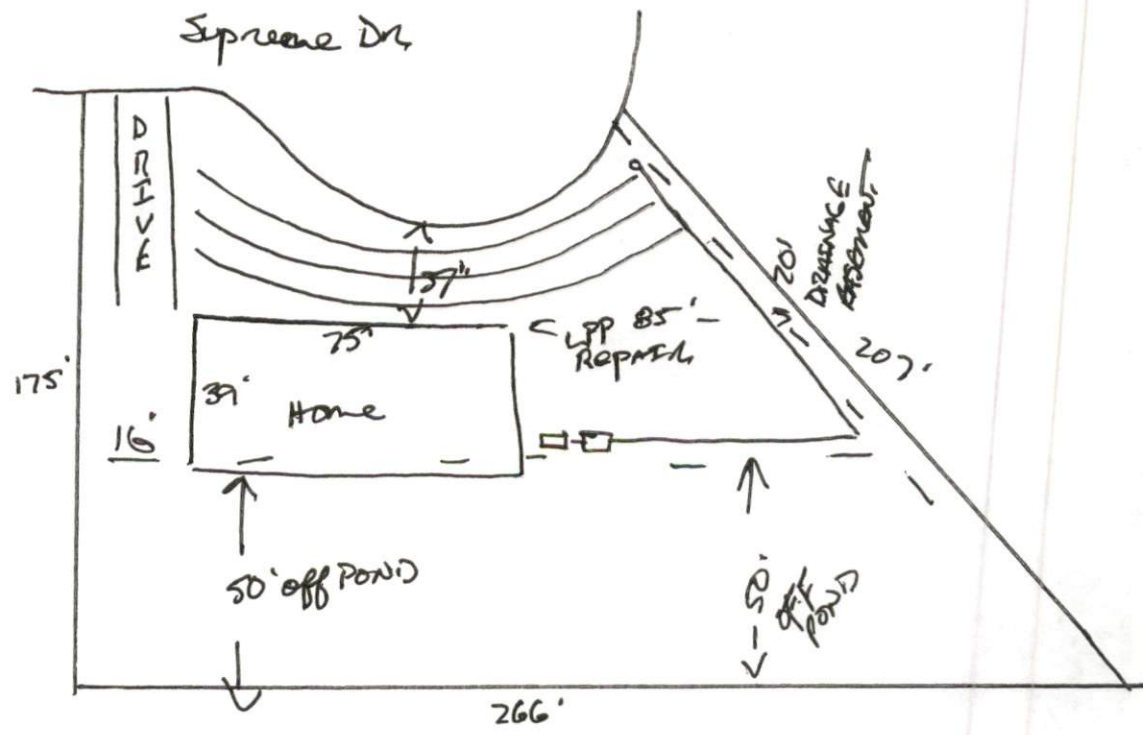

#05-5-12670

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22185. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Hamilton Builders Telephone # 893-8427

Address 286 E PINE ST LELINGTON N.C. 27546

Property Location SR# 1435 Road Name Tripp RD

Subdivision Plantation Lot # 37 # Bedrooms Proposed 3 ³⁶⁰ _{OPD} Lot Size .76

TYPE OF SYSTEM

- New Installation Repair Septic Tank Nitrification Lines
- Conventional Other Pump to 2590 Reduction System MANHOLE
- Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber 1000 gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 3 Length of lines 100 Ft.
 Width of ditches 3 ft. Depth of ditches 24-18 inches
 French Drain: Linear feet required - Depth of gravel -

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Markson
Signature of Authorized Agent for Harnett County

8-11-05
Date