

HTE# 05-5-13048

13049

# IMPROVEMENT PERMIT 22770

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) DONALD + KAREN STEPHENSON New Installation  Septic Tank  Repair

Property Location: SR# 1412 Christian Light Nitrification Line  Expansion

Subdivision \_\_\_\_\_ Lot # \_\_\_\_\_

Tax ID# \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 4 4806PD Lot Size: 11.48 acres

Basement with Plumbing:  Garage:

Water Supply:  Well  Public  Community

Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other 25% Reduction System

Size of tank: Septic Tank: 1200 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of 2 exact length 180 width of \_\_\_\_\_ depth of \_\_\_\_\_  
Drainage Field ditches 3 ft. of each ditch 120 ft. ditches 3 ft. ditches 24" max in.

French Drain Required: - Linear feet

Date: 10-18-05

PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

Signed: James E. Markant  
Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.


Two types of layout

#1 2-180' LINES JUST CONNECTED TO HOME

#2 3-120' LINES CONNECTED TO HOME + BARN

FOR BATHROOM + SINK ONLY IN BARN. 130'

#3 Contractor to MEET ON SITE PRIOR TO INSTALLATION.

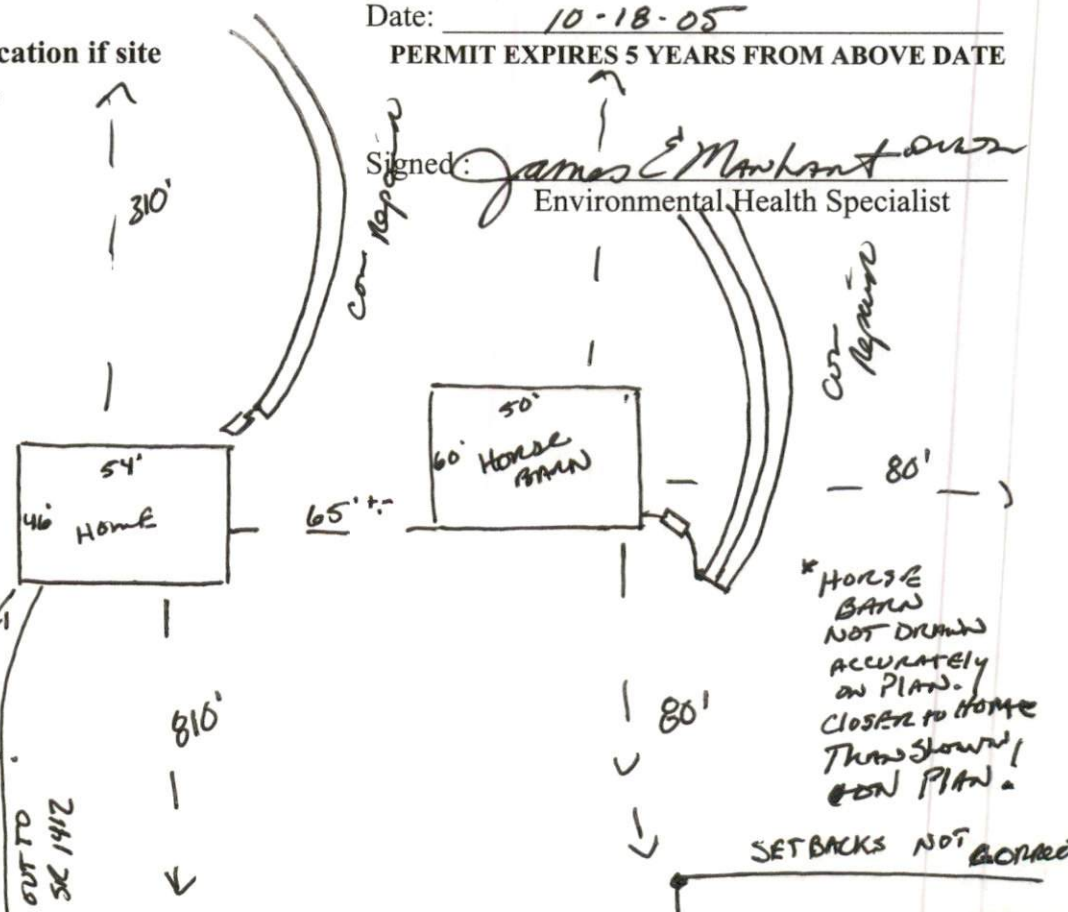

\* HORSE BARN NOT DRAWN ACCURATELY ON PLAN. CLOSER TO HOME THAN SHOWN ON PLAN.

SETBACKS NOT CORRECT

05-5-13048  
13049

# HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22770. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

DONALD + KAREN STEPHENSON 919-639-4660  
Name Telephone #

2112 Saddle tree CANYE W:1100 Spring N.C. 27552  
Address

1412 Christina Light  
Property Location SR# Road Name

48060 11 acres  
Subdivision Lot # # Bedrooms Proposed Lot Size

### TYPE OF SYSTEM

New Installation  Repair  Septic Tank  Nitrification Lines

Conventional  Other 25% red spot

Basement  With Plumbing  Without Plumbing

Water Supply:  Well  Public Water Supply Minimum Well Setback: \_\_\_\_\_ Ft.

Septic Tank 1200 gal Pump Chamber \_\_\_\_\_ gal

### NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 3 Length of lines 120 Ft.  
2 180

Width of ditches 3 ft. Depth of ditches 24 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Merchant 10-18-05  
Signature of Authorized Agent for Harnett County Date