

HTE# 0550013203

IMPROVEMENT PERMIT 22230

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) JOSEPH BRETT ALLEN New Installation Septic Tank Repair

Property Location: SR# 1131 AUTRY RD Nitrification Line Expansion

Subdivision _____ Lot # _____

Tax ID# _____ Quadrant # _____

Number of Bedrooms Proposed : 4 (480 gpd) Lot Size: 2.07 ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 100 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 4 ft. exact length of each ditch 90 ft. width of ditches 3 ft. depth of ditches SEE NOTE in.


French Drain Required: _____ Linear feet

Date: 10/20/05
PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature] RS (OLIVER TOLKSOORF)
Environmental Health Specialist

- * START BOTTOM LINE @ 30" RUN TO 22"
- START TOP LINE @ 35" RUN TO 27"
- 232'
- * SET TANK SHALLOW TO AVOID NEEDING A PUMP
- * CALL WITH ANY QUESTIONS PRIOR TO INSTALLATION

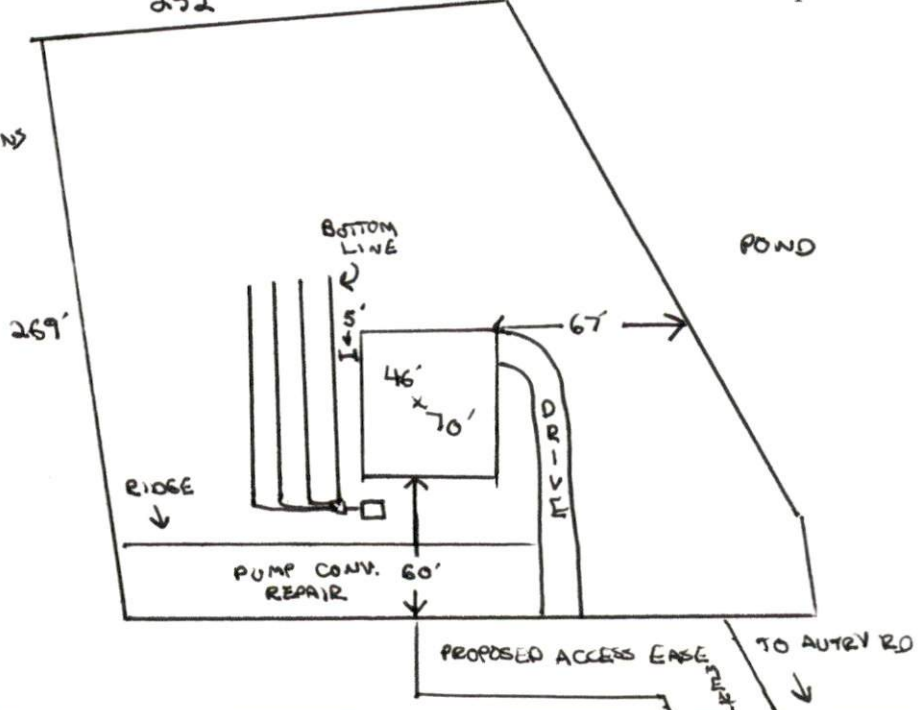

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22230. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

JOSEPH BRETT ALLEN

Name

Telephone #

Address

1131

Property Location SR#

AUTRY RD

Road Name

Subdivision

Lot #

4 (480 gal)

Bedrooms Proposed

2.07AC

Lot Size

TYPE OF SYSTEM

New Installation [] Repair Septic Tank Nitrification Lines

Conventional [] Other _____

[] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well Public Water Supply Minimum Well Setback: 100 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 90 Ft.

Width of ditches 3 ft. Depth of ditches 35-22 inches ^{* SEE IP}

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature]
Signature of Authorized Agent for Harnett County

10/20/05

Date