

HTE# 05-5001339Y

HARNETT COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT 22413

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Danny Morris (Silverado Homes) New Installation Septic Tank Repair

Property Location: SR# 1108 Nitrification Line Expansion

Subdivision Yorkshire Plantation Lot # 37/38 Combined

Tax ID# _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (56x40) 360 sq ft Lot Size: 1.53 ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: 7000 gallons 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 3 exact length 100 width of ditches 3 depth of ditches 18 in.

French Drain Required: _____ Linear feet

Date: 12-5-05
PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]
224 Environmental Health Specialist

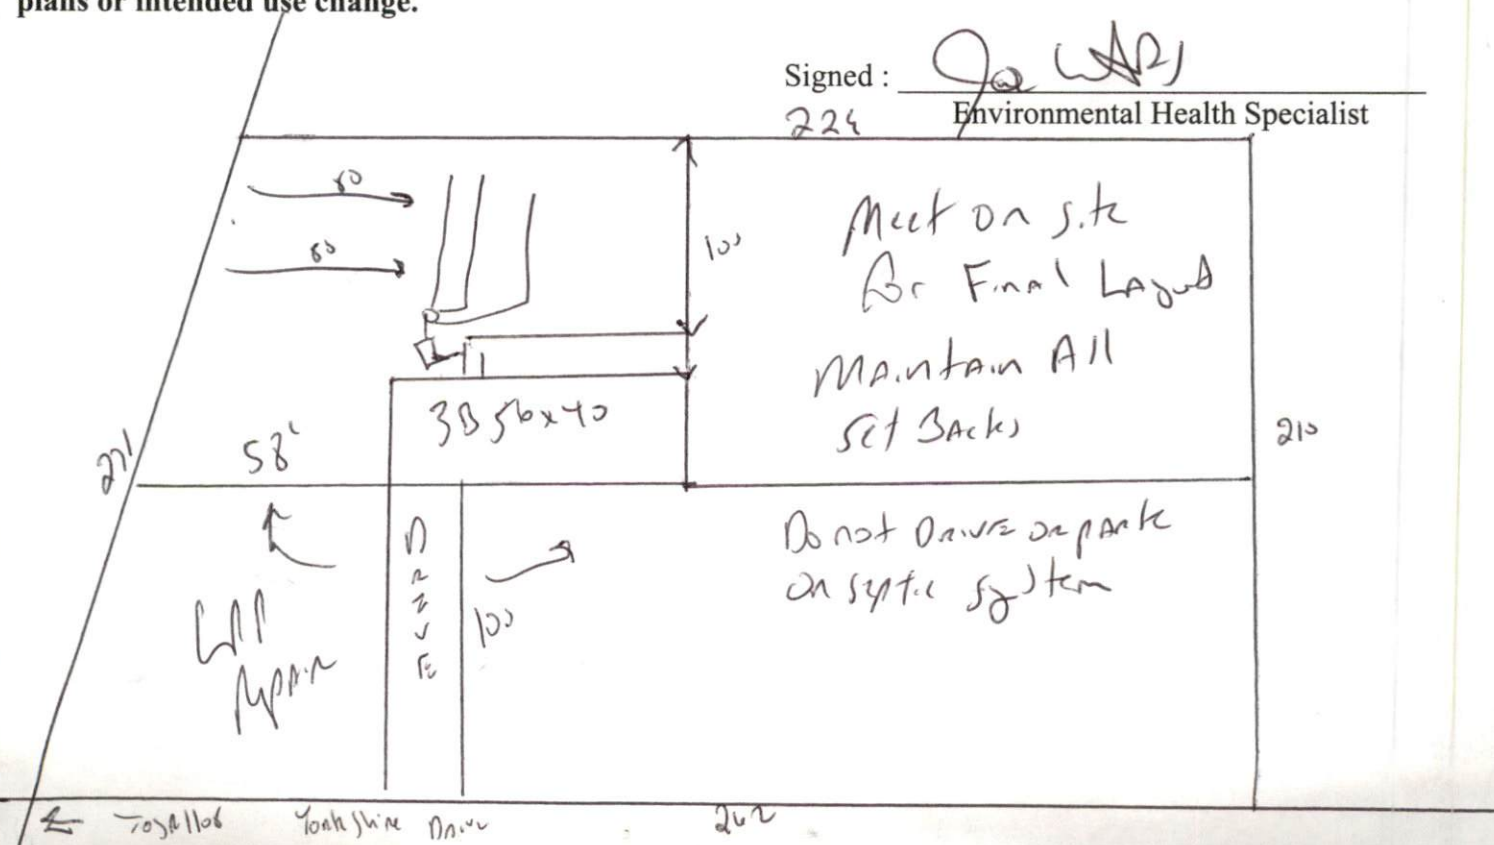

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22413. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Danny Norman Telephone # _____

Address _____

1106

Property Location SR# Yorkshire Plantation Lot # 37/38 Combined # Bedrooms Proposed 3(56x40) 360 rpl Road Name 1.53 ac
Subdivision _____ Lot # _____ # Bedrooms Proposed _____ Lot Size _____

TYPE OF SYSTEM

- New Installation [] Repair
- Septic Tank
- Nitrification Lines
- Conventional [] Other _____
- [] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 3 Length of lines 100 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County Jon West RS Date 12-5-05