

HTE# 05-5-1356212

## IMPROVEMENT PERMIT 22883

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Frederick Frys New Installation ☒ Septic Tank ☒ Repair ☐Property Location: SR# 1575 CAUTION BROWN RD Nitrification Line ☒ Expansion ☐

Subdivision \_\_\_\_\_ Lot # \_\_\_\_\_

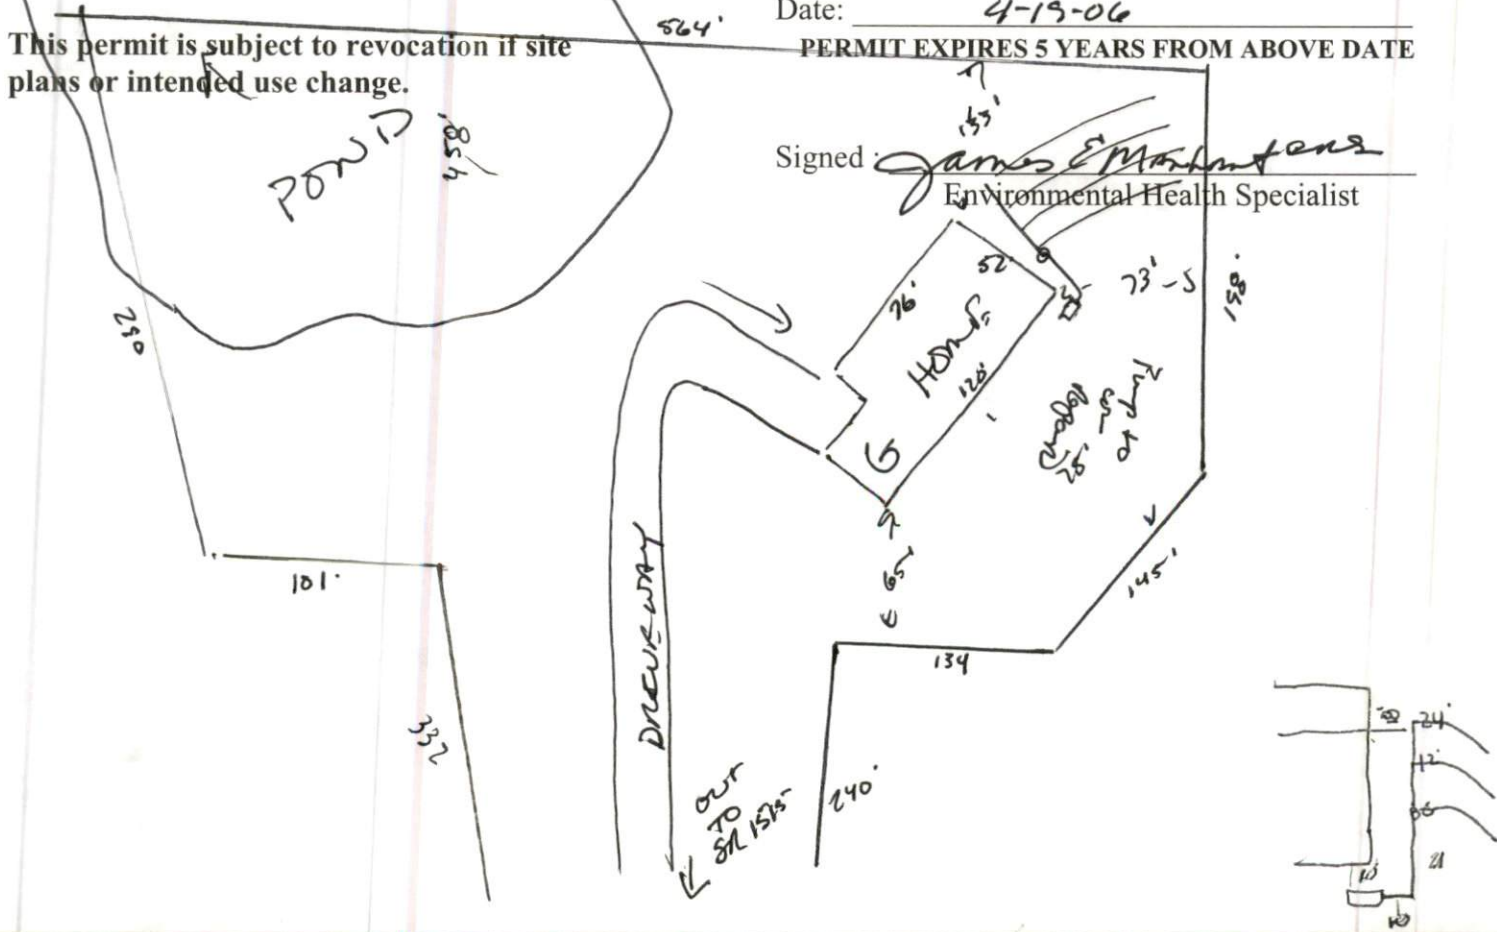
Tax ID# \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 or 3000 Lot Size: 5.54 acresBasement with Plumbing: ☐ Garage: ☒Water Supply: ☐ Well ☒ Public ☐ CommunityDistance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property.  
Subject to final approval.

Type of system: ☒ Conventional ☐ Other \_\_\_\_\_Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallonsSubsurface No. of exact length width of depth of  
Drainage Field ditches 4 ft. of each ditch 100 ft. ditches 3 ft. ditches 24 in.French Drain Required: - Linear feet

This permit is subject to revocation if site  
plans or intended use change.

Date: 4-19-06  
PERMIT EXPIRES 5 YEARS FROM ABOVE DATESigned: James E. Martin  
Environmental Health Specialist

## HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22883. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Frederick Frye Telephone # 893-8156

Address P.O. BOX 2556 Ellington N.C. 27546

Property Location SR# 1515 Road Name Chilton Brown

Subdivision 3BRN 3606PD Lot # 5154A  
# Bedrooms Proposed 5 Lot Size 5154A

### TYPE OF SYSTEM

☒ New Installation ☐ Repair ☒ Septic Tank ☒ Nitrification Lines

☒ Conventional ☐ Other \_\_\_\_\_

☐ Basement ☐ With Plumbing ☐ Without Plumbing

Water Supply: ☐ Well ☒ Public Water Supply Minimum Well Setback: \_\_\_\_\_ Ft.

Septic Tank 1000 gal Pump Chamber \_\_\_\_\_ gal

### NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 4 Length of lines 100 Ft.

Width of ditches 3 ft. Depth of ditches 24 inches

French Drain: Linear feet required — Depth of gravel —

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Markland  
Signature of Authorized Agent for Harnett County

4-19-06  
Date