

HTE# 05-5-13653R

# H...ett County Department of Pub... Health 18788

PERMIT # 23262

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

PROPERTY LOCATION: OVERHILLS RD

Name: (owner) CAVINESS LAND DEVELOPMENT SUBDIVISION STONECROSS LOT # 32

System Installer: O C CARTER Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well 100 feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

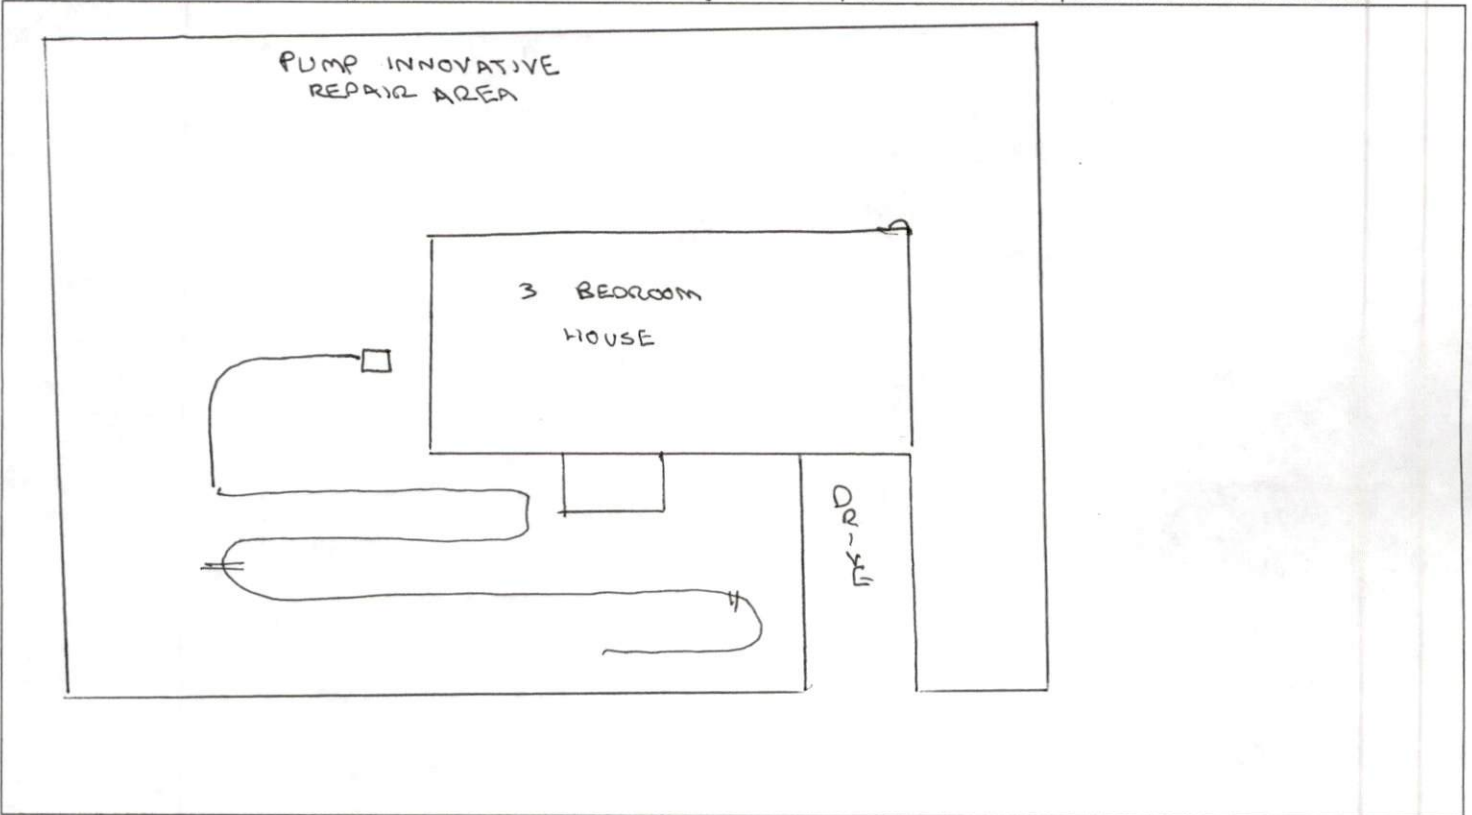

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other POLYSTYRENE AG. TRENCH Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of 1 exact length width of depth of  
Drainage Field ditches 1 of each ditch 150 feet ditches 3 feet ditches 18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 10/25/06

HTE # 05-5-13653R

H **WETT COUNTY HEALTH DEPARTMENT**  
**ENVIRONMENTAL HEALTH SECTION**

18720

# OPERATIONS PERMIT

Name: (owner) CANNISS LAND DEVELOPMENT  New Installation  Septic Tank  Repair

Property Location: SR# OVERHILLS RD  Nitrification Line  Expansion

Subdivision STONECROSS Lot # 32 Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Contractor: D. C. CARTER Registration # \_\_\_\_\_

Basement with Plumbing:  Garage:

Water Supply:  Well  Public  Community

Distance From Well: 100 ft.

**Following are the specifications for the sewage disposal system on above captioned property.**

Type of system:  Conventional  Other POLYSTYRENE ACC. TRENCH

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 150 ft. width of ditches 3 ft. depth of ditches 18 in. (NATURAL GRADE)

French Drain Required: \_\_\_\_\_ Linear feet Date: 9/21/06

PERMIT NO. 23262 Inspected by: [Signature] RS

