

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner:
 Address:
 Proposed Facility:
 Location of Site:
 Water Supply: Public Individual Well
 Evaluation Method: Auger Boring Pit
 Type of Wastewater: Sewage Industrial Process

Applicant:
 Date Evaluated:
 Property Size:
 Property Recorded:
 Spring Other
 Cut
 Mixed

1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		OTHER PROFILE FACTORS				Profile Class & LTAR
		1941 Structure/ Texture	1941 Consistence Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	
	0-36"	G SL						PS .6
	36"	PM						
	0-33"	G SL						PS .6
	33"	PM						
	0-10"	G SL						PS -
	10"	PM						

Description	Initial System	Repair System
Available Space (.1945)	✓	✓
System Type(s)	INNOV	INNOV
Site LTAR	.6	.6

Other Factors (.1946): _____
 Site Classification (.1948): PS
 Evaluated By: OT
 Others Present: DM

COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE S-SHOULDER SLOPE L-LINEAR SLOPE FS-FOOT SLOPE N-NOSE SLOPE H-HEAD SLOPE CC-CONCLAVE SLOPE CV-CONVEX SLOPE T-TERRACE FP-FLOOD PLAN	I	S-SAND LS-LOAMY SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE	NS-NON-STICKY SS-SLIGHTLY STICKY
	II	SL-SANDY LOAM L-LOAM	0.8 - 0.6	FI-FIRM VFI-VERY FIRM	S-STICKY VS-VERY STICKY
	III	SI-SILT- SIL-SILT LOAM CL-CLAY LOAM SCL-SANDY CLAY LOAM SICL-SILTY CLAY LOAM	0.6 - 0.3	EFI-EXTREMELY FIRM	NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
	IV	SIC-SILTY CLAY C-CLAY SC-SANDY CLAY	0.4 - 0.1		


STRUCTURE

- SG-SINGLE GRAIN
- M-MASSIVE
- CR-CRUMB
- GR-GRANULAR
- SBK-SUBANGULAR BLOCKY
- ABK-ANGULAR BLOCKY
- PL-PLATY
- PR-PRISMATIC

MINERALOGY

- SLIGHTLY EXPANSIVE
- EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

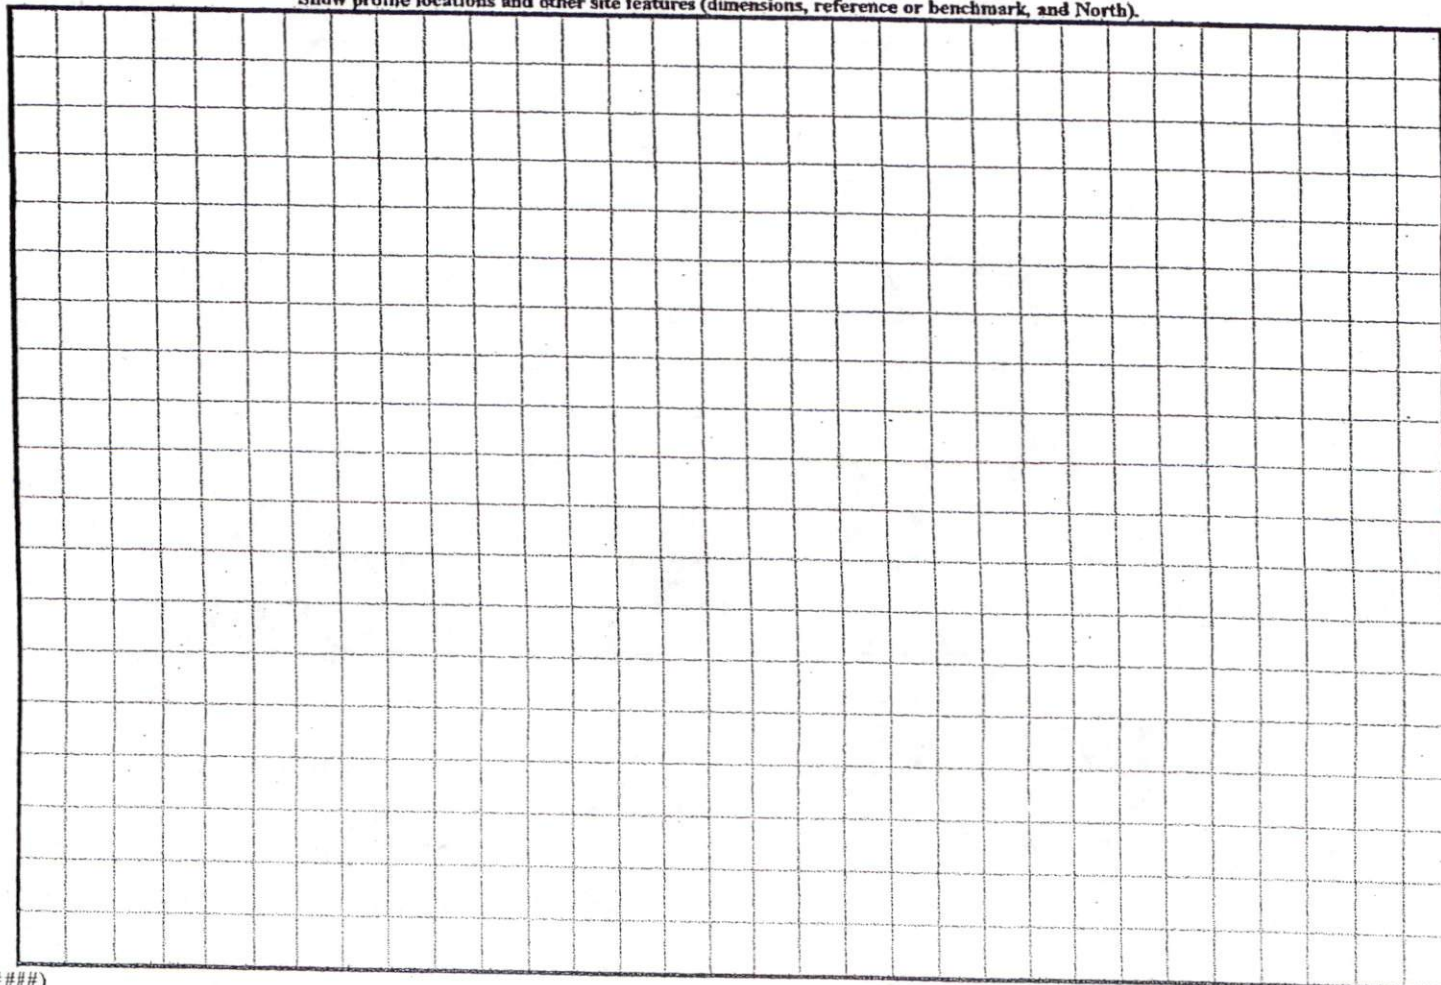

1=20

SITE PLAN APPROVAL

DISTRICT KAZOR USE SFD

#BEDROOMS 3

12/7/05

AR

Date

Zoning Administrator

31

N 50°35'07"W 115.64'

N 38°14'14"E 128.72'

PUMP
INNOV.

25'

20.00'

PROPOSED DECK
5.00'

8.00'

28.02'

2.17'

14.98'

10.00'

11.50'

10.00'

11.50'

13.48'

PROPOSED HOUSE LOCATION

4.00'

2.99'

9.00'

6.00'

6.00'

6.00'

7.71'

13.71'

11.50'

6.00'

17.71'

23.71'

35.7'

11.50'

26.00'

35'

32

0.35 AC.

LINE INNOV REPAIR

PROPOSED DRIVE

35.5'

S 50°35'05"E 118.28'

S 39°24'45"W 128.69'

Cobblestone Drive