

HTE# 06-50014134R

Harnett County Department of Public Health 19018

PERMIT # 23075

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 1701

Name: (owner) Michael Phillips

SUBDIVISION CAROLINA SEASONS

LOT # H-9

System Installer: Johnny Faircloth

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 50 feet

System Type: Pump to E-2 Flow TIP Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

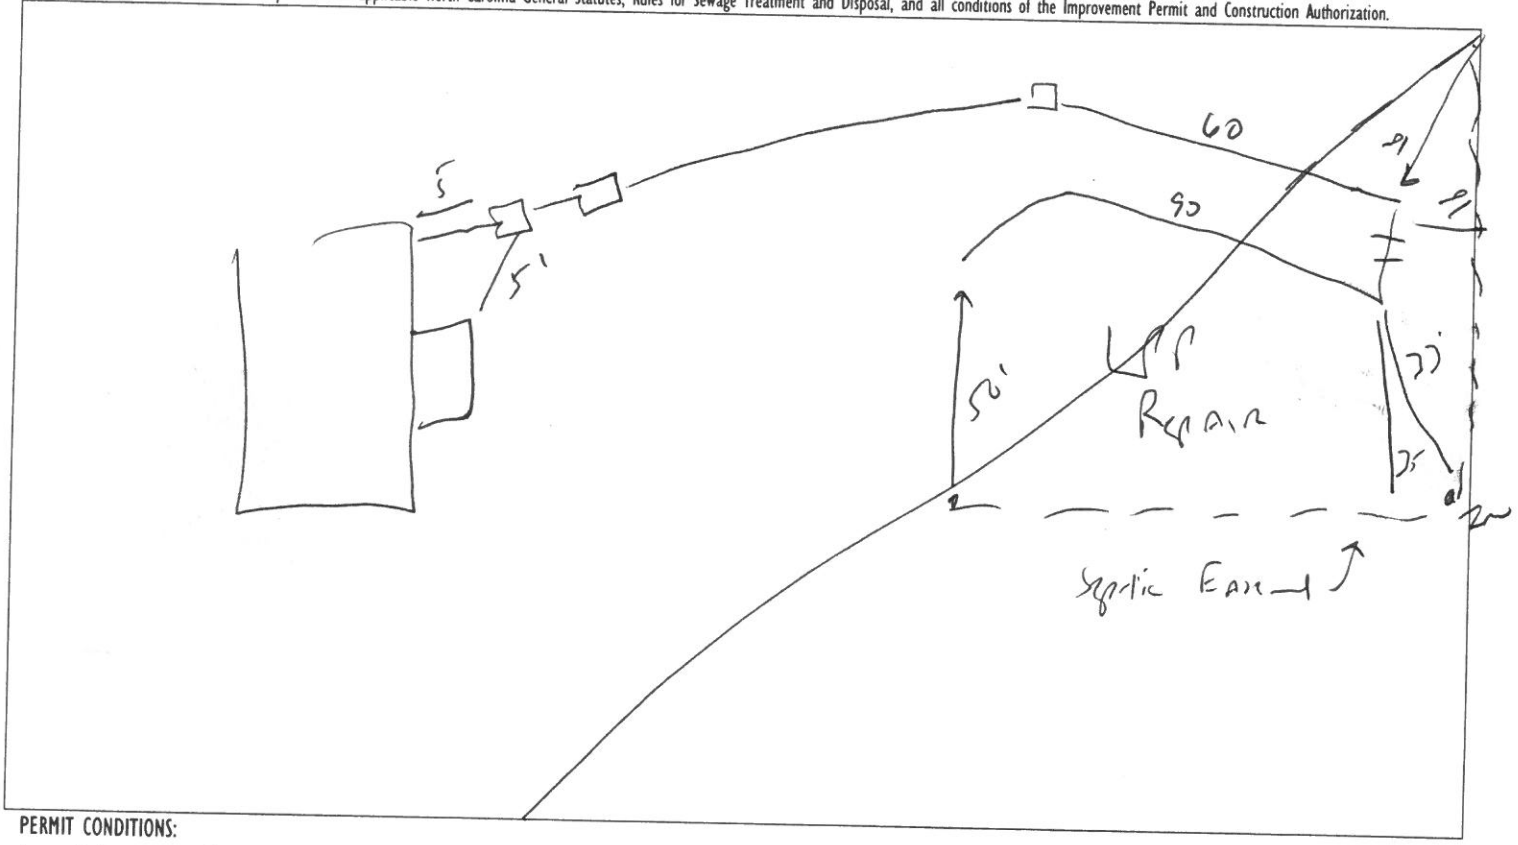

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to E-2 Flow Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface Drainage Field No. of ditches 1 exact length of each ditch 150 feet width of ditches 3 feet depth of ditches _____ inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 2-12-07