HTE #. 06-500-14240

HA ETT COUNTY HEALTH DEPAR ENT
ENVIRONMENTAL HEALTH SECTION

18070

OPERATIONS PERMIT

Name: (owner) Danny Norris ☒ New Installation ☒ Septic Tank ☐ Repair

Property Location: SR# 1201 ☒ Nitrification Line ☐ Expansion

Subdivision Carolina Estates Lot # C-4 Tax ID # _____ Quadrant # _____

Contractor: Ted Brown Registration # _____

Basement with Plumbing: ☐ Garage: ☒ Lines OK, Tanks OK, Pump OK 6-15-06 JW

Water Supply: ☐ Well ☒ Public ☐ Community

Distance From Well: 50 ft. Needs Alarm & Alarm Box checked

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: ☐ Conventional ☒ Other Pump to 25% Reduction System Infiltration check Y

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field	No. of ditches 1	exact length of each ditch 200 ft. 4 Chamber	width of ditches 3 ft.	depth of ditches 18-24 in.

French Drain Required: _____ Linear feet Date: 08-24-06

PERMIT NO. 22544 Inspected by: J. Lee
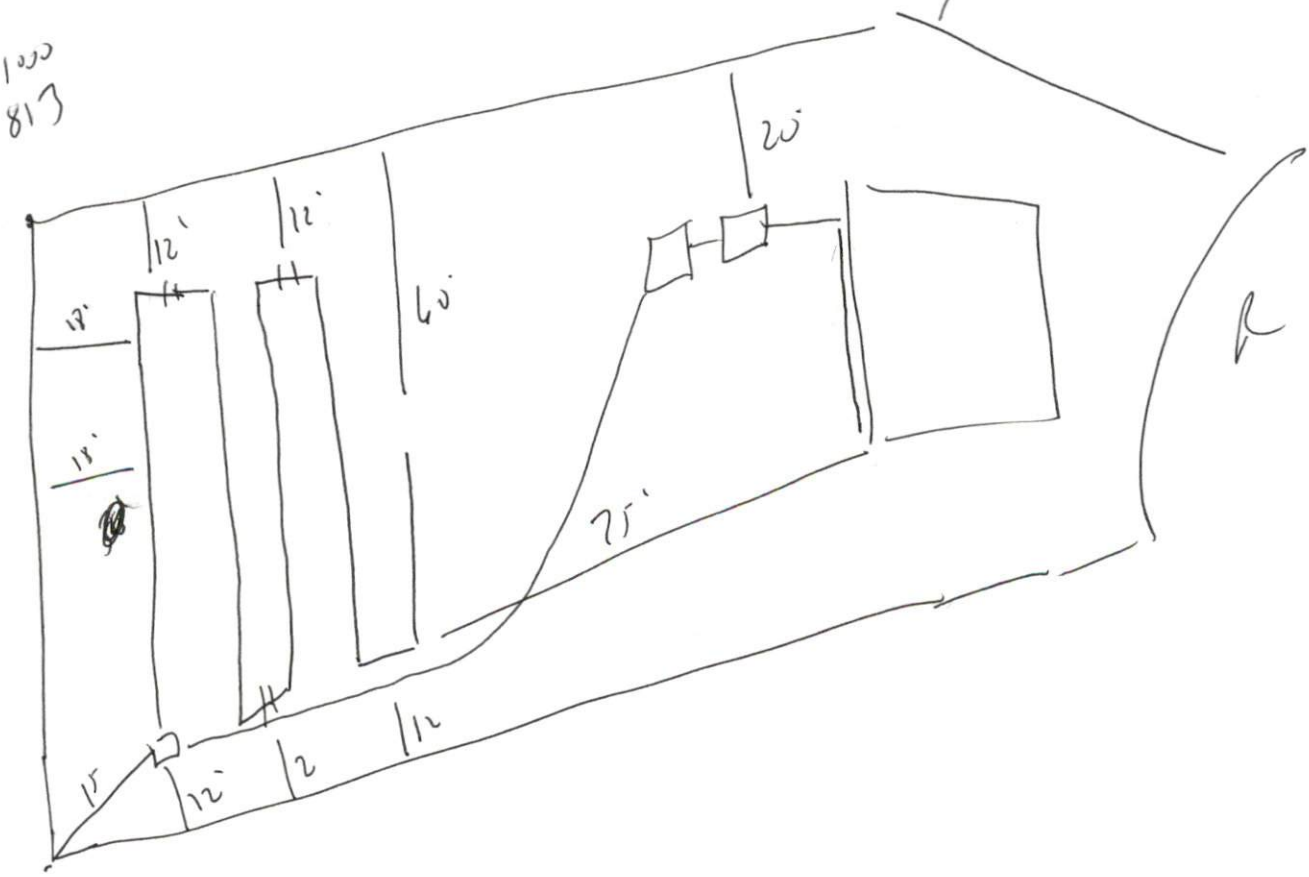
MCP 1000
JTB 813