

HARNETT COUNTY HEALTH DEPARTMENT

HTE# 06-5-14375

IMPROVEMENT PERMIT 22875

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Brian Johnson Builders New Installation Septic Tank Repair
Property Location: SR# 1429 Chalybeate RD Nitrification Line Expansion
Subdivision DEXTERFIELD Lot # 65
Tax ID# _____ Quadrant # _____
Number of Bedrooms Proposed: 3 BR 360 GPD Lot Size: .401

Basement with Plumbing: Garage:
Water Supply: Well Public Community
Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property.
Subject to final approval.

Type of system: Conventional Other 25% Reduction Syst

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 2 ft. of each ditch 120 ft. ditches 3 ft. ditches 30-318 in.


French Drain Required: - Linear feet

Date: 4-5-06

This permit is subject to revocation if site plans or intended use change.

PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

Signed: James E. Mankant
Environmental Health Specialist

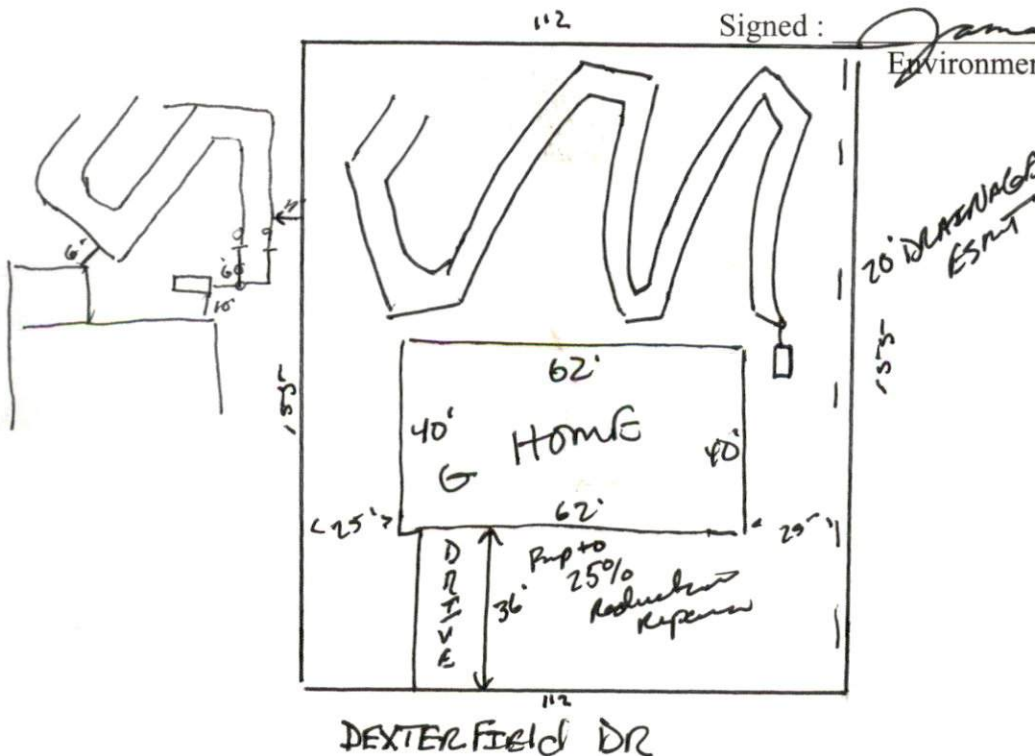

DEXTERFIELD DR

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 02875. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Brian Johnson Builders 639-3714
Name Telephone #

635 Chiswell RD Angier N.C. 27501
Address

1429 Chalybeate
Property Location SR# Road Name

DEXTERFIELD 65 3BR-360LPD .401
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other 25% Reduction Syst

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 2 Length of lines 120 Ft.

Width of ditches 3 ft. Depth of ditches 30-218 inches

French Drain: Linear feet required - Depth of gravel -

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Manhart
Signature of Authorized Agent for Harnett County

4-5-06
Date