

HTE# 06-S-15051

Halifax County Department of Public Health 18776

PERMIT # 22997

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: CAMERON HILL RD

Name: (owner) CUMBERLAND HOMES SUBDIVISION YORKSHIRE PLANTATION LOT # 182

System Installer: TED BROWN Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

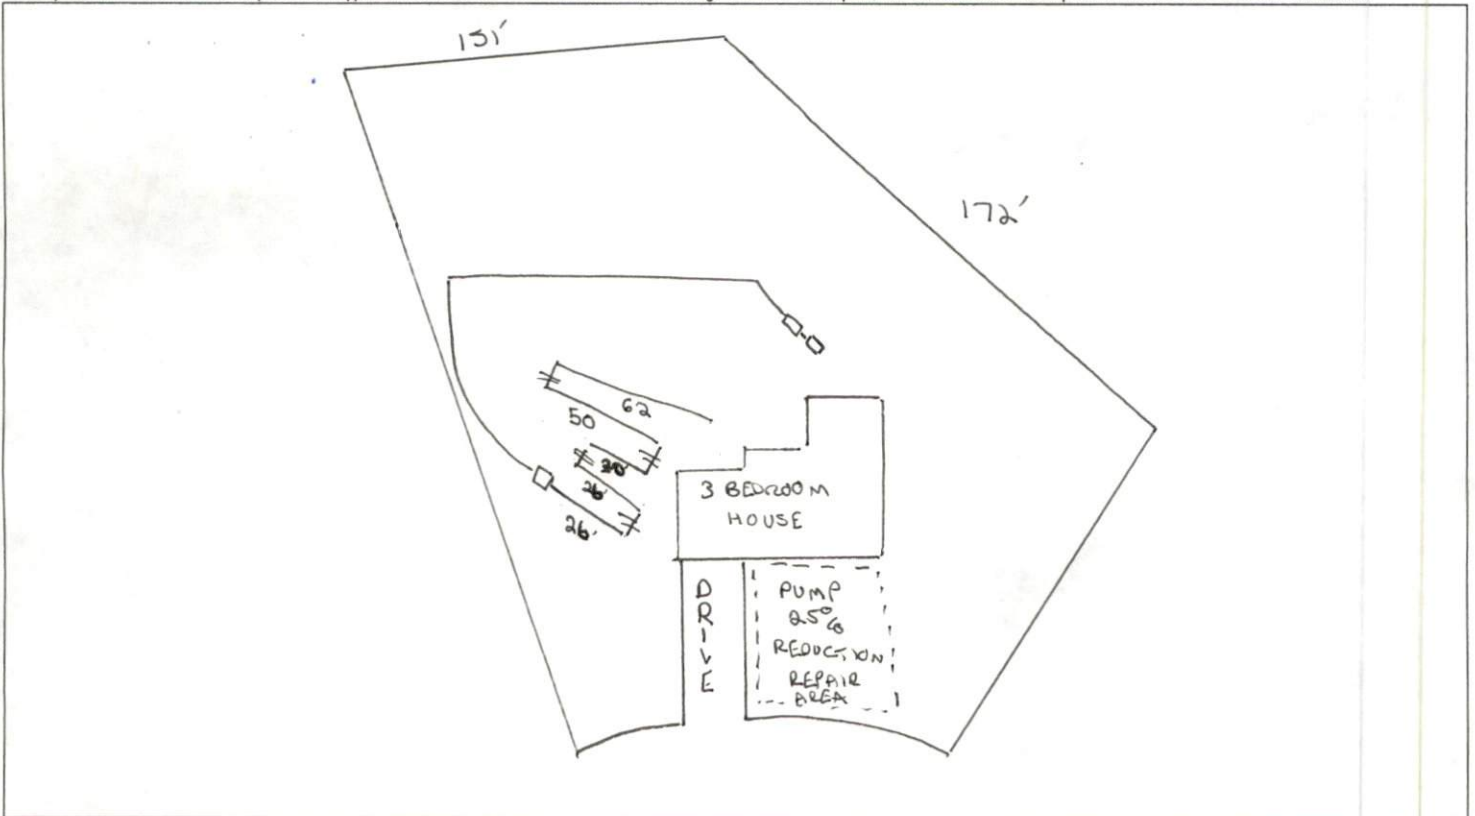

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: LINES & TANKS CHECKED ON 9/22/06. PUMP & ALARM STILL TO BE CHECKED

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other QUICKY CHAMBER Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 200 feet ditches 3 feet ditches 12 inches
 French Drain Required: _____ Linear feet

Authorized State Agent Guthrie Pierce for [Signature] Date 10-3-06

pump & alarm checked by ↑↑