

HTE# 06-50015125

# IMPROVEMENT PERMIT 23086

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Danny Norris (Harc) New Installation  Septic Tank  Repair

Property Location: SR# 1108 Nitrification Line  Expansion

Subdivision Yorkshire Plantation Lot # 166

Tax ID# \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 (56x36) 360 sq ft Lot Size: .55 AC

Basement with Plumbing:  Garage:

Water Supply:  Well  Public  Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other Pump to 25% Reduction SYSTEM

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field No. of ditches 1 ft. exact length of each ditch 150 ft. width of ditches 3 ft. depth of ditches 18.24 in.


French Drain Required: \_\_\_\_\_ Linear feet of 25% Reduction System

Date: 07-07-06

This permit is subject to revocation if site plans or intended use change.

PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

Signed: [Signature]  
195' Environmental Health Specialist

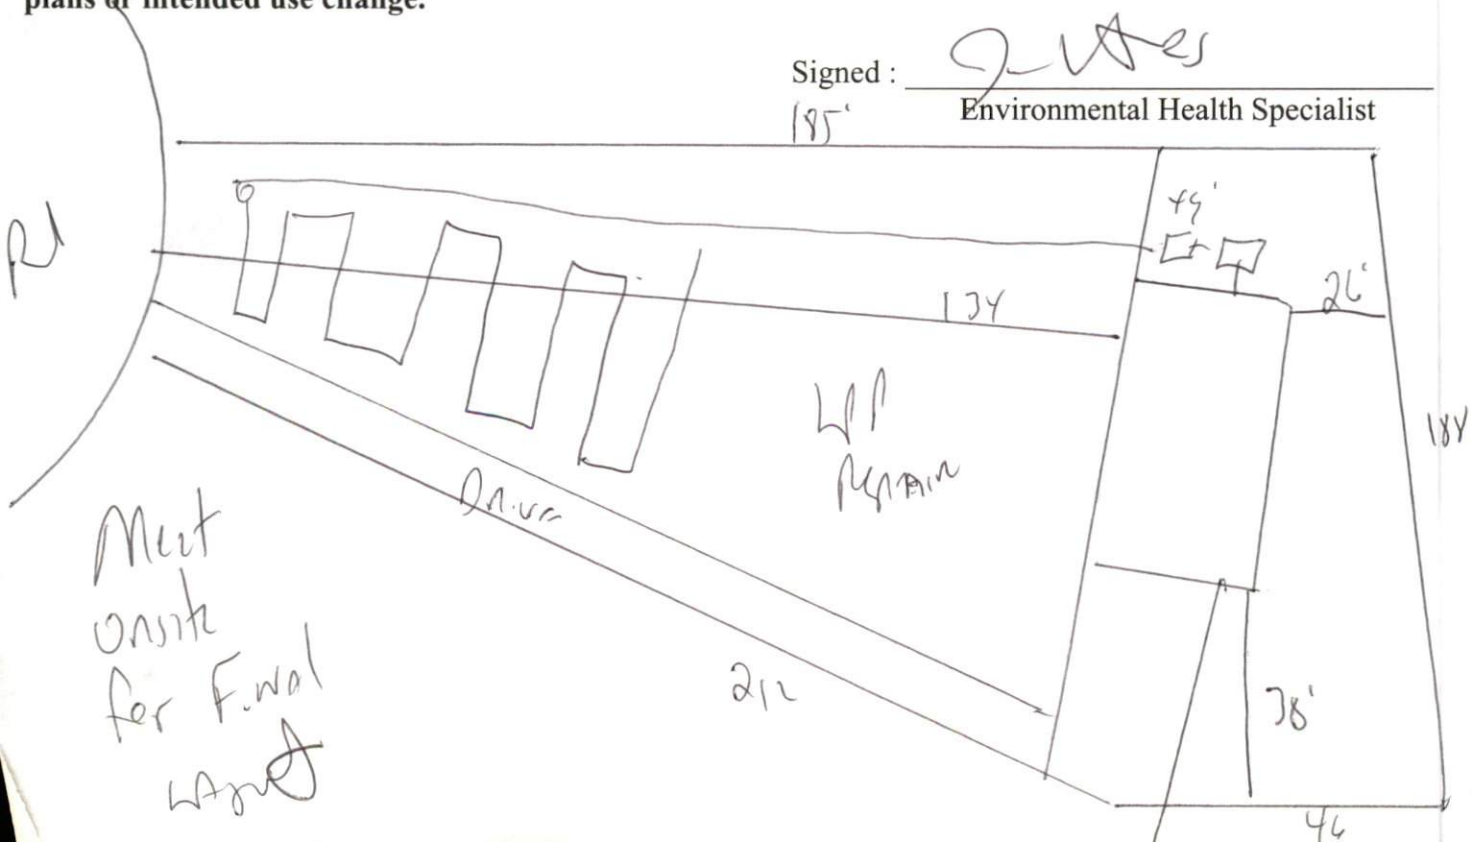

# HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 23086. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance.

***This authorization will be invalid if ownership, site plans, or intended use change.***

Name Danny Morris Telephone # \_\_\_\_\_

Address \_\_\_\_\_

1108  
Property Location SR# \_\_\_\_\_ Road Name \_\_\_\_\_

Yorkshire Plantation 166 3(56x76) 260 gpl .55 Ac  
Subdivision Lot # # Bedrooms Proposed Lot Size

### TYPE OF SYSTEM

- New Installation    Repair    Septic Tank    Nitrification Lines  
 Conventional    Other Pump to 25% Reduction SYSTEM  
 Basement    With Plumbing    Without Plumbing

Water Supply:  Well    Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal   Pump Chamber 1000 gal

### NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 150 Ft.  
 Width of ditches 3 ft. Depth of ditches 18.24 inches   **25% Reduction SYSTEM**  
 French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County [Signature] Date 07-29-06