

HTE# 06-50015197

Hammett County Department of Public Health

19014

PERMIT # 23078

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: (421 Bishop's Mill Lane)

Name: (owner) Charles Stewart Kelly Kelly SUBDIVISION _____ LOT # _____

System Installer: D. J. Rickland Registration # _____


Basement with plumbing: Garage Number of Bedrooms 3 10.00 Ac

Type of Water Supply: Community Public Well Distance from well 50' feet

System Type: GRAVEL Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

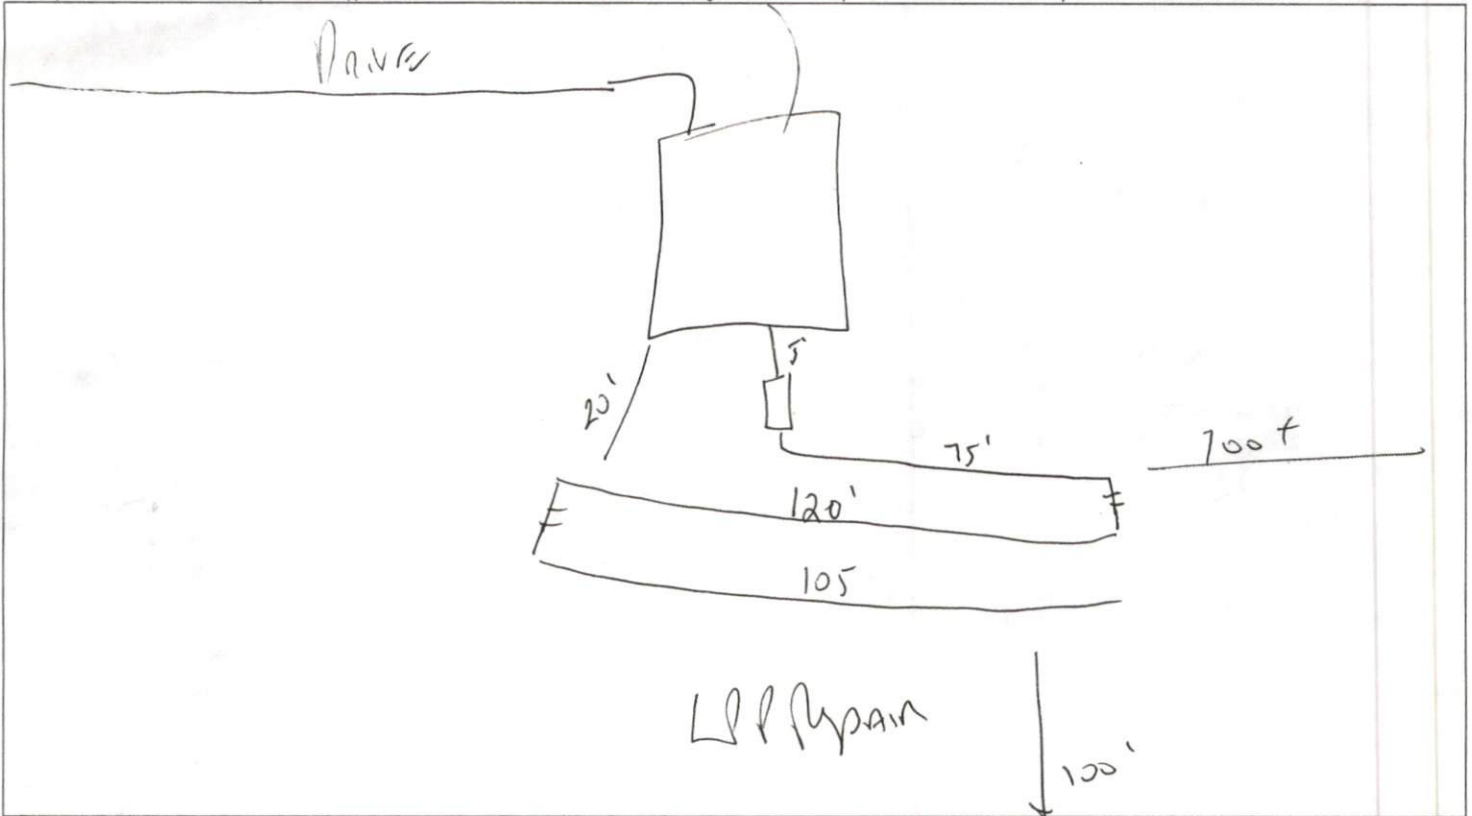

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of 1 exact length _____ width of 3 depth of 18"
 Drainage Field ditches _____ of each ditch 300 feet ditches _____ feet ditches _____ inches
 French Drain Required: _____ Linear feet

Authorized State Agent Jo W. Adams Date 02-05-07