

HTE# 06-500 15395

Harnett County Department of Public Health 18822

PERMIT # 23047

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 1108

Name: (owner) Danny Norris

SUBDIVISION Yorkshire Plantation LOT # 171

System Installer: Ted Brown Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 50 feet


System Type: 25% Reduction System - Infiltrator Quick 4 Types V and VI Systems expire in 5 years.

(In accordance with Table V a) spec III 8 Owner must contact Health Department 6 months prior to expiration for permit renewal.

Gloucester

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

Yorkshire Dr.

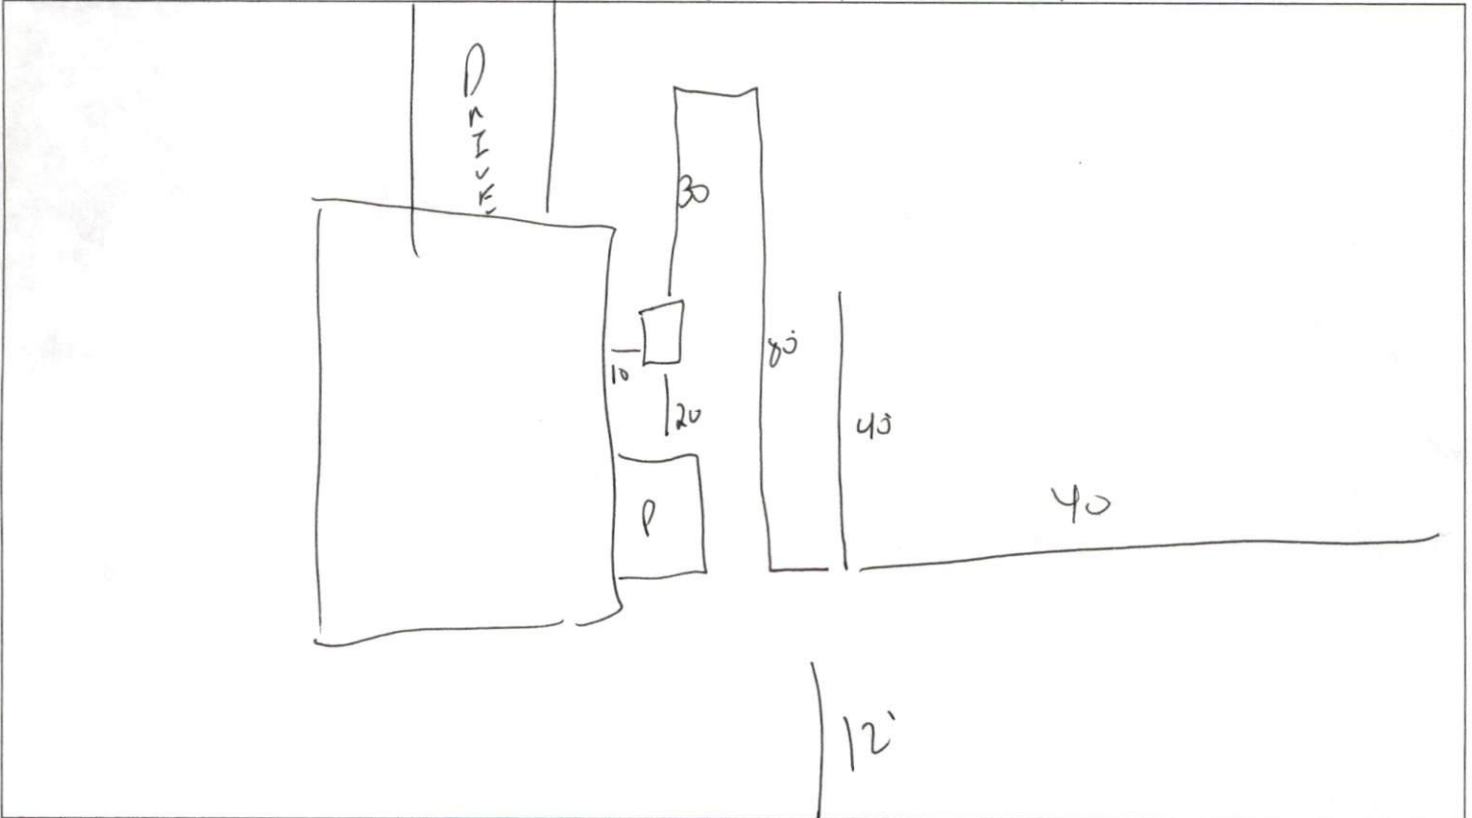

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Reduction system Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 150 feet ditches 3 feet ditches 18-24 inches
 French Drain Required: _____ Linear feet of Infiltrator Quick 4 Chamber

Authorized State Agent [Signature] Date 10-24-06