

HTE# 06-5-15461

Harnett County Department of Public Health 19100

PERMIT # 03125

Operation Permit

- New Installation
 Septic Tank
 Repair
 Nitrification Line
 Expansion

PROPERTY LOCATION: SR-1566 Popas LAKE

Name: (owner) R.L. Properties

SUBDIVISION Popas LAKE

LOT # 12

System Installer: Wayne Edwards Plumbing Solutions Registration # _____

Basement with plumbing: Garage Number of Bedrooms 5


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Conventional Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

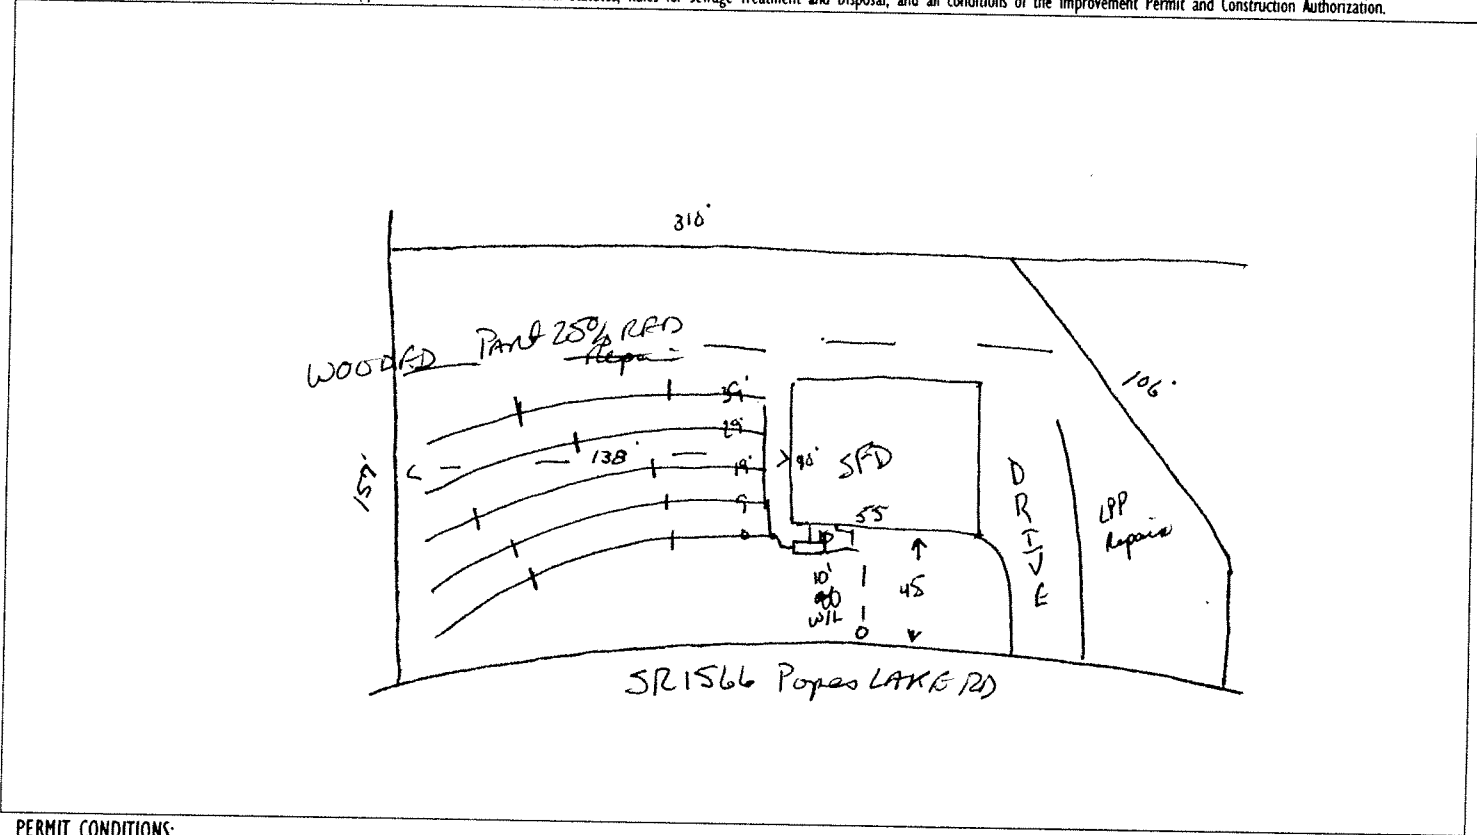

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Size of tank: Septic Tank: 1500 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 5 exact length of each ditch 115 feet width of ditches 3 feet depth of ditches 26" → 16" inches

French Drain Required: _____ Linear feet

Authorized State Agent Jama E. Manhart Date 3-7-07