

HTE# 06-500 15554

Harnett County Department of Public Health 18974

PERMIT # 23195

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 1237

Name: (owner) Joseph Brett Allen SUBDIVISION _____ LOT # _____

System Installer: Mike Ray Registration # _____


Basement with plumbing: Garage Number of Bedrooms 2

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Pumpt. Gravel HI B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

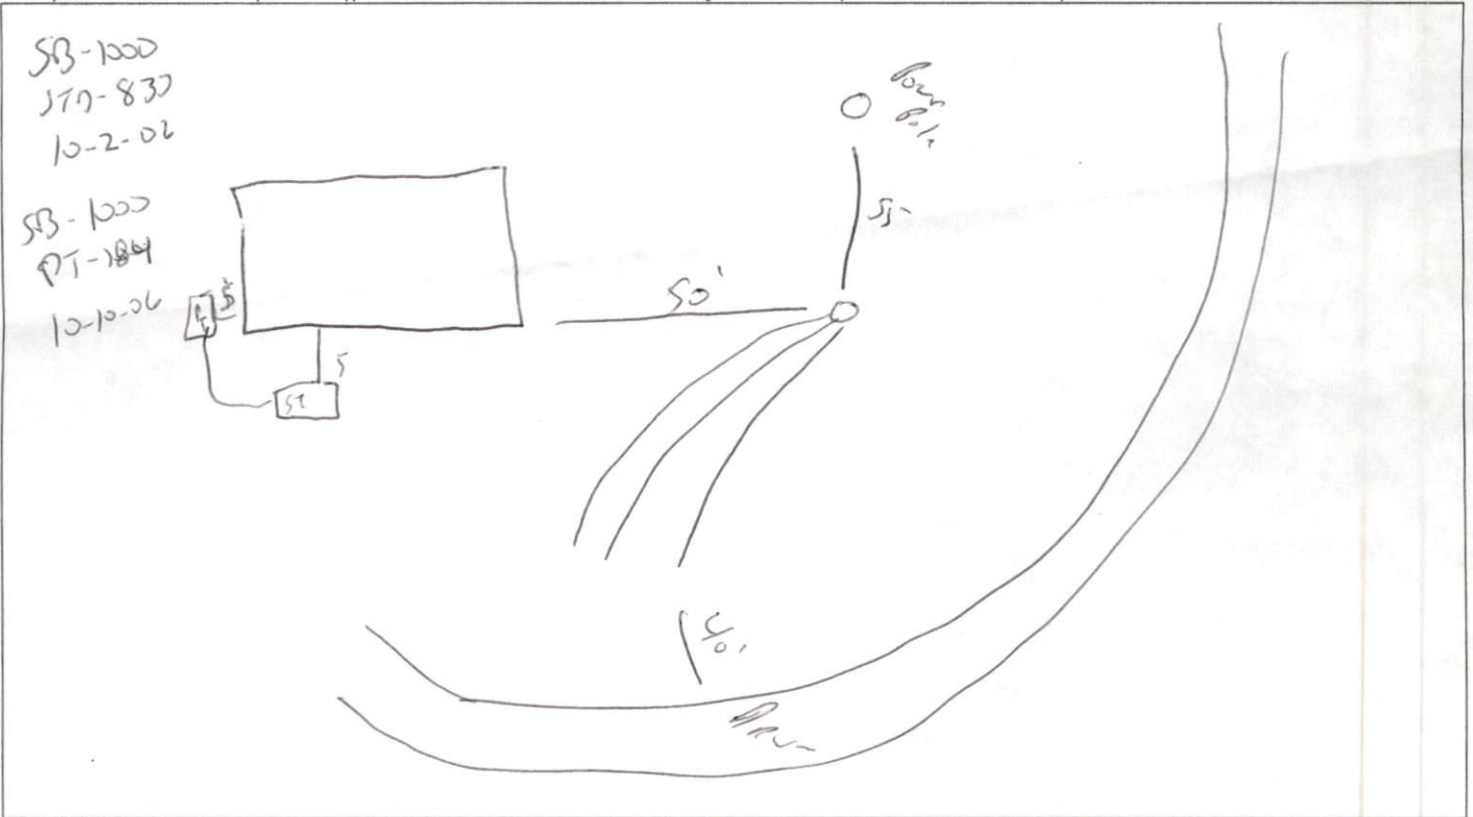

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pumpt. Conventional Size of tank: Septic Tank: 100 gallons Pump Tank: 100 gallons
 Subsurface No. of 3 exact length 90 feet width of 3 depth of 16 inches
 Drainage Field ditches 3 of each ditch 90 feet ditches 3 feet ditches 16 inches
 French Drain Required: _____ Linear feet

Authorized State Agent Joe [Signature] Date 01-08-07