

HTE# 06-50015674

Harnett County Department of Public Health 18991

PERMIT # 23216

Operation Permit

JBC Dev.

New Installation Septic Tank Repair Nitrification Line Expansion

Name: (owner) JASON Price Const.

PROPERTY LOCATION: 1201

SUBDIVISION CAROLINA SEASON 1

LOT # B 24

System Installer: Ted Brown

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 50 feet

System Type: Pump to Infiltrator grade 4 **III S** Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

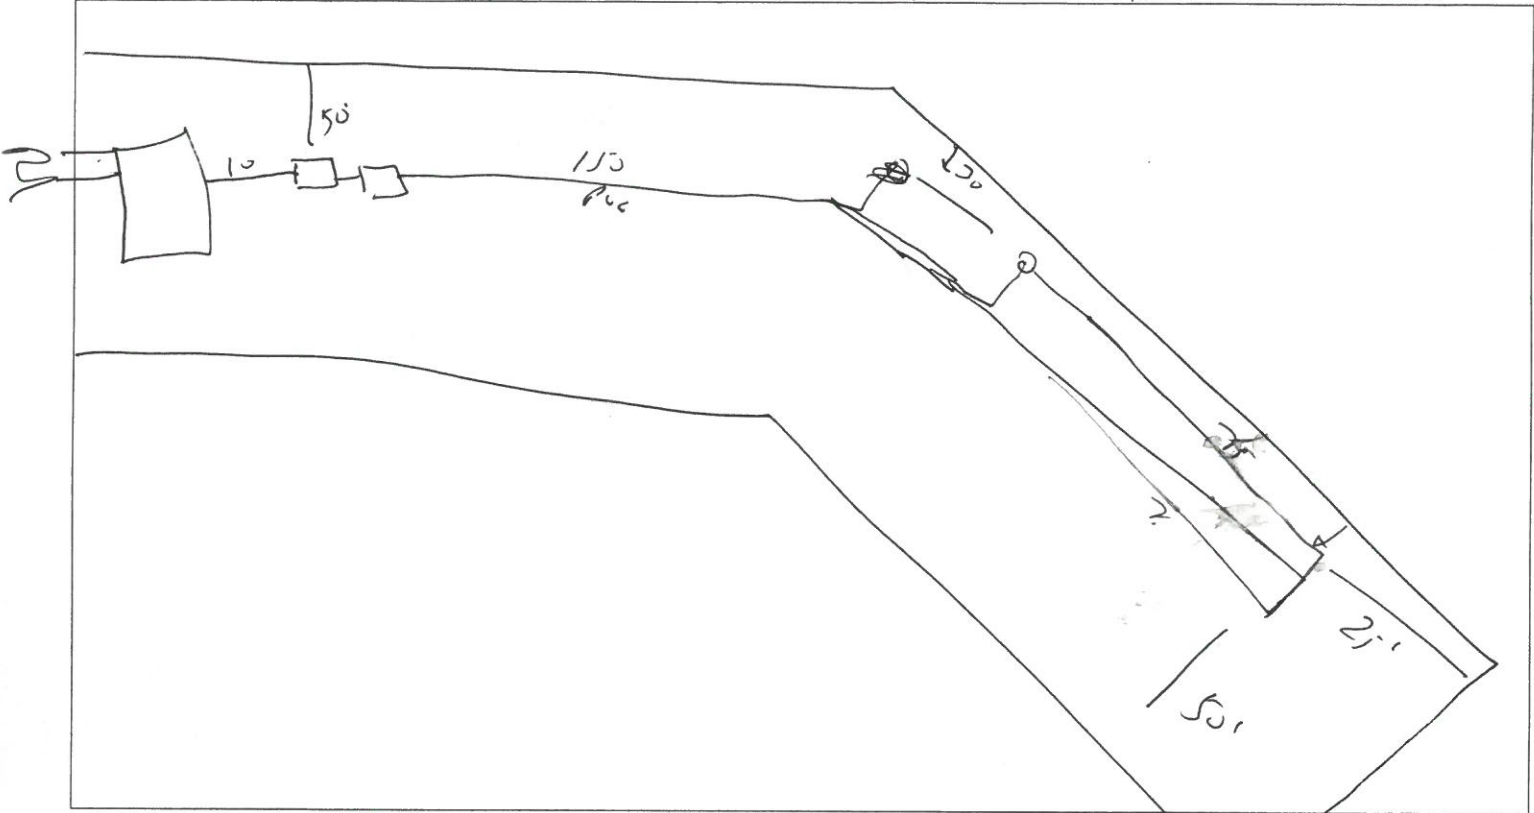

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pump to Conventional Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface Drainage Field: No. of ditches 1 exact length of each ditch 150 feet width of ditches 7 feet depth of ditches 18.24 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 03-07-07