
HTE# 06-500-15958R Harnett County Department of Public Health

Improvement Permit

26501

A building permit cannot be issued with only an Improvement Permit PROPERTY LOCATION: Doc's Road		
MILLED TO GARY Robinson 1		or # 40
NEW TO REPAIR TO EXPANSION		
Type of Structure: SFO- 45×45	3BR	
Proposed Wastewater System Type: 25% Redu	uction Sys.	
Projected Daily Flow: 360 GPD		
Number of bedrooms: Number of Occupa	oants: max	
Basement Yes 'Mo No		
	red based on final location and elevations of facilities	
Type of Water Supply: Community Public Public	☐ Well Distance from well 100 feet Permit valid for: ☐ Five	: years
Permit conditions: 1'reet un site to-	Final Layort & Maintain All SetBacks 100	expiration
ORNIGHT Dumbing SI	hallow where shown, STUB Out At ground	level
	REHI Date: 02.28-2011 SEE ATTACHED SITE	CUPROLL
Authorized State Agent:: The issuance of this permit by the Health Department in no way quarant.	Date: Oak AS SEE ATTACHED SITE ttees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their	
site is subject to revocation if the site plan, plat, or the intended use the Laws and Rules for Sewage Treatment and Disposal and to conditions	hanges. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with	requirements, inis h the provisions of
	Construction Authorization	
	(Required for Building Permit)	
The construction and installation requirements of Rules .1950, .1952, .195 with the attached system layout.	754, .1955, .1956, .1957, .1958. and .1959 are incorporated by references into this permit and shall be met. Systems shall be install	led in accordance
ISSUED TO: GARY Robinson	Homes PROPERTY LOCATION: Doc's Road	
CEO HENDE 20	SUBDIVISION COLONIAL HILLS LOT	# 40
Facility Type: SFO 45x45 38		
Basement? Yes No Basement Fixtu		
Type of Wastewater System** みらん &	eduction system (Initial) Wastewater Flow: 360	GPD
(See note below, if applicable 🗚)		
LPP R	epara 360 LF (Repair)	
Installation Requirements/Conditions	Number of trenches	
Septic Tank Size <u>1000</u> gallons	Exact length of each trench 200 feet Trench Spacing: Feet on Co	enter
Pump Tank Size gallons	Trenches shall be installed on contour at a Soil Cover: inches	
0	Maximum Trench Depth of: 18 inches (Maximum soil cover shall not exceed	
	(Trench bottoms shall be level to +/-1/4" 36" above the trench bottom)	
	in all directions)	
Pump Requirements:ft. TDH vs	,	
rump kequirementsit. 10n vs		es below pipe
e ve	Aggregate Depth: inch	
Conditions:		_ inches total
WATER LINES (INCLUDING IRRIGATION) MUST BI	E TOFT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.	
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DR		
**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.		
и аррисаше. Типоетзіано те зумет туре зрестей то отпетень пот те туре зрестей он те аррисацот, і ассерь те мрестсацоть от тих регипь.		
Owner/Legal Representative Signature:		
	lat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the	site. This
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH		
$\overline{}$		
Authorized State Agent:	RCHS Date: 02-28-2011	
↓	Construction Authorization Expiration Date: 192-28- 2016	

Harnett County Department of Public Health Site Sketch

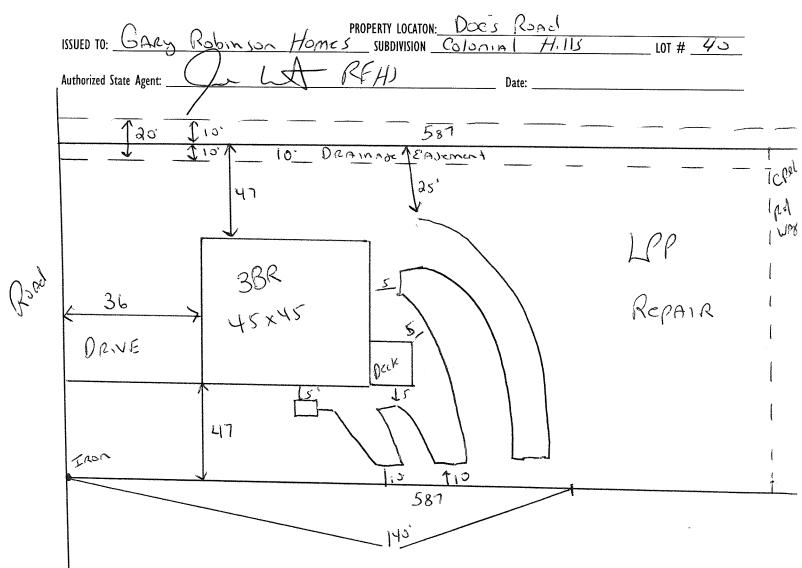

STUB Out Plumbing At ground level or higher where Shown.

Keep All under ground utilities 10 from any part of septic system and Repair Area

MAINTAIN All Sct BACKS - Keep drainLines 25' from Property Line with drainage Easement along it.