

HTE# 0650016022 R

Harriet County Department of Public Health

23674

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: John Campbell Builders
 NEW REPAIR EXPANSION
 Type of Structure: SFD - 42x58 - 3BR
 Proposed Wastewater System Type: Pump to Gravel
 Projected Daily Flow: 360 GPD
 Number of bedrooms: 3 Number of Occupants: 6 max
 Basement Yes No

PROPERTY LOCATION: 1114
 SUBDIVISION Colonial Hills LOT # 51

Site Improvements required prior to Construction Authorization Issuance:
Note may need to change to 25% reduction system to get out of pump requirement

Pump Required: Yes No May be required based on final location and elevations of facilities
 Type of Water Supply: Community Public Well Distance from well 50 feet Permit valid for: Five years No expiration
 Permit conditions: STUB out plumbing shallow at ground level or higher where shown & pump may not be required if 18 to 24" Pitch Piping can be maintained - meet on site

Authorized State Agent: [Signature] Date: 2-26-07 SEE ATTACHED SITE SKETCH
 The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: John Campbell Builders

PROPERTY LOCATION: 1114
 SUBDIVISION Colonial Hills LOT # 51

Facility Type: SFD - 42x58 - 3BR New Expansion Repair
 Basement? Yes No Basement Fixtures? Yes No
 Type of Wastewater System** Pump to Gravel (Initial) Wastewater Flow: 360 GPD
 (See note below, if applicable) 290 LF 1 LPP (Repair)

Installation Requirements/Conditions

Septic Tank Size 1000 gallons Exact length of each trench 1x240 feet Trench Spacing: 9 Feet on Center
 Pump Tank Size 1000 gallons Trenches shall be installed on contour at a Soil Cover: 6 inches
if needed Maximum Trench Depth of: 18-24 inches (Maximum soil cover shall not exceed 36" above the trench bottom)
 Pump Requirements: _____ ft. TDH vs. _____ GPM in all directions)
 Conditions: _____ Aggregate Depth: 6 inches below pipe
2 inches above pipe
12 inches total

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.

Authorized State Agent: [Signature] Date: 2-26-07 SEE ATTACHED SITE SKETCH
 Construction Authorization Expiration Date: 2-26-2012

HTE# 06-50016022 R

Permit # 23674

Harnett County Department of Public Health Site Sketch

ISSUED TO: John Campbell Builders


PROPERTY LOCATOR: 1116

SUBDIVISION Colonial Hills

LOT # 57

Authorized State Agent: J. W. [Signature]

Date: 2-26-57

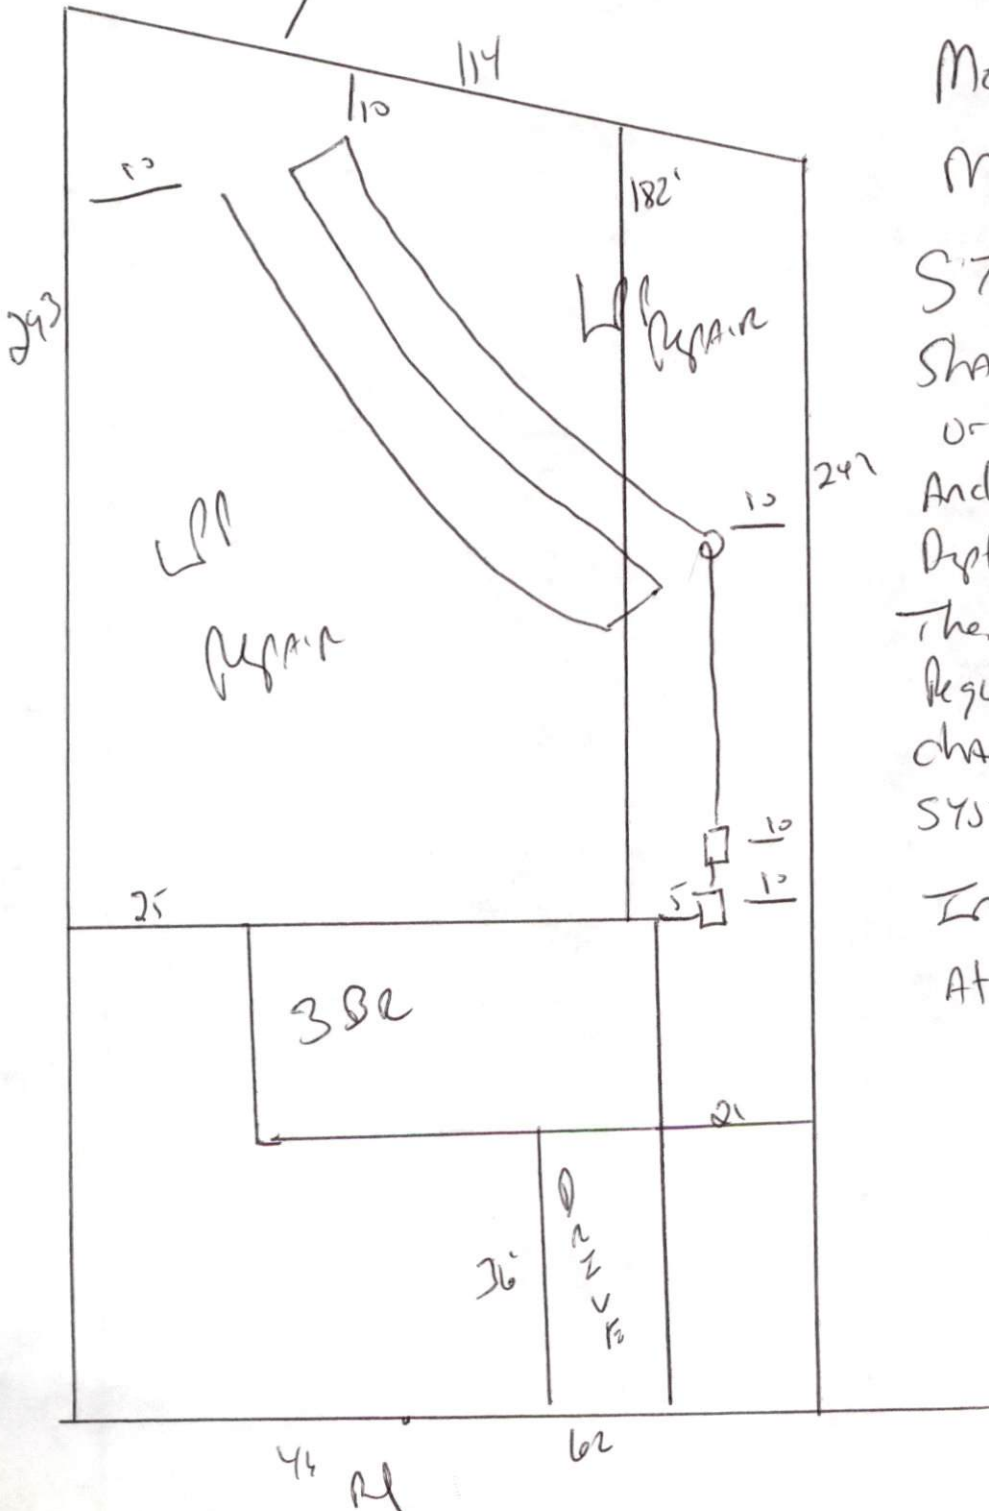

Meet on site
MAINTAIN ALL SETBACKS

STUB OUT PLUMBING
SHALLOW - AT GROUND LEVEL
OR HIGHER WHERE SHOWN
AND A 18 TO 24" DITCH
DEPTH CAN BE MAINTAINED
THEN PUMP MAY NOT BE
REQUIRED. -MAY NEED TO
CHANGE TO 25% REDUCTION
SYSTEM -

INSTALL 1x240 OF GRAVEL
AT 18" TO 24" DEEP.