

PERMIT # 27412

Operation Permit

☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ Expansion

PROPERTY LOCATION: Nc 27

Name: (owner) Kent Wren SUBDIVISION Laurel Valley LOT # 15

System Installer: Ted Brown Registration #

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 3


Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well 5 feet

System Type: Pump 7.257. Medation system III, Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

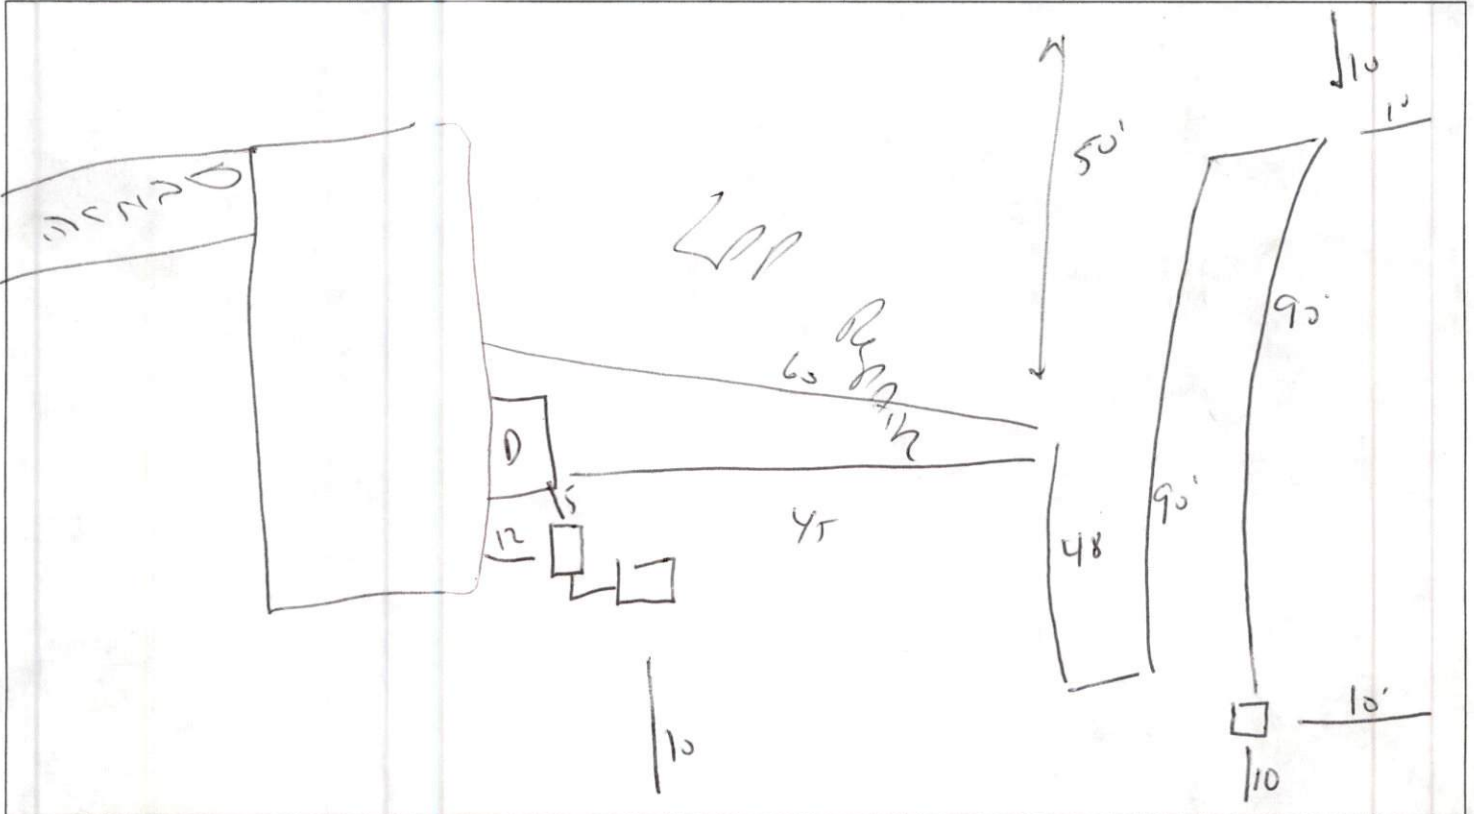

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes ☐ No ☒
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other Infiltrator 2-1/4" Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface No. of _____ exact length _____ width of _____ depth of _____
Drainage Field ditches 1 of each ditch 225 feet ditches 3 feet ditches 18.24 inches
French Drain Required: _____ Linear feet

Authorized State Agent

Date 5-8-07