

HTE# 06-50016168

Harnett County Department of Public Health 19209

PERMIT # 23412

Operation Permit

☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: NC 27Name: (owner) Kent PierceSUBDIVISION Laurel ValleyLOT # 16System Installer: Ted Brown


Registration # _____

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 3Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well 50 feetSystem Type: Septic Infiltrator 146 Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

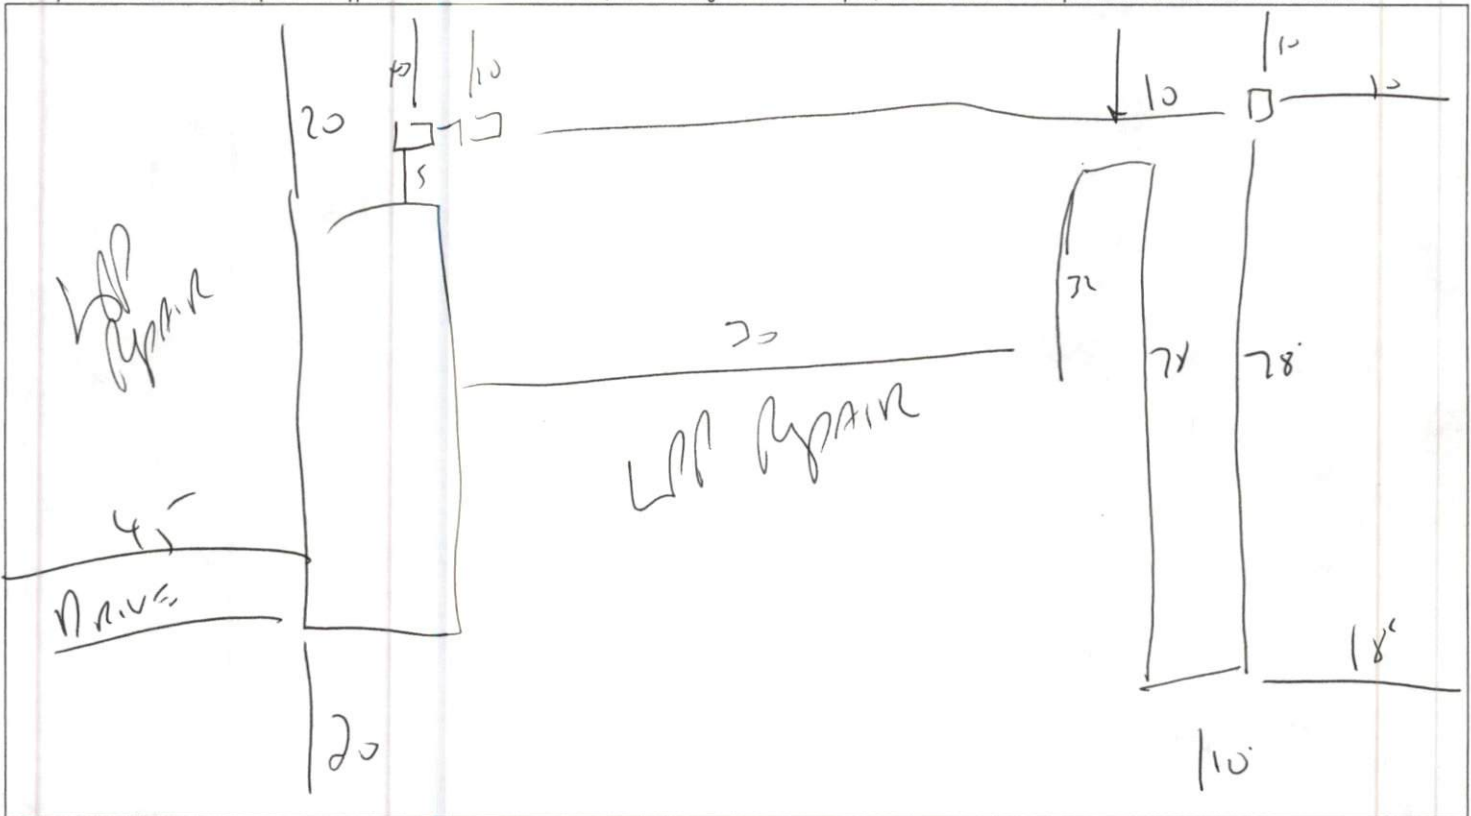

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other Septic Quick 4 Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallonsSubsurface No. of exact length width of depth of
Drainage Field ditches 1 of each ditch 180 feet ditches 7 feet ditches 18.24 inches

French Drain Required: _____ Linear feet

Authorized State Agent J. L. WainDate 4-18-07