


Southeastern Soil & Environmental Associates, Inc.

P.O. Box 9321
Fayetteville, NC 28311
Phone/Fax (910) 822-4540
Email meaker3851@aol.com

HUNTERS POINT
LOTS 16 + 17
PROPOSED SEPTIC

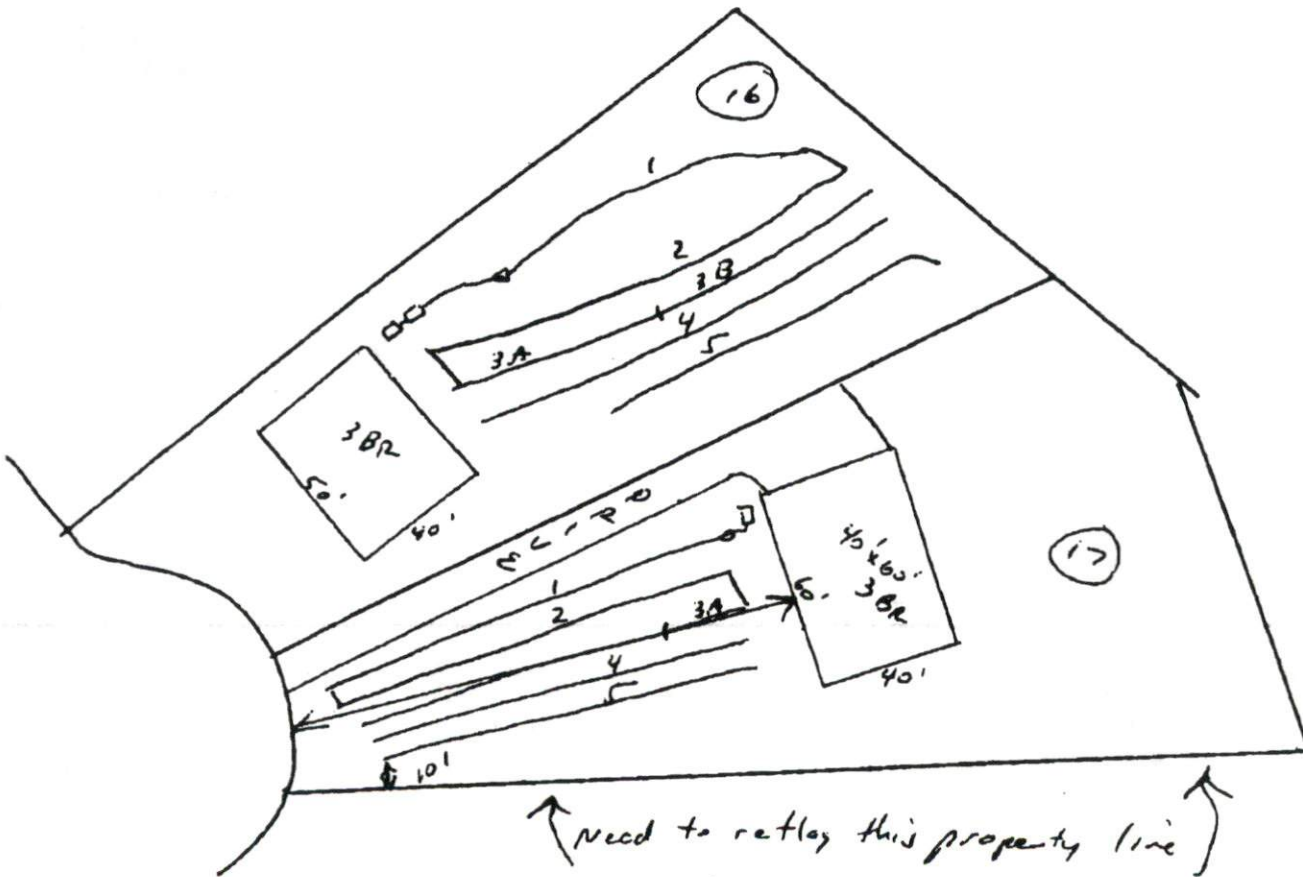

⊗ 142' HOUSE SETBACK ON LOT 17

1" = 50'

SOUTHEASTEN SOIL & ENVIRONMENTAL ASSOC, INC.

PROPOSED SUBSURFACE WASTE DISPOSAL SYSTEM DETAIL SHEET

SUBDIVISION Hunter Point

LOT 17

INITIAL SYSTEM Approved 25% red

REPAIR pump to approved 25% red

DISTRIBUTION series

DISTRIBUTION series

BENCHMARK 100.0

LOCATION Top of water table

NO. BEDROOMS 3

proposed CAP = 0.4 gpd/ft

LINE FLAG COLOR ELEVATION ACTUAL LENGTH

LINE	FLAG COLOR	ELEVATION	ACTUAL LENGTH
1	B	99.25	
2	W	98.84	115'
3A	B	97.25	110'
			30'
			255'
3B	B	97.25	
4	W	96.60	62'
5	B	96.47	93'
			93'
			249'

Fri 5/15/07

BY M EAKER

DATE 5/20/07

May 25 07 07:28a

michael eaker

9108224540

p. 4



A facsimile from

SOUTHEASTERN SOIL & ENVIRONMENTAL

Mike Eaker
910-822-4540

To: Freddie Stencil
Fax number:

Date: 5/25/07

Regarding: Hunters Point, Lots 16+17. (4 pages)

Comments:

Following are layouts for these 2 lots.

- ① LOT 16 SHOULD BE APPROVED AS YOU PREVIOUSLY SUBMITTED
- * ② LOT 17 NEEDS TO BE REVISED WITH A 142' HOUSE SETBACK. YOU WILL ALSO NEED TO REFLAT LOWER PROPERTY LINE (AS SHOWN) TO VERIFY LOCATION. IT MAY NEED TO BE SLIGHTLY ADJUSTED TO MAINTAIN 10 FT. PLEASE SUBMIT NEW PLOT TO HARN CO.
- ③ I HAVE MET OLIVER (HARNETT CO) ON SITE AND RECEIVED APPROVAL FOR THESE DESIGNS.