

Property I
Lot #:
File #:
Code:

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner:

Address:

Applicant:

Date Evaluated: 6-4-07

Proposed Facility: SFD Design Flow (.1949): 360

Property Size:

Location of Site:
Water Supply: Public Individual Well

Property Recorded: Spring Other

Evaluation Method: Auger Boring Pit


Cut

Type of Wastewater: Sewage Industrial Process

Mixed

P R O F I L E #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			1941 Structure/ Texture	1941 Consistence/ Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1944 Saprolite Class	1944 Restr. Horiz.	
1	L 5%	0-20	SL	HL GR NSNP					.4
		20-40	SC-L	HL 1/2 BK SSSP					
2	L 5%	0-20	SL	HL GR NSNP					.4
		20-40	SC-CL	HL 1/2 BK SSSP	44 754R 412				
3	L 5%	0-18	SL	HL GR NSNP					.4
		18-40	SC-CL	HL 1/2 BK SSSP	44 754R 412				

Description	Initial System	Repair System
available Space (.1945)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
System Type(s)	25% .4	25% .4
Site LTAR	.4	.4

Other Factors (.1946): _____
Site Classification (.1948): _____
Evaluated By: 
Others Present: _____


COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND		FR-FRIABLE	SS-SLIGHTLY STICKY
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FI-FIRM	S-STICKY
FS-FOOT SLOPE		L-LOAM		VFI-VERY FIRM	VS-VERY STICKY
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3	EFI-EXTREMELY FIRM	NP-NON-PLASTIC
H-HEAD SLOPE		SIL-SILT LOAM		SP-SLIGHTLY STICKY	
CC-CONCLAVE SLOPE		CL-CLAY LOAM		P-PLASTIC	
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM		VP-VERY PLASTIC	
T-TERRACE		SICL-SILTY CLAY LOAM			
FP-FLOOD PLAN	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			


STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

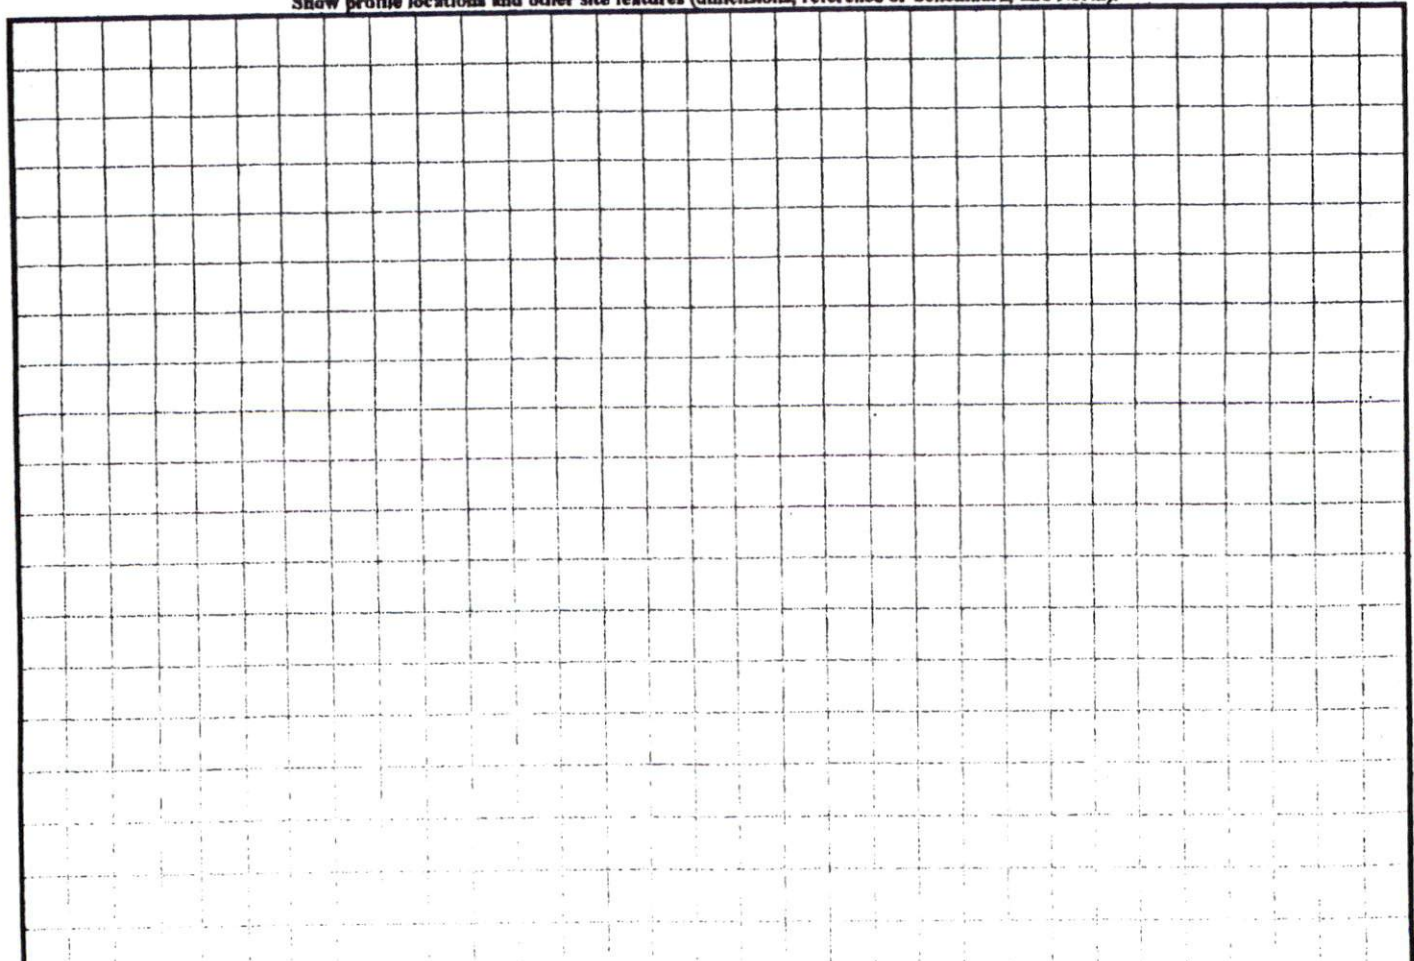

Lot 26 Hunters Point
101 Weatherby Ct.

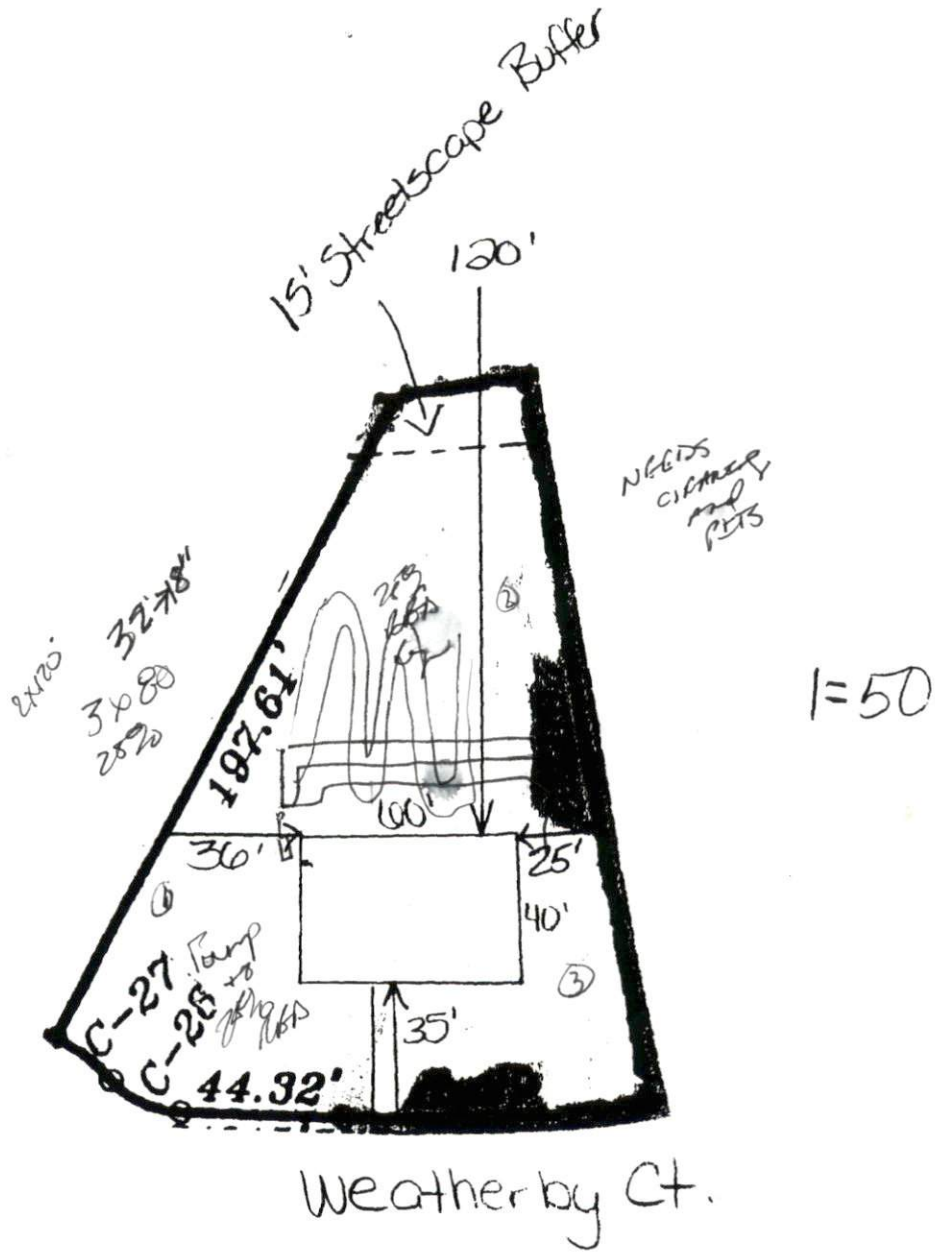

TE PLAN APPROVAL
DISTRICT RA3C USE SFD
EDRCCMS 3
2-22-07 diagram